

# **HYDRAULIC / HYDROLOGIC CALCULATIONS**

**Site Plan**  
**Upton Apartments**  
**47 Main Street**  
**Upton, MA**

**Applicant/Developer:**  
**Lobisser Building Corp.**  
**1 Charlesview Road**  
**Hopedale, MA 01747**

**Prepared By:**

**D&L Design Group, Inc.**  
**115 Water Street**  
**Milford, MA 01757**

**September 12, 2023**



## **TABLE OF CONTENTS**

### **Drainage Summary**

#### **Stormwater Management Calculations**

**Standard #2: Peak Discharge Rates**

**Standard #3: Loss of Annual Recharge**

**Standard #4: 80% TSS Removal**

**Standard #9: Operation & Maintenance Plan**

**Drawdown Calculations**

**Stormwater Checklist**

**Additional Calculations**

### **Appendices**

**Inspection Report During Construction**

**Inspection Reports After Construction**

**Soil Maps & Soil Logs**

**Hydrocad Files**

**Pre-Development Diagram**

**Post- Development Diagram**

## **DRAINAGE SUMMARY**

D&L Design Group Inc. is pleased to provide the following Hydraulic / Hydrologic analysis for the proposed site plan for Upton Apartments located at 47 Main Street.

The proposed 68-unit Comprehensive Permit mixed-income rental multifamily project is located at 47 Main Street between 45 and 51 Main Street in Upton, MA. The existing site consists of 6.75± acres of undisturbed wooded area.

The hydrologic conditions were analyzed using TR-55 and HydroCAD® for the 2, 10, 25, and 100-year storm events utilizing Technical Paper 40, 24-hour Rainfall events.

The proposed Project will include construction of:

- A 4-story apartment building,
- 105 parking spaces including 24 parking spaces in 3 detached garage buildings,
- Accessory uses including a playground, grill area, and dog park,
- Driveway access to access Main Street (MA Route 140), and parking areas around the proposed building.
- Retaining walls and landscaping as shown on the preliminary engineering plans,
- A sewer main and pump station, and
- An 8" water main loop to service the apartment building.

The proposed grading of the site has been designed so that all runoff from the proposed Project can be collected, treated, and mitigated before all runoff is discharged toward the existing wetlands located on the site or before it leaves the subject site.

The project as designed conforms to the Massachusetts DEP Stormwater Management Policy.

### **EXISTING CONDITIONS**

As noted above, the Project is located at a wooded, undisturbed 6.75± acre site at 47 Main Street in Upton, MA. There is an existing wetland (approximately 0.45 acres) at the southern end of the site. Another wetland (approximately 0.42 acres) is at the east portion of the site closest to School Street. A very small uphill wetland is at the west side of the site (approximately

0.05 acres). An Order of Resource Area Delineation (ORAD) (MassDEP 311-0799) was issued by the Upton Conservation Commission on June 30, 2022.

The parcel slopes from the north to the east and the south. To analyze the effect of the proposed Project on the existing wetlands to the south and the east, the subject site was analyzed as two watersheds.

In the Pre-Development Condition, Subcatchment 1 represents the tributary area of the property that flows to the south property line toward Main Street and the wetlands located there.

Subcatchment 2 represents the tributary area of the property that flows to the east property line toward School Street and the wetlands located there.

According to the online USGS soil survey, the analyzed areas consist of soils with "C" hydrologic ratings. Per the soil testing performed on the site for the proposed project the soil classification and characteristics of the soil have been confirmed.

All soil testing was witnessed by the Upton Conservation Agent.

## **PROPOSED CONDITIONS**

The proposed design of the site will consist of a grass area around the driveway and parking areas as well as the proposed apartment building and parking garages as shown on the plans.

The area left undisturbed will be woodland area adjacent to the wetlands and the middle of the site.

The proposed drainage system will consist of catch basins and drain manholes located within the project to collect and direct the runoff into two forebay and infiltration basins (Basin #1 and Basin #2). The infiltration basins will then discharge into a small settling basin with level spreaders that will create a sheet flow and discharge into the 30-foot No Disturb area.

The site will also use the proposed recharge at the building location that will collect and direct the roof runoff into an underground basin near the southeast corner of the residential building.

To analyze surface water flows, the site was divided into multiple Subcatchments, Ponds, and Reaches.

In summary, the peak rates of runoff were compared under pre-development and post-development conditions for analysis of the 2-year, 10-year, 25-year, and 100-year storm events.

The following is a **Peak Discharge Summary Table**:

### Design Point Analysis:

Watershed		Design Event			
		2 Year	10 Year	25 Year	100 Year
Pre-Development	IP#1E	4.97/0.361	11.43/0.797	15.89/1.11	23.04/1.61
	IP#2E	4.3/0.341	10.14/0.766	14.21/1.07	20.77/1.57
Post Development	IP#1P	3.29/0.331	11.18/0.787	15.70/1.11	22.46/1.61
	IP#2P	1.83/0.151	4.49/0.619	7.50/0.995	15.27/1.51

### DEP STORMWATER MANAGEMENT STANDARDS

**Standard #1:** The proposed changes will not cause erosion in adjacent water of the Commonwealth, as BMP measures are proposed in accordance with the design requirements of the Stormwater Management Handbook. The Erosion & Sedimentation Control Plan provides for the installation of siltation barriers, temporary basins, and temporary construction entrances. The Erosion & Sedimentation Control Plan outlines intermediary measures to control runoff during construction and after construction.

**Standard #2:** The proposed development peak discharge rates for the total off-site flows are less than or equal to pre-development discharge rates for the 2-year, 10-year, 25-year, and 100-year storm events for the design points analyzed. **See attached calculations above showing how the site mitigates the increased flow rates resulting from proposed design surface changes.**

**Standard #3:** The proposed project proposes all roof runoff to be infiltrated into the ground. Recharge will also be accomplished along the grass swale located along the driveway. The existing settling basin will be monitored throughout the construction to ensure that the runoff depths are designed to drain in under 72 hours as required by the BMP. **See attached calculations below.**

**Standard #4:** Over 80% TSS removal shall occur based on the BMP measurements provided. The treatment train varies for each section. TSS removal worksheets are provided for each treatment train on the site. **See attached calculations.**

**Standard #5:** The proposed Project will not generate higher potential pollutant loads and therefore will not require additional BMP practices.

**Standard #6:** The proposed Project is not near a critical area.

**Standard #7:** The proposed Project is not a redevelopment project.

**Standard #8:** Erosion and sediment control measures are proposed as part of the proposed Project.

**Standard #9:** An Operation & Maintenance Plan **See attached plan.**

**Standard #10:** This Project does not propose any illicit discharges.

## **STANDARD #3 –LOSS OF ANNUAL RECHARGE**

Recharge Basins at Building are constructed for recharge following the Stormwater Regulations. Soils were found to be Class C permeability.

The table below shows the required and provided recharge volumes for the project. As shown, the proposed condition exceeds the minimum requirement for the additional impervious areas.

**Recharge Volume Summary**

Soil Type	Recharge Factor (in. runoff)	Existing Impervious Area (sf)	Additional Impervious Area (sf)	Min. Req. Recharge Volume (cf)
A	0.60	0	0	0
B	0.35	0	0	0
C	0.25	0	86,790	1,808
D	0.10	0	0	0
<b>Total Required</b>				<b>1,808</b>

Standard #3 Only Applies to Additional Impervious

Provided Recharge Volume (cf)		
Basin 1		5,222
Basin 2		3,075
Basin 4		7,840
<b>Total Provided</b>		<b>16,137</b>

### **Recharge Volume Calculation:**

$$Rv = F \times I$$

Rv = Required Recharge Volume

F = Recharge Factor

I = Total Impervious Area (Proposed)

$$Rv = (0.25")/(1"/12") \times 86,790 \text{ s.f.} = 1,808 \text{ cf (Required)}$$

Provided Infiltration is 16,137 cf taken from Stage Storage Worksheet

## **STANDARD #4- 80% TSS REMOVAL**

ESTIMATED PROPOSED NEW PAVED COVER= 64,390 S.F.

### **REQUIRED WATER QUALITY VOLUME:**

<b>Water Quality Volume</b>		
Required Treatment Volume	1.0	Inches Over Impervious Areas
Watershed Series	Paved Area	Water Quality Volume
P-1 (pavement)	32,428	2,703
P-2	27,755	2,303
P-3	4,207	350

The design of the drainage system is such that the site is routed through a series of treatment BMP's meeting the Standard. The attached TSS Removal worksheets show the water treatment prior to the proposed basins located within the proposed development. No bypass is designed of the BMP's reducing the WQV.

### **Water Quality Volume Calculation:**

#### **P-1 (Basin 1)**

Wv = F x I

Wv = Required Water Quality Volume

F = Water Factor

I = Total Impervious Area

Rv = (1")/(1'/12") x 32,428 s.f. = 2,703 cf (Required)

Provided 2,826 c.f.

#### **P-2(Basin 2)**

Wv = F x I

Wv = Required Water Quality Volume

F = Water Factor

Rv = (1")/(1'/12") x 27,755 s.f. = 2,303 cf (Required)

Provided 2,330 c.f.

#### **P-3(Basin 3)**

Wv = F x I

Wv = Required Water Quality Volume

F = Water Factor

Rv = (1")/(1'/12") x 4,207 s.f. = 350 cf (Required)

Provided 2,228 c.f.

## **STANDARD #9- OPERATION & MAINTENANCE**

### ***OPERATION & MAINTENANCE PLAN:***

#### **Applicant & RESPONSIBLE PARTY:**

The current owner is the Pederson Family Trust who will be selling the land to Lobisser Building Corp once the project is approved.

#### **FUTURE OWNER & RESPONSIBLE PARTY:**

47 Main LLC (to be formed). The Manager of the proposed LLC will be Kevin W. Lobisser.

#### **DURING CONSTRUCTION:**

##### ***SILT FENCE BARRIER:***

The silt fence barrier shall be installed prior to construction.

During construction the contractor shall inspect the silt fence barrier on a weekly basis and after any significant rainstorm resulting in greater than 0.5" of rainfall. The barrier shall be inspected for any breaches or disturbances and repaired immediately.

After construction is substantially completed, the barrier shall be maintained as stated above until all new areas are vegetated.

After construction is substantially completed, these duties shall be transferred to the property owner.

#### ***CONSTRUCTION ENTRANCE APRONS:***

Construction aprons shall be installed to protect Main Street. The construction entrance apron shall be installed prior to commencement of construction and shall be inspected weekly. The construction entrance apron shall be replaced when debris becomes noticeable on the existing pavement surfaces leading to and from the construction site.

#### ***SLOPE STABILIZATION:***

The slope stabilization controls shall be installed immediately upon obtaining final grades as shown on the project plans. Slopes in the swale area shall be stabilized according to the details provided. All 3:1 slopes established on-site shall be loamed and seeded as soon as the weather permits. Any 2:1 slopes established shall be covered with slope stabilization fabric, then loamed and seeded as soon as weather permits. Areas in failure shall be re-graded to final grade and stabilized as necessary.

**TEMPORARY BASINS:**

The temporary basins shall be inspected immediately after storm events and cleaned to remove sediment build-up. Outfalls shall be inspected for erosion or scouring. Additional rip rap shall be added as required to minimize erosion. Temporary basins will be constructed as needed and determined during construction.

**OUTLET CONTROL STRUCTURE:**

Outlet control structures at basins have temporary stone or other filtration devices installed around inlet to prevent sediment deposits. Sediment shall be removed when accumulation exceeds 1" depth on paved surfaces.

**CHECK DAMS:**

Check Dams shall be inspected weekly and after rainfall in excess of 0.5". Accumulated sediment shall be removed when depth exceeds 3" on the upstream side of the dam. Stone or fabric shall be replaced when evidence of clogging is present.

**CONSTRUCTION COMPLETION:**

The entire stormwater management system shall be inspected upon completion of construction. Portions of the system containing sediment shall be cleaned and all sediment properly removed.

**AFTER CONSTRUCTION:****SEDIMENT BASIN:**

Sediment Basins shall be visually inspected monthly for accumulation of debris, slope failure, or stone displacement. Slopes shall be mowed quarterly. Bottom shall be swept/vacuumed of accumulated debris semi-annually.

**CATCH BASIN & DROP INLET:**

At a minimum, the catch basins shall be inspected and cleaned on a quarterly basis. It is preferred that collection of accumulated sediment shall be accomplished by means of vacuum pumping and not by means of a clamshell bucket. Disposal of accumulated sediment shall be performed in accordance with applicable local, state, and federal guidelines and regulations.

**GRASS SWALES & INFILTRATION BASIN:**

Inspect infiltration basin after major storm events (>3.0 inches) to verify stabilization and infiltration. Mow slopes and/or berms quarterly. Remove accumulated clippings from infiltration stone. Inspect basin semi-annually for the following:

- Signs of differential settlement

- Cracking
- Erosion
- Leakage in embankments
- Tree growth on embankments
- Condition of rip rap
- Sediment accumulation
- Turf health.

## LONG TERM POLLUTION PREVENTION PLAN

The following are the material management practices that shall be used to reduce the risk of spills or other accidental exposure of materials and substances to stormwater runoff.

**Good Housekeeping:** The following good housekeeping practices will be followed on site during the construction project and continued upon completion of the construction activities.

1. A concerted effort shall be made to store only enough product required to complete a particular task.
2. All materials stored on site shall be stored in a neat and orderly fashion in their appropriate containers and, if possible, under a roof or other secure enclosure.
3. Products shall be kept in their original containers with the original manufacturer's label.
4. Substances shall not be mixed with one another unless recommended by the manufacturer.
5. Whenever possible, all of a product shall be used up before disposing of the container.
6. The manufacturer's recommendations for proper use and disposal shall be followed.
7. The site superintendent shall inspect daily to ensure proper use and disposal of materials on site.

**Hazardous Products:** The following practices are intended to reduce the risks associated with hazardous materials.

1. Products shall be kept in original containers unless they are not re-sealable.
2. Where feasible, the original label and material safety data shall be retained, given that they contain important product information.
3. If surplus product must be disposed, follow manufacturers or local and State recommended methods for proper disposal.

**Product Specific Practices:** The following product-specific practices shall be followed on site:

**Petroleum Products:**

1. All on-site vehicles shall be monitored for leaks and receive regular preventative maintenance to reduce the risk of leakage.
2. Petroleum products shall be stored in tightly sealed containers that are clearly labeled.
3. Petroleum Products shall be stored in compliance with applicable Fire Marshall regulations.

**Bituminous Concrete:**

Any bituminous concrete or asphalt substances used on site shall be applied according to the manufacturer's recommendations.

**Fertilizers:**

Fertilizers shall be applied in the minimum amounts recommended by the manufacturer.

Once applied, fertilizers shall be worked into the soil to limit exposure to stormwater.

Storage shall be in a covered shed or trailer. The contents of any partially used bags of fertilizer shall be transferred to a sealable plastic bag or bin to avoid spills.

**Paints:**

1. All containers shall be tightly sealed and stored when not required for use.
2. Excess paint shall not be discharged into any catch basin, drain manhole or any portion of the stormwater management system.
3. Excess paint shall be properly disposed of according to manufacturer's recommendations or State and local regulations.

**Concrete Trucks:**

Concrete trucks shall not be allowed to wash out or discharge surplus concrete or drum-wash water on site.

**SPILL CONTROL PRACTICES**

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices shall be followed for spill prevention and cleanup:

1. Manufacturer's recommended methods for cleanup shall be readily available at the onsite trailer, and site personnel shall be made aware of the procedures and the location of the information.
2. Materials and equipment necessary for spill clean-up shall be kept in the material storage area on site. Equipment and materials shall include, but not be limited to, brooms, dust pans, mops, rags, gloves, goggles, kitty litter, sand, sawdust, and plastic and metal trash containers specifically for this purpose.
3. All spills shall be cleaned up immediately after discovery.
4. The spill area shall be kept well-ventilated, and personnel shall wear appropriate protective clothing to prevent injury from contact with hazardous substances.
5. Spills of toxic or hazardous material shall be reported to the appropriate State and/or local authority in accordance with local and/or State regulations.
6. The spill prevention plan shall be adjusted to include measures to prevent a particular type of spill from reoccurring and instructions on how to clean up the spill if there is another occurrence. A description of the spill, what caused it, and the clean-up measures shall also be included.
7. The "Manager" shall be the spill prevention and cleanup coordinator. The "Manager" shall designate at least three other site personnel who will be trained in the spill control practices identified above.

## Drawdown Calculation:

### **Pond #1**

$$Time_{drawdown} = \frac{Rv}{(K)(Bottom\ Area)}$$

Where:

Rv = Storage Volume (5,222.f.)

K = Saturated 2.42 in/hour)

Bottom Area = Bottom Area of Recharge Structure (1,911 s.f.)

5,222 c.f./ (2.42 in/hour)(1inch/12foot)(1,911 s.f.) = 14 hours

### **Pond #2**

$$Time_{drawdown} = \frac{Rv}{(K)(Bottom\ Area)}$$

Where:

Rv = Storage Volume 3,075.f.)

K = Saturated 2.42 in/hour)

Bottom Area = Bottom Area of Recharge Structure (1745 s.f.)

3,075 c.f./ (2.42 in/hour)(1inch/12foot)(1,745 s.f.) = 9 hours

### **Pond #4**

$$Time_{drawdown} = \frac{Rv}{(K)(Bottom\ Area)}$$

Where:

Rv = Storage Volume 7,840.f.)

K = Saturated 2.42 in/hour)

Bottom Area = Bottom Area of Recharge Structure (3,637 s.f.)

7,840 c.f./ (2.42 in/hour)(1inch/12foot)(3,637 s.f.) = 11 hours

## **STORMWATER MANAGEMENT CHECKLIST**



# Checklist for Stormwater Report

## B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

**Note:** Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

### Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature



Signature and Date

*M. Dean* 9-12-23

## Checklist

**Project Type:** Is the application for new development, redevelopment, or a mix of new and redevelopment?

- New development
- Redevelopment
- Mix of New Development and Redevelopment



# Checklist for Stormwater Report

## Checklist (continued)

**LID Measures:** Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- No disturbance to any Wetland Resource Areas
- Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- Reduced Impervious Area (Redevelopment Only)
- Minimizing disturbance to existing trees and shrubs
- LID Site Design Credit Requested:
  - Credit 1
  - Credit 2
  - Credit 3
- Use of "country drainage" versus curb and gutter conveyance and pipe
- Bioretention Cells (Includes Rain Gardens)
- Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- Treebox Filter
- Water Quality Swale
- Grass Channel
- Green Roof
- Other (describe): \_\_\_\_\_

### Standard 1: No New Untreated Discharges

- No new untreated discharges
- Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



# Checklist for Stormwater Report

## Checklist (continued)

### Standard 2: Peak Rate Attenuation

- Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

### Standard 3: Recharge

- Soil Analysis provided.
- Required Recharge Volume calculation provided.
- Required Recharge volume reduced through use of the LID site Design Credits.
- Sizing the infiltration, BMPs is based on the following method: Check the method used.
  - Static
  - Simple Dynamic
  - Dynamic Field<sup>1</sup>
- Runoff from all impervious areas at the site discharging to the infiltration BMP.
- Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
  - Site is comprised solely of C and D soils and/or bedrock at the land surface
  - M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
  - Solid Waste Landfill pursuant to 310 CMR 19.000
  - Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

<sup>1</sup> 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



# Checklist for Stormwater Report

## Checklist (continued)

### Standard 3: Recharge (continued)

- The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

### Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
- Provisions for storing materials and waste products inside or under cover;
- Vehicle washing controls;
- Requirements for routine inspections and maintenance of stormwater BMPs;
- Spill prevention and response plans;
- Provisions for maintenance of lawns, gardens, and other landscaped areas;
- Requirements for storage and use of fertilizers, herbicides, and pesticides;
- Pet waste management provisions;
- Provisions for operation and management of septic systems;
- Provisions for solid waste management;
- Snow disposal and plowing plans relative to Wetland Resource Areas;
- Winter Road Salt and/or Sand Use and Storage restrictions;
- Street sweeping schedules;
- Provisions for prevention of illicit discharges to the stormwater management system;
- Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
- Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
- List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.

- A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
- Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
  - is within the Zone II or Interim Wellhead Protection Area
  - is near or to other critical areas
  - is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
  - involves runoff from land uses with higher potential pollutant loads.

- The Required Water Quality Volume is reduced through use of the LID site Design Credits.
- Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



# Checklist for Stormwater Report

## Checklist (continued)

### Standard 4: Water Quality (continued)

- The BMP is sized (and calculations provided) based on:
  - The ½" or 1" Water Quality Volume or
  - The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the proprietary BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

### Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted *prior to* the discharge of stormwater to the post-construction stormwater BMPs.
- The NPDES Multi-Sector General Permit does *not* cover the land use.
- LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- All exposure has been eliminated.
- All exposure has *not* been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

### Standard 6: Critical Areas

- The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- Critical areas and BMPs are identified in the Stormwater Report.



# Checklist for Stormwater Report

## Checklist (continued)

### Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:

- Limited Project
- Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
- Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
- Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
- Bike Path and/or Foot Path
- Redevelopment Project
- Redevelopment portion of mix of new and redevelopment.

Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.

The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
- Construction Period Operation and Maintenance Plan;
- Names of Persons or Entity Responsible for Plan Compliance;
- Construction Period Pollution Prevention Measures;
- Erosion and Sedimentation Control Plan Drawings;
- Detail drawings and specifications for erosion control BMPs, including sizing calculations;
- Vegetation Planning;
- Site Development Plan;
- Construction Sequencing Plan;
- Sequencing of Erosion and Sedimentation Controls;
- Operation and Maintenance of Erosion and Sedimentation Controls;
- Inspection Schedule;
- Maintenance Schedule;
- Inspection and Maintenance Log Form.

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



# Checklist for Stormwater Report

## Checklist (continued)

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has *not* been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- The project is *not* covered by a NPDES Construction General Permit.
- The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

### Standard 9: Operation and Maintenance Plan

- The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
  - Name of the stormwater management system owners;
  - Party responsible for operation and maintenance;
  - Schedule for implementation of routine and non-routine maintenance tasks;
  - Plan showing the location of all stormwater BMPs maintenance access areas;
  - Description and delineation of public safety features;
  - Estimated operation and maintenance budget; and
  - Operation and Maintenance Log Form.
- The responsible party is *not* the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
  - A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
  - A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

### Standard 10: Prohibition of Illicit Discharges

- The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- An Illicit Discharge Compliance Statement is attached;
- NO Illicit Discharge Compliance Statement is attached but will be submitted *prior to* the discharge of any stormwater to post-construction BMPs.

## STAGE-STORAGE WORKSHEET

**DATE:** 8/24/2023      **CLIENT:** lobisser  
**PROJECT NUMBER:** J-16      **CALCULATED BY:** PML  
**BASIN NUMBER:** 1      **CHECKED BY:**  
**LOCATION:** Basin 1

ELEVATION (FEET)	AREA (FT <sup>2</sup> )	AVERAGE	VERTICAL	VOLUME	VOLUME
		AREA (FT <sup>2</sup> )	INTERVAL (FT)	INCREMENTAL (FT <sup>3</sup> )	CUMULATIVE (FT <sup>3</sup> )
320.0	528			0	
324.0	2083	1306	4	5222	5222

## STAGE-STORAGE WORKSHEET

**DATE:** 8/24/2023      **CLIENT:** lobisser  
**PROJECT NUMBER:** J-16      **CALCULATED BY:** PML  
**BASIN NUMBER:** 1      **CHECKED BY:**  
**LOCATION:** Basin 1

ELEVATION (FEET)	AREA (FT <sup>2</sup> )	AVERAGE	VERTICAL	VOLUME	VOLUME
		AREA (FT <sup>2</sup> )	INTERVAL (FT)	INCREMENTAL (FT <sup>3</sup> )	CUMULATIVE (FT <sup>3</sup> )
322.0	518				0
325.0	1532	1025	3	3075	3075

## STAGE-STORAGE WORKSHEET

**DATE:** 8/24/2023      **CLIENT:** lobisser  
**PROJECT NUMBER:** J-16      **CALCULATED BY:** PML  
**BASIN NUMBER:** 1      **CHECKED BY:**  
**LOCATION:** Basin 1

ELEVATION (FEET)	AREA (FT <sup>2</sup> )	AVERAGE	VERTICAL	VOLUME	VOLUME
		AREA (FT <sup>2</sup> )	INTERVAL (FT)	INCREMENTAL (FT <sup>3</sup> )	CUMULATIVE (FT <sup>3</sup> )
324.5	3637			0	
326.5	3637	3637	2	7274	7274

## STAGE-STORAGE WORKSHEET

DATE: 8/24/2023  
PROJECT NUMBER: J-10  
BASIN NUMBER: 1  
LOCATION: Basin 1

CLIENT: lobisser  
CALCULATED BY: PML  
CHECKED BY:

ELEVATION (FEET)	AREA (FT <sup>2</sup> )	AVERAGE AREA (FT <sup>2</sup> )	VERTICAL INTERVAL (FT)	VOLUME INCREMENTAL (FT <sup>3</sup> )	VOLUME CUMULATIVE (FT <sup>3</sup> )
320.0	400				0
323.0	1484	942	3	2826	2826

## STAGE-STORAGE WORKSHEET

**DATE:** 8/24/2023      **CLIENT:** lobisser  
**PROJECT NUMBER:** J-16      **CALCULATED BY:** PML  
**BASIN NUMBER:** 2      **CHECKED BY:**  
**LOCATION:** Basin 2

ELEVATION (FEET)	AREA (FT <sup>2</sup> )	AVERAGE	VERTICAL	VOLUME INCREMENTAL (FT <sup>3</sup> )	VOLUME CUMULATIVE (FT <sup>3</sup> )
		AREA (FT <sup>2</sup> )	INTERVAL (FT)		
322.0	830			0	
324.0	1500	1165	2	2330	2330

## STAGE-STORAGE WORKSHEET

DATE: 8/24/2023  
PROJECT NUMBER: J-16  
BASIN NUMBER: 3  
LOCATION: Basin 3

**CLIENT: lobisser**  
**6 ALCULATED BY: PML**  
**CHECKED BY:**

ELEVATION (FEET)		AVERAGE AREA (FT <sup>2</sup> )	VERTICAL INTERVAL (FT)	VOLUME INCREMENTAL (FT <sup>3</sup> )	VOLUME CUMULATIVE (FT <sup>3</sup> )
331.0	240				0
334.0	1245	743	3	2228	2228

## **APPENDICES:**

**Soil Logs and Soil Map Information**

**Inspection & Maintenance Logs During Construction**

**Inspection & Maintenance Logs After Construction**

**Hydrocad Files**

**Pre-Development Watershed Map**

**Post-Development Watershed Map**

**WEEKLY**  
**Inspection and Maintenance Log**  
**DURING CONSTRUCTION**

FOR: Main St.  
& After 1.0" Rain

Components	Date
<b>Erosion Control – Weekly</b> Comments during insp.	
Note corrective measures performed & Date	
<b>On Site Pavement</b> <b>Sweeping – as Needed</b> Comments during insp.	
Note corrective measures performed & date	
<b>Silt Fence &amp; Composite Sock– Monthly</b> Comments during insp.	
Note corrective measures performed & date	
<b>Temporary Basin Area as Needed</b> Comments during insp.	
Note corrective measures performed & date	
<b>Construction Entrance as Needed</b> Comments during insp.	
Note corrective measures performed & date	
Inspector _____ Title _____ Date _____	
Address _____ Tel# _____	

**WEEKLY**  
**Inspection and Maintenance Log**  
**DURING CONSTRUCTION**      **FOR: Main St.**  
**& After 1.0" Rain**

Components	Date
<b>Notify Cons. Comm. Issues effecting Resource Areas</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Silt of Public (Charlton Road)</b>	
<b>Streets – Daily</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Stockpile Materials</b>	
<b>Ring with Composite Sock – Weekly</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Any Spill Fuel, Chemical- Daily</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Temporary Ground Cover Area – Weekly</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Temporary Stone at Access Drive as Needed</b>	
Comments during insp.	
Note corrective measures performed & date	
<b>Note corrective measures performed &amp; date</b>	
Comments during insp.	
Note corrective measures performed & date	
Comments during insp.	
Note corrective measures performed & date	
Comments during insp.	
Note corrective measures performed & date	

Inspector	Title	Date
-----------	-------	------

Address	Tel#
---------	------

**WEEKLY  
Inspection and Maintenance Log  
DURING CONSTRUCTION**

FOR: Main St.  
& After 1.0" Rain

Components	Date	
<b>Lawn Area / Mulch Area</b>		
<b>Erosion, Washouts</b>		
Comments during insp.		
 Note corrective measures performed & date		
<b>Stone Aprons at Outfalls Exit as Needed</b>		
Comments during insp.		
 Note corrective measures performed & date		
<b>Forebay as Needed</b>		
Comments during insp.		
 Note corrective measures performed & date		
<b>Illicit Drainage Discharge</b>		
 Comments during insp.		
 Note corrective measures performed & date		
Comments during insp.		
 Note corrective measures performed & date		
Comments during insp.		
 Note corrective measures performed & date		
Inspector	Title	Date
Address	Tel#	

**Inspection and Maintenance Log  
AFTER CONSTRUCTION**

FOR: Main Street  
& After 3.0" Rain

Components	Date	
<b>Basin#1</b> - twice a year		
Comments during insp.		
Note corrective measures performed & Date		
<b>Basin#2</b> -twice a year		
Comments during insp.		
Note corrective measures performed & date		
<b>Forebay#1</b> -twice a year		
Comments during insp.		
Note corrective measures performed & date		
<b>Forebay#2</b> -twice a year		
Comments during insp.		
Note corrective measures performed & date		
<b>Catch Basins</b> - 8 inches of sediment or twice a year		
Comments during insp.		
Note corrective measures performed & date		
Inspector	Title	Date
Address	Tel#	

**Inspection and Maintenance Log  
AFTER CONSTRUCTION**

**FOR: Main Street  
& After 3.0" Rain**

<b>Components</b>	<b>Date</b>
<b>Outlet Control Structure#1</b> <b>-8 inches of sediment or twice a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>Outlet Control Structure #2</b> <b>Twice a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>Basin#3</b> <b>-four times a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>Level Spreader Basin 1</b> <b>-Twice a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>Level Spreader Basin 2</b> <b>-Twice a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>All Flared end sections and rip rap aprons</b> <b>- twice a year</b> Comments during insp.	
Note corrective measures performed & date	
<b>Components</b>	<b>Date</b>

J-016

**Inspection and Maintenance Log  
AFTER CONSTRUCTION**

**FOR: Main Street  
& After 3.0" Rain**



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### A. Facility Information

Lobisser Building Corp

Owner Name  
47 Main Street  
Street Address  
Upton  
City

Map/Lot #  
01568  
MA  
State  
Zip Code

### B. Site Information

1. (Check one)  New Construction  Upgrade  Repair

2. Soil Survey Available?  Yes  No  
If yes:

NRCS  
Source  
315B  
Soil Map Unit

Situate

Soil Name

Glacial Till

Soil Parent material

Ridge

Landform

3. Surficial Geological Report Available?  Yes  No  
If yes:

Year Published/Source

Description of Geologic Map Unit:

4. Flood Rate Insurance Map  Within a regulatory floodway?  Yes  No

5. Within a velocity zone?  Yes  No

6. Within a Mapped Wetland Area?  Yes  No  
If yes, MassGIS Wetland Data Layer:

7. Current Water Resource Conditions (USGS):  August 2023  
Month/Day/Year  
Range:  Above Normal  Normal  Below Normal

8. Other references reviewed:



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: 10-11 Hole #: 8/3/23 Date 10 am Time Clear 78 Weather Latitude 45° 4' Longitude: 4° 4' Slope (%)

1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.)

Description of Location:

2. Soil Parent Material: Glacial Till

Ridge  
Landform

Front of Parcel  
Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body n/a feet  
Property Line 70 feet

4. Unsuitable Materials Present:  Yes  No  
If Yes:  Disturbed Soil  Fill Material  
 Weathered/Fractured Rock  Bedrock

5. Groundwater Observed:  Yes  No

If yes: 0/60 Depth Weeping from Pit

0/72 Depth Standing Water in Hole

### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume	Soil Structure	Consistence (Moist)	Soil Other
				Depth	Color				
0-12	A	S.L.	10YR4/4	N/A		N/A		N/A	Dth#10
12-21	B	S.L.	10YR4/6	N/A		N/A		N/A	
21-72	C	C.S.	2.5Y5/4	N/A		N/A	30		
									Dth#11
0-10	A	S.L.	10YR4/4	N/A					
10-20	B	S.L.	10YR4/6	N/A					
20-72	C	C.S.	2.5Y5/4	N/A			35		

Additional Notes:



## Commonwealth of Massachusetts City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (*minimum of two holes required at every proposed primary and reserve disposal area*)

## 2. Soil Parent Material:

3. Distances from:	Open Water Body	<u>n/a</u> feet	Drainage Way	<u>n/a</u> feet	Wetlands	<u>30</u> feet
4. Unsuitable	Property Line	<u>40</u> feet	Drinking Water Well	<u>n/a</u> feet	Other	<u>      </u> feet
Materials Present:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	If Yes: <input type="checkbox"/> Disturbed Soil <input type="checkbox"/> Fill Material <input type="checkbox"/> Weathered/Fractured Rock <input type="checkbox"/> Bedrock				
5. Groundwater Observed:	<input checked="" type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	If yes: _____ Depth Weeping from Pit	_____ Depth S		

### Additional Notes:



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### D. Determination of High Groundwater Elevation

1. Method Used:

Depth observed standing water in observation hole \_\_\_\_\_ inches **0/72** inches

Depth weeping from side of observation hole \_\_\_\_\_ inches **0/60** inches

Depth to soil redoximorphic features (mottles) \_\_\_\_\_ inches \_\_\_\_\_ inches

Depth to adjusted seasonal high groundwater ( $S_h$ ) \_\_\_\_\_ inches \_\_\_\_\_ inches (USGS methodology)

Index Well Number

Reading Date

$$S_h = S_c - [S_r \times (OW_c - OW_{max})/OW_r]$$

Obs. Hole/Well# \_\_\_\_\_  $S_c$  \_\_\_\_\_  $S_r$  \_\_\_\_\_  $OW_c$  \_\_\_\_\_  $OW_{max}$  \_\_\_\_\_  $OW_r$  \_\_\_\_\_  $S_h$  \_\_\_\_\_

2. Estimated Depth to High Groundwater: \_\_\_\_\_ inches

### E. Depth of Pervious Material

#### 1. Depth of Naturally Occurring Pervious Material

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

Yes  No

b. If yes, at what depth was it observed (exclude A and O Horizons)?

c. If no, at what depth was impervious material observed?

Upper boundary: 30 inches Lower boundary: 72+ inches  
Upper boundary:            inches Lower boundary:            inches



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

Peter Lavoie SE#1332

Typed or Printed Name of Soil Evaluator / License #

Mary Overholt

Name of Approving Authority Witness

8/3/23

Date

2025

Expiration Date of License

Upton Conservation Agent

Approving Authority

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

**Field Diagrams:** Use this area for field diagrams:





Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### A. Facility Information

Lobisser Building Corp  
Owner Name  
47 Main Street  
Street Address  
Upton  
City

Map/Lot #  
01568  
MA  
State  
Zip Code

### B. Site Information

1. (Check one)  New Construction  Upgrade  Repair
2. Soil Survey Available?  Yes  No If yes: \_\_\_\_\_
3. Surficial Geological Report Available?  Yes  No If yes: \_\_\_\_\_

Description of Geologic Map Unit: \_\_\_\_\_

4. Flood Rate Insurance Map Within a regulatory floodway?  Yes  No
5. Within a velocity zone?  Yes  No
6. Within a Mapped Wetland Area?  Yes  No If yes, MassGIS Wetland Data Layer: \_\_\_\_\_
7. Current Water Resource Conditions (USGS): August 2023 Month/Day/ Year Range:  Above Normal  Normal  Below Normal
8. Other references reviewed: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: 5&6-2023      8/3/23

Hole #      Date

Time

Clear 78

Weather

Latitude

Longitude:

4

Slope (%)

1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.) woodland

wooded

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

#### Description of Location:

2. Soil Parent Material: Glacial Till

Ridge

Landform

Front of Parcel

Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body n/a feet

Drainage Way n/a feet

Welllands

50 feet

4. Unsuitable Materials Present:  Yes  No      If Yes:  Disturbed Soil  Fill Material

Drinking Water Well n/a feet

Other

feet

5. Groundwater Observed:  Yes  No

If yes: 48/0 Depth Weeping from Pit

Depth Standing Water in Hole

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Soil Structure	Soil Consistency (Moist)	Coarse Fragments % by Volume	Other
				Depth	Color	Percent				
0-20	A	S.L.	10YR4/4	N/A			N/A			Dth#5
20-30	B	S.L.	10YR4/6	N/A			N/A			
30-60	C	L.S.	2.5Y5/4	30"	10YR5/8	25	25			
										Dth#6
0-10	A	S.L.	10YR4/4	N/A						
10-32	B	S.L.	10YR4/6	N/A						
32-52	C	L.S.	2.5Y5/4	N/A						

Additional Notes:



**Commonwealth of Massachusetts**  
**City/Town of Upton**

# Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

**C. On-Site Review** (*minimum of two holes required at every proposed primary and reserve disposal area*)

Deep Observation Hole Number: <u>7&amp;8</u>					
1. Land Use:	<u>Woodland</u> (e.g., woodland, agricultural field, vacant lot, etc.)	<u>2023</u>	<u>8/3/23</u>	<u>10</u>	<u>CLEAR 78</u>
		Date	Time	Weather	Latitude
				<u>Wooded</u>	<u>some</u>
					<u>Surface Stones (e.g., cobbles, stones, boulders, etc.)</u>

2000, *Journal of Economic*

## 2 Soil Parent Material: Glacial Till

3. Distances from:		Open Water Body	<u>n/a</u> feet	Drainage Way	<u>n/a</u> feet	Wetlands	<u>70</u> feet
		Property Line	<u>40</u> feet	Drinking Water Well	<u>n/a</u> feet	Other	_____ feet
4. Unsuitable Materials Present:		<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	If Yes:	<input type="checkbox"/> Disturbed Soil	<input type="checkbox"/> Fill Material	<input type="checkbox"/> Weathered/Fractured Rock	<input type="checkbox"/> Bedrock
5. Groundwater Observed:		<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	If yes: <u>52/46</u> Depth Weeping from Pit			
				<u>52/46</u> Depth Standing Water in Hole			

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)		Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
			Depth	Color	Percent	Gravel	Cobbles & Stones				
0-10	A	S.L.	10YR4/4	N/A							Dth#7
10-32	B	S.L.	10YR4/6	N/A							
32-60	C	L.S.	5Y7/2	41°	10YR5/8	25					
0-10	A	S.L.	10YR4/4	N/A							Dth#8
10-32	B	S.L.	10YR4/6	N/A							
32-70	C1	L.S.	5Y7/2	39	10YR5/8	25					

#### Additional Notes:



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### D. Determination of High Groundwater Elevation

- Method Used:
  - Depth observed standing water in observation hole 48/0 inches
  - Depth weeping from side of observation hole 48/0 inches
  - Depth to soil redoximorphic features (mottles) 30/0 inches
  - Depth to adjusted seasonal high groundwater ( $S_h$ ) \_\_\_\_\_ inches (USGS methodology)

Index Well Number

Reading Date

$$S_h = S_c - [S_r \times (OW_c - OW_{max})/OW_r]$$

Obs. Hole Well# \_\_\_\_\_  $S_c$  \_\_\_\_\_  $S_r$  \_\_\_\_\_  $OW_c$  \_\_\_\_\_  $OW_{max}$  \_\_\_\_\_  $OW_r$  \_\_\_\_\_  $S_h$  \_\_\_\_\_

- Estimated Depth to High Groundwater: \_\_\_\_\_ inches

### E. Depth of Pervious Material

#### 1. Depth of Naturally Occurring Pervious Material

- Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

Yes  No

- If yes, at what depth was it observed (exclude A and O Horizons)?

- If no, at what depth was impervious material observed?

Upper boundary: 30 \_\_\_\_\_ inches Lower boundary: 72+ \_\_\_\_\_ inches  
Upper boundary: \_\_\_\_\_ inches Lower boundary: \_\_\_\_\_ inches



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

*[Handwritten signature]*

Signature of Soil Evaluator  
**Peter Lavoie SE#1332**

Typed or Printed Name of Soil Evaluator / License #  
**Mary Overholt**

Name of Approving Authority Witness

8/3/23  
Date  
**2025**

Expiration Date of License  
Upton Conservation Agent  
Approving Authority

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

**Field Diagrams:** Use this area for field diagrams:





Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### A. Facility Information

Lobisser Building Corp

Owner Name  
47 Main Street  
Street Address  
Upton  
City

MA  
State

Map/Lot #  
01568  
Zip Code

### B. Site Information

1. (Check one)  New Construction  Upgrade  Repair
2. Soil Survey Available?  Yes  No  
If yes:  
Soil Name  
Glacial Till  
Soil Parent material  
Ridge  
Landform
3. Surficial Geological Report Available?  Yes  No  
If yes:  
Year Published/Source  
Map Unit

Description of Geologic Map Unit:

4. Flood Rate Insurance Map  Within a regulatory floodway?  Yes  No
5. Within a velocity zone?  Yes  No
6. Within a Mapped Wetland Area?  Yes  No  
If yes, MassGIS Wetland Data Layer:  
Wetland Type  
Range:  Above Normal  Normal  Below Normal
7. Current Water Resource Conditions (USGS):  
August 2023  
Month/Day/Year
8. Other references reviewed:



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number:	Hole #	8/3/23	Date	10 am	Time	Clear 78	Weather	Latitude	Longitude:
1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.)	Woodland		wooded			Some			4
Description of Location:									
2. Soil Parent Material:	Glaical Till								
3. Distances from:	Open Water Body	n/a	feet	Ridge	Landform	Front of Parcel	Position on Landscape (SU, SH, BS, FS, TS)	Wetlands	50 feet
	Property Line	70	feet	Drainage Way	n/a	Drinking Water Well	n/a	Other	feet
4. Unsuitable Materials Present:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		If Yes:	<input type="checkbox"/> Disturbed Soil <input type="checkbox"/> Fill Material		<input type="checkbox"/> Weathered/Fractured Rock		<input type="checkbox"/> Bedrock	
5. Groundwater Observed:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		If yes:	36"/28" Depth Weeping from Pit		Depth Standing Water in Hole			
Soil Log									
Depth (in)	Soil Horizon Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Soil Structure	Consistence (Moist)	Soil Slope (%)	Other
				Depth	Color				
0-10	A	S.L.	10YR4/4	N/A		N/A			Dth#1
10-28	B	S.L.	10YR4/6	N/A		N/A			
28-60	C	L.S.	2.5Y5/4	36"	10YR5/8	25	25		
									Dth#2
0-12	A	S.L.	10YR4/4	N/A					
12-28	B	S.L.	10YR4/6	28"	10YR5/8	25	N/A		
28-72	C	L.S.	2.5Y5/4	N/A					

Additional Notes:

---



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: <u>3&amp;4</u>			8/3/23	10	Time	Weather	Latitude	Longitude:																																																																																													
1. Land Use: <u>Woodland</u> (e.g., woodland, agricultural field, vacant lot, etc.)			2023	Date	Wooded	some																																																																																															
Description of Location:																																																																																																					
2. Soil Parent Material: <u>Glacial Till</u>			Ridge	Position on Landscape (SU, SH, BS, FS, TS)																																																																																																	
3. Distances from: Open Water Body <u>n/a</u> feet			Drainage Way <u>n/a</u> feet	Wetlands <u>70</u> feet																																																																																																	
Property Line <u>40</u> feet			Drinking Water Well <u>n/a</u> feet	Other _____ feet																																																																																																	
4. Unsuitable Materials Present: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			If Yes: <input type="checkbox"/> Disturbed Soil <input type="checkbox"/> Fill Material <input type="checkbox"/> Weathered/Fractured Rock	<input type="checkbox"/> Bedrock																																																																																																	
5. Groundwater Observed: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			If yes: <u>36"/48"</u> Depth Weeping from Pit	Depth Standing Water in Hole																																																																																																	
<table border="1"> <thead> <tr> <th rowspan="2">Depth (in)</th> <th rowspan="2">Soil Horizon Layer</th> <th rowspan="2">Soil Texture (USDA)</th> <th rowspan="2">Soil Matrix: Color-Moist (Munsell)</th> <th colspan="2">Redoximorphic Features</th> <th colspan="2">Coarse Fragments % by Volume</th> <th rowspan="2">Soil Structure</th> <th rowspan="2">Consistence (Moist)</th> <th rowspan="2">Soil Slope (%)</th> </tr> <tr> <th>Depth</th> <th>Color</th> <th>Percent</th> <th>Gravel</th> <th>Cobbles &amp; Stones</th> </tr> </thead> <tbody> <tr> <td>0-12</td> <td>A</td> <td>S.L.</td> <td>10YR4/4</td> <td>N/A</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td>Dth#3</td> </tr> <tr> <td>12-28</td> <td>B</td> <td>S.L.</td> <td>10YR4/6</td> <td>24"</td> <td>10YR5/8</td> <td>25</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>28-72</td> <td>C</td> <td>L.S.</td> <td>2.5Y5/4</td> <td>N/A</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td>Dth#4</td> </tr> <tr> <td>0-10</td> <td>A</td> <td>S.L.</td> <td>10YR4/4</td> <td>N/A</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>10-21</td> <td>B</td> <td>S.L.</td> <td>10YR4/6</td> <td>N/A</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>21-41</td> <td>C1</td> <td>L.S.</td> <td>5Y6/2</td> <td>28</td> <td>10YR5/8</td> <td>25</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>41-65</td> <td>C2</td> <td>M.S.</td> <td>2.5Y5/4</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>									Depth (in)	Soil Horizon Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Consistence (Moist)	Soil Slope (%)	Depth	Color	Percent	Gravel	Cobbles & Stones	0-12	A	S.L.	10YR4/4	N/A						Dth#3	12-28	B	S.L.	10YR4/6	24"	10YR5/8	25					28-72	C	L.S.	2.5Y5/4	N/A						Dth#4	0-10	A	S.L.	10YR4/4	N/A							10-21	B	S.L.	10YR4/6	N/A							21-41	C1	L.S.	5Y6/2	28	10YR5/8	25					41-65	C2	M.S.	2.5Y5/4							
Depth (in)	Soil Horizon Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure					Consistence (Moist)	Soil Slope (%)																																																																																							
				Depth	Color	Percent	Gravel		Cobbles & Stones																																																																																												
0-12	A	S.L.	10YR4/4	N/A						Dth#3																																																																																											
12-28	B	S.L.	10YR4/6	24"	10YR5/8	25																																																																																															
28-72	C	L.S.	2.5Y5/4	N/A						Dth#4																																																																																											
0-10	A	S.L.	10YR4/4	N/A																																																																																																	
10-21	B	S.L.	10YR4/6	N/A																																																																																																	
21-41	C1	L.S.	5Y6/2	28	10YR5/8	25																																																																																															
41-65	C2	M.S.	2.5Y5/4																																																																																																		
Additional Notes:																																																																																																					



Commonwealth of Massachusetts  
City/Town of Upton

**Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal**

**D. Determination of High Groundwater Elevation**

1. Method Used:

Depth observed standing water in observation hole \_\_\_\_\_ inches

Depth weeping from side of observation hole 36/28 inches 24/28 inches

Depth to soil redoximorphic features (mottles) 26/28 inches 24/28 inches

Depth to adjusted seasonal high groundwater ( $S_h$ ) \_\_\_\_\_ inches (USGS methodology)

Index Well Number

Reading Date

$$S_h = S_c - [S_r \times (OW_c - OW_{max})/OW_r]$$

Obs. Hole/Well# \_\_\_\_\_  $S_c$  \_\_\_\_\_  $S_r$  \_\_\_\_\_  $OW_c$  \_\_\_\_\_  $OW_{max}$  \_\_\_\_\_  $OW_r$  \_\_\_\_\_  $S_h$  \_\_\_\_\_

2. Estimated Depth to High Groundwater: \_\_\_\_\_ inches

**E. Depth of Pervious Material**

1. Depth of Naturally Occurring Pervious Material

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

Yes  No

b. If yes, at what depth was it observed (exclude A and O Horizons)?

c. If no, at what depth was impervious material observed?

Upper boundary: 24 \_\_\_\_\_ inches Lower boundary: 72+ \_\_\_\_\_ inches

Upper boundary: \_\_\_\_\_ inches Lower boundary: \_\_\_\_\_ inches



Commonwealth of Massachusetts  
City/Town of Upton

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator  
*Peter Lavoie*

Typed or Printed Name of Soil Evaluator / License #  
**Peter Lavoie SE#1332**

Name of Approving Authority Witness  
**May Overholts**

Date  
**8/3/23**

Expiration Date of License  
**2025**

Approving Authority  
**Upton Conservation Agent**

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

**Field Diagrams:** Use this area for field diagrams:



**Soil Map—Worcester County, Massachusetts, Southern Part  
(MAIN STREET - PROJECT)**



Soil Map—Worcester County, Massachusetts, Southern Part  
(MAIN STREET - PROJECT)

## MAP LEGEND

Area of Interest (AOI)	Area of Interest (AOI)
Soils	Soil Map Unit Polygons
	Soil Map Unit Lines
	Soil Map Unit Points
Special Point Features	
Blowout	Soil Area
Borrow Pit	Stony Spot
Clay Spot	Very Stony Spot
Closed Depression	Wet Spot
Gravel Pit	Other
Gravelly Spot	Special Line Features
Landfill	
Levee	Water Features
Marsh or swamp	Streams and Canals
Mine or Quarry	
Miscellaneous Water	Transportation
Perennial Water	Rails
Rock Outcrop	Interstate Highways
Saline Spot	US Routes
Sandy Spot	Major Roads
Severely Eroded Spot	Local Roads
Sinkhole	
Slide or Slip	Background
Sodic Spot	Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

**Warning:** Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Worcester County, Massachusetts, Southern Part  
Survey Area Date: Version 15, Sep 9, 2022

Soil map units are labeled (as space allows) for map scales 1:60,000 or larger.

Data(s) aerial images were photographed: May 22, 2022—Jun 5, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.



Natural Resources  
Conservation Service

Web Soil Survey  
National Cooperative Soil Survey

7/13/2023  
Page 2 of 3

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres In AOI	Percent of AOI
73A	Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony	3.9	7.1%
300B	Montauk fine sandy loam, 3 to 8 percent slopes	5.1	9.2%
300C	Montauk fine sandy loam, 8 to 15 percent slopes	3.2	5.8%
302B	Montauk fine sandy loam, 0 to 8 percent slopes, extremely stony	17.1	31.0%
315B	Scituate fine sandy loam, 3 to 8 percent slopes	12.1	22.1%
317B	Scituate fine sandy loam, 3 to 8 percent slopes, extremely stony	1.2	2.2%
420B	Canton fine sandy loam, 3 to 8 percent slopes	10.9	19.9%
420C	Canton fine sandy loam, 8 to 15 percent slopes	0.3	0.6%
422C	Canton fine sandy loam, 8 to 15 percent slopes, extremely stony	1.1	2.1%
<b>Totals for Area of Interest</b>		<b>55.0</b>	<b>100.0%</b>

## Worcester County, Massachusetts, Southern Part

### 302B—Montauk fine sandy loam, 0 to 8 percent slopes, extremely stony

#### Map Unit Setting

*National map unit symbol:* 2w80t  
*Elevation:* 30 to 1,120 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days  
*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Montauk, extremely stony, and similar soils:* 85 percent  
*Minor components:* 15 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Montauk, Extremely Stony

##### Setting

*Landform:* Ground moraines, drumlins, recessional moraines, hills  
*Landform position (two-dimensional):* Summit, shoulder, backslope  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex  
*Parent material:* Coarse-loamy over sandy lodgment till derived from gneiss, granite, and/or schist

##### Typical profile

*Oe - 0 to 2 inches:* moderately decomposed plant material  
*A - 2 to 6 inches:* fine sandy loam  
*Bw1 - 6 to 28 inches:* fine sandy loam  
*Bw2 - 28 to 36 inches:* sandy loam  
*2Cd - 36 to 74 inches:* gravelly loamy sand

##### Properties and qualities

*Slope:* 0 to 8 percent  
*Surface area covered with cobbles, stones or boulders:* 9.0 percent  
*Depth to restrictive feature:* 20 to 43 inches to densic material  
*Drainage class:* Well drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately high (0.00 to 1.42 in/hr)  
*Depth to water table:* About 18 to 37 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)  
*Available water supply, 0 to 60 inches:* Low (about 5.6 inches)

**Interpretive groups**

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 7s  
*Hydrologic Soil Group:* C  
*Ecological site:* F144AY007CT - Well Drained Dense Till Uplands  
*Hydric soil rating:* No

**Minor Components**

**Scituate, extremely stony**

*Percent of map unit:* 8 percent  
*Landform:* Ground moraines, hills, drumlins  
*Landform position (two-dimensional):* Summit, backslope, footslope  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Canton, extremely stony**

*Percent of map unit:* 5 percent  
*Landform:* Hills  
*Landform position (two-dimensional):* Summit, shoulder, backslope  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Ridgebury, extremely stony**

*Percent of map unit:* 2 percent  
*Landform:* Depressions, ground moraines, hills, drainageways  
*Landform position (two-dimensional):* Footslope, toeslope  
*Landform position (three-dimensional):* Head slope, base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

## Data Source Information

Soil Survey Area: Worcester County, Massachusetts, Southern Part  
Survey Area Data: Version 15, Sep 9, 2022



## Worcester County, Massachusetts, Southern Part

### 315B—Scituate fine sandy loam, 3 to 8 percent slopes

#### Map Unit Setting

*National map unit symbol: 9bc9  
Elevation: 200 to 950 feet  
Mean annual precipitation: 32 to 50 inches  
Mean annual air temperature: 45 to 50 degrees F  
Frost-free period: 145 to 240 days  
Farmland classification: All areas are prime farmland*

#### Map Unit Composition

*Scituate and similar soils: 80 percent  
Minor components: 20 percent  
Estimates are based on observations, descriptions, and transects of  
the mapunit.*

#### Description of Scituate

##### Setting

*Landform: Hills  
Landform position (two-dimensional): Footslope  
Landform position (three-dimensional): Base slope  
Down-slope shape: Linear  
Across-slope shape: Concave  
Parent material: Friable coarse-loamy eolian deposits over dense  
sandy lodgment till derived from granite and gneiss*

##### Typical profile

*H1 - 0 to 4 inches: sandy loam  
H2 - 4 to 16 inches: gravelly sandy loam  
H3 - 16 to 30 inches: loamy sand  
H4 - 30 to 65 inches: gravelly loamy sand*

##### Properties and qualities

*Slope: 3 to 8 percent  
Depth to restrictive feature: 20 to 30 inches to dense material  
Drainage class: Moderately well drained  
Runoff class: High  
Capacity of the most limiting layer to transmit water  
(Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)  
Depth to water table: About 17 to 36 inches  
Frequency of flooding: None  
Frequency of ponding: None  
Available water supply, 0 to 60 inches: Very low (about 2.7 inches)*

##### Interpretive groups

*Land capability classification (irrigated): None specified  
Land capability classification (nonirrigated): 2w  
Hydrologic Soil Group: C  
Ecological site: F144AY037MA - Moist Dense Till Uplands*



*Hydric soil rating:* No

**Minor Components**

**Montauk**

*Percent of map unit:* 15 percent

*Hydric soil rating:* No

**Ridgebury**

*Percent of map unit:* 5 percent

*Landform:* Depressions

*Hydric soil rating:* Yes

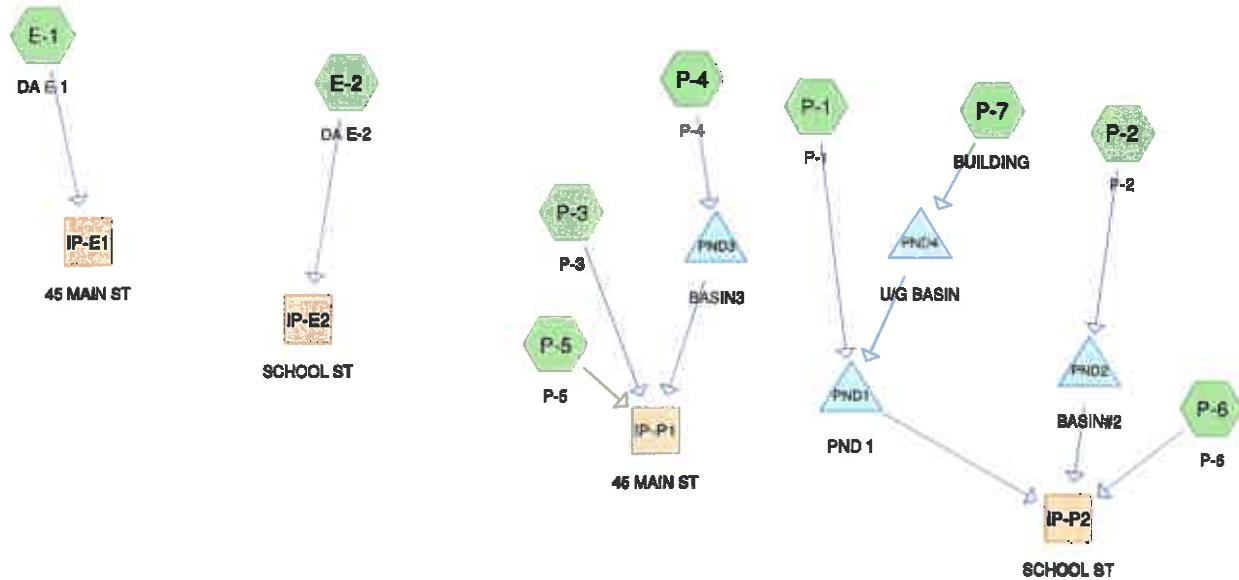
## **Data Source Information**

**Soil Survey Area:** Worcester County, Massachusetts, Southern Part

**Survey Area Data:** Version 15, Sep 9, 2022



## **Hydrocad Files**



**Routing Diagram for PRE-POST DEVELOPMENT**  
 Prepared by D&L Design Group Inc, Printed 8/29/2023  
 HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Printed 8/29/2023

Page 2

**Rainfall Events Listing**

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2YR	Type III 24-hr		Default	24.00	1	3.39	2
2	10YR	Type III 24-hr		Default	24.00	1	5.11	2
3	25YR	Type III 24-hr		Default	24.00	1	6.19	2
4	100YR	Type III 24-hr		Default	24.00	1	7.85	2

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Printed 8/29/2023

Page 3

**Area Listing (all nodes)**

Area (acres)	CN	Description (subcatchment-numbers)
3.874	74	>75% Grass cover, Good, HSG C (E-1, E-2, P-1, P-2, P-3, P-4, P-6)
1.860	98	Paved parking, HSG C (E-1, E-2, P-1, P-2, P-3, P-4)
0.514	98	Roofs, HSG C (P-7)
13.796	70	Woods, Good, HSG C (E-1, E-2, P-1, P-2, P-4, P-5, P-6)
<b>20.044</b>	<b>74</b>	<b>TOTAL AREA</b>

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Printed 8/29/2023

Page 4

**Soil Listing (all nodes)**

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
20.044	HSG C	E-1, E-2, P-1, P-2, P-3, P-4, P-5, P-6, P-7
0.000	HSG D	
0.000	Other	
<b>20.044</b>		<b>TOTAL AREA</b>

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Printed 8/29/2023

Page 5

**Ground Covers (all nodes)**

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	3.874	0.000	0.000	3.874	>75% Grass cover, Good	E-1, E-2, P-1, P-2, P-3, P-4, P-6
0.000	0.000	1.860	0.000	0.000	1.860	Paved parking	E-1, E-2, P-1, P-2, P-3, P-4
0.000	0.000	0.514	0.000	0.000	0.514	Roofs	P-7
0.000	0.000	13.796	0.000	0.000	13.796	Woods, Good	E-1, E-2, P-1, P-2, P-4, P-5, P-6
0.000	0.000	20.044	0.000	0.000	20.044	<b>TOTAL AREA</b>	

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Printed 8/29/2023

Page 6

**Pipe Listing (all nodes)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Width (inches)	Diam/Height (inches)	Inside-Fill (inches)	Node Name
1	P-1	0.00	0.00	288.0	0.0250	0.010	0.0	18.0	0.0	P-1
2	P-4	0.00	0.00	250.0	0.0250	0.010	0.0	15.0	0.0	P-4

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 7

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

**Subcatchment E-1: DA E-1**Runoff Area=197,469 sf 3.58% Impervious Runoff Depth>0.95"  
Flow Length=560' Slope=0.0450 '/' Tc=7.1 min CN=72 Runoff=4.97 cfs 0.361 af**Subcatchment E-2: DA E-2**Runoff Area=197,469 sf 2.56% Impervious Runoff Depth>0.90"  
Flow Length=470' Tc=9.3 min CN=71 Runoff=4.30 cfs 0.341 af**Subcatchment P-1: P-1**Runoff Area=81,268 sf 39.90% Impervious Runoff Depth>1.57"  
Flow Length=618' Tc=7.1 min CN=82 Runoff=3.51 cfs 0.244 af**Subcatchment P-2: P-2**Runoff Area=82,391 sf 33.69% Impervious Runoff Depth>1.50"  
Flow Length=330' Tc=7.1 min CN=81 Runoff=3.40 cfs 0.237 af**Subcatchment P-3: P-3**Runoff Area=8,272 sf 54.38% Impervious Runoff Depth>1.95"  
Tc=6.0 min CN=87 Runoff=0.45 cfs 0.031 af**Subcatchment P-4: P-4**Runoff Area=56,906 sf 7.39% Impervious Runoff Depth>1.07"  
Flow Length=505' Tc=5.5 min CN=74 Runoff=1.70 cfs 0.116 af**Subcatchment P-5: P-5**Runoff Area=145,259 sf 0.00% Impervious Runoff Depth>0.85"  
Tc=10.0 min CN=70 Runoff=2.89 cfs 0.236 af**Subcatchment P-6: P-6**Runoff Area=81,891 sf 0.00% Impervious Runoff Depth>0.90"  
Flow Length=428' Slope=0.0450 '/' Tc=8.1 min CN=71 Runoff=1.83 cfs 0.141 af**Subcatchment P-7: BUILDING**Runoff Area=22,400 sf 100.00% Impervious Runoff Depth>2.95"  
Tc=6.0 min CN=98 Runoff=1.65 cfs 0.126 af**Reach IP-E1: 45 MAIN ST**Inflow=4.97 cfs 0.361 af  
Outflow=4.97 cfs 0.361 af**Reach IP-E2: SCHOOL ST**Inflow=4.30 cfs 0.341 af  
Outflow=4.30 cfs 0.341 af

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 8

**Reach IP-P1: 45 MAIN ST**Inflow=3.26 cfs 0.309 af  
Outflow=3.26 cfs 0.309 af**Reach IP-P2: SCHOOL ST**Inflow=1.83 cfs 0.151 af  
Outflow=1.83 cfs 0.151 af**Pond PND1: PND 1**Peak Elev=323.27' Storage=6,513 cf Inflow=3.51 cfs 0.244 af  
Discarded=0.17 cfs 0.119 af Primary=0.00 cfs 0.000 af Outflow=0.17 cfs 0.119 af**Pond PND2: BASIN#2**Peak Elev=324.63' Storage=5,943 cf Inflow=3.40 cfs 0.237 af  
Discarded=0.16 cfs 0.114 af Primary=0.06 cfs 0.010 af Outflow=0.21 cfs 0.125 af**Pond PND3: BASIN3**Peak Elev=332.82' Storage=1,987 cf Inflow=1.70 cfs 0.116 af  
Discarded=0.08 cfs 0.051 af Primary=0.27 cfs 0.042 af Outflow=0.35 cfs 0.093 af**Pond PND4: U/G BASIN**Peak Elev=324.55' Storage=1,896 cf Inflow=1.65 cfs 0.126 af  
Discarded=0.20 cfs 0.126 af Primary=0.00 cfs 0.000 af Outflow=0.20 cfs 0.126 af**Total Runoff Area = 20.044 ac Runoff Volume = 1,833 af Average Runoff Depth = 1.10"**  
**88.16% Pervious = 17.670 ac 11.84% Impervious = 2.374 ac**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

Printed 8/29/2023

Page 9

**Summary for Subcatchment E-1: DA E-1**

Runoff = 4.97 cfs @ 12.11 hrs, Volume= 0.361 af, Depth> 0.95"  
 Routed to Reach IP-E1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
7,074	98	Paved parking, HSG C
35,876	74	>75% Grass cover, Good, HSG C
154,519	70	Woods, Good, HSG C
197,469	72	Weighted Average
190,395		96.42% Pervious Area
7,074		3.58% Impervious Area
Tc (min)	Length (feet)	Slope (ft/ft)
0.2	40	0.0450
0.5	110	0.0450
6.4	410	0.0450
7.1	560	Total
Velocity (ft/sec)	Capacity (cfs)	Description
3.42		Shallow Concentrated Flow, TRAVEL PATH A TO B Unpaved Kv= 16.1 fps
3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps

**PRE-POST DEVELOPMENT**

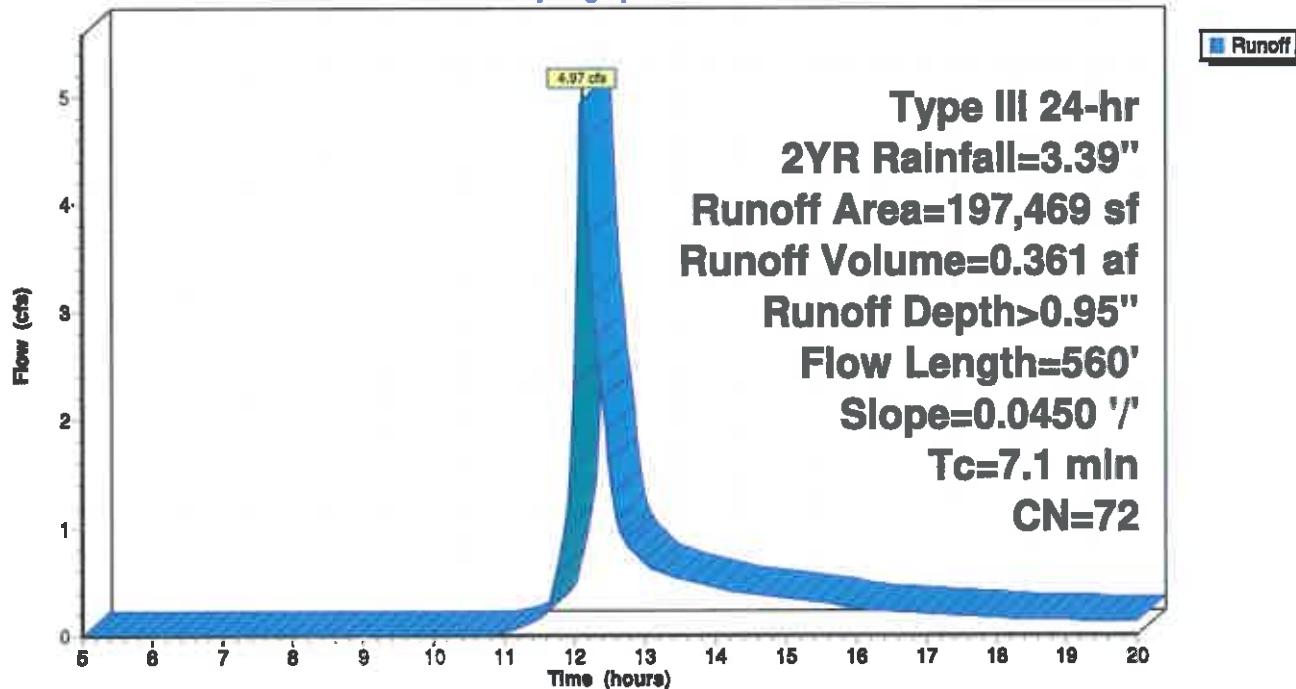
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 10

**Subcatchment E-1: DA E-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 11

**Summary for Subcatchment E-2: DA E-2**

Runoff = 4.30 cfs @ 12.15 hrs, Volume= 0.341 af, Depth> 0.90"  
 Routed to Reach IP-E2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description		
5,057	98	Paved parking, HSG C		
30,786	74	>75% Grass cover, Good, HSG C		
161,626	70	Woods, Good, HSG C		
197,469	71	Weighted Average		
192,412		97.44% Pervious Area		
5,057		2.56% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
3.4	40	0.0450	0.20	<b>Sheet Flow, TRAVEL PATH A TO B</b> Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42	<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
2.9	225	0.0650	1.27	<b>Shallow Concentrated Flow, TRAVEL PATH C TO D</b> Woodland Kv= 5.0 fps
2.6	125	0.0250	0.79	<b>Shallow Concentrated Flow, TRAVEL PATH D TO E</b> Woodland Kv= 5.0 fps
9.3	470	Total		

**PRE-POST DEVELOPMENT**

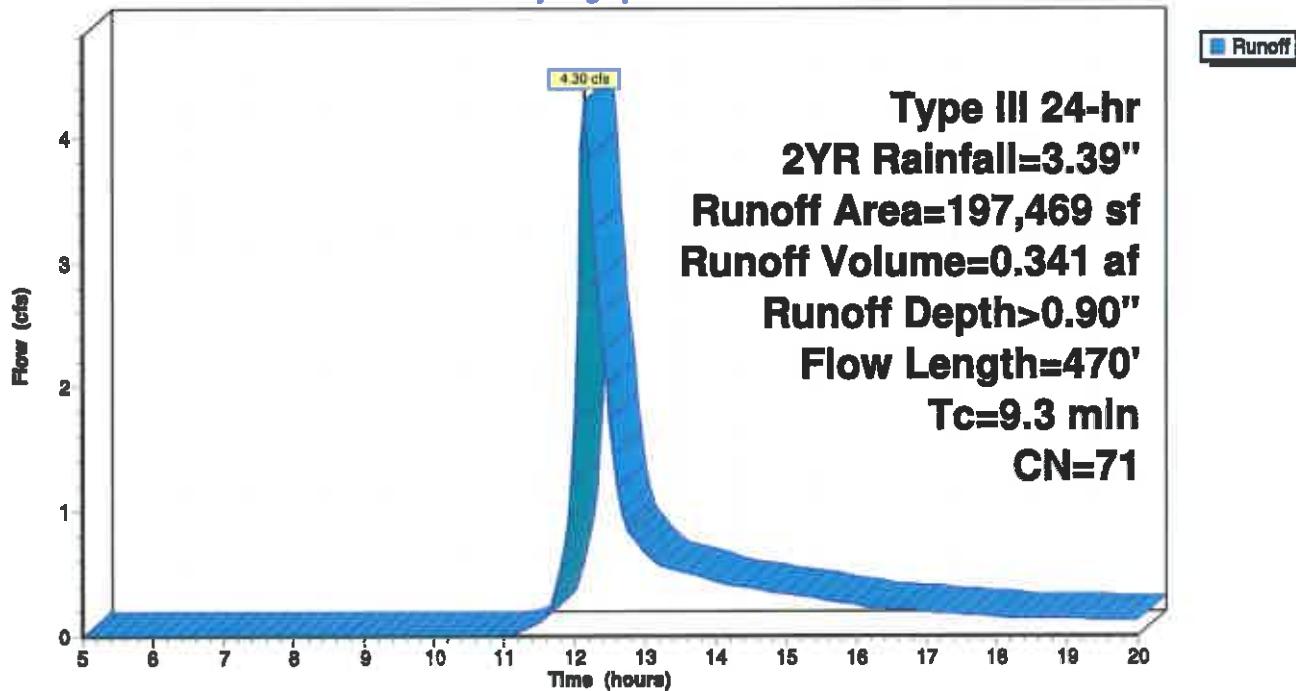
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-Sc a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 12

**Subcatchment E-2: DA E-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

Printed 8/29/2023

Page 13

**Summary for Subcatchment P-1: P-1**

Runoff = 3.51 cfs @ 12.11 hrs, Volume= 0.244 af, Depth> 1.57"  
 Routed to Pond PND1 : PND 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description			
32,428	98	Paved parking, HSG C			
26,882	74	>75% Grass cover, Good, HSG C			
21,958	70	Woods, Good, HSG C			
81,268	82	Weighted Average			
48,840		60.10% Pervious Area			
32,428		39.90% Impervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.6	100	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
0.6	100	0.0200	2.87		Shallow Concentrated Flow, TRAVEL PATH D TO E Paved Kv= 20.3 fps
0.4	288	0.0250	12.22	21.59	Pipe Channel, TRAVEL PATH E TO F 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.010
7.1	618	Total			

**PRE-POST DEVELOPMENT**

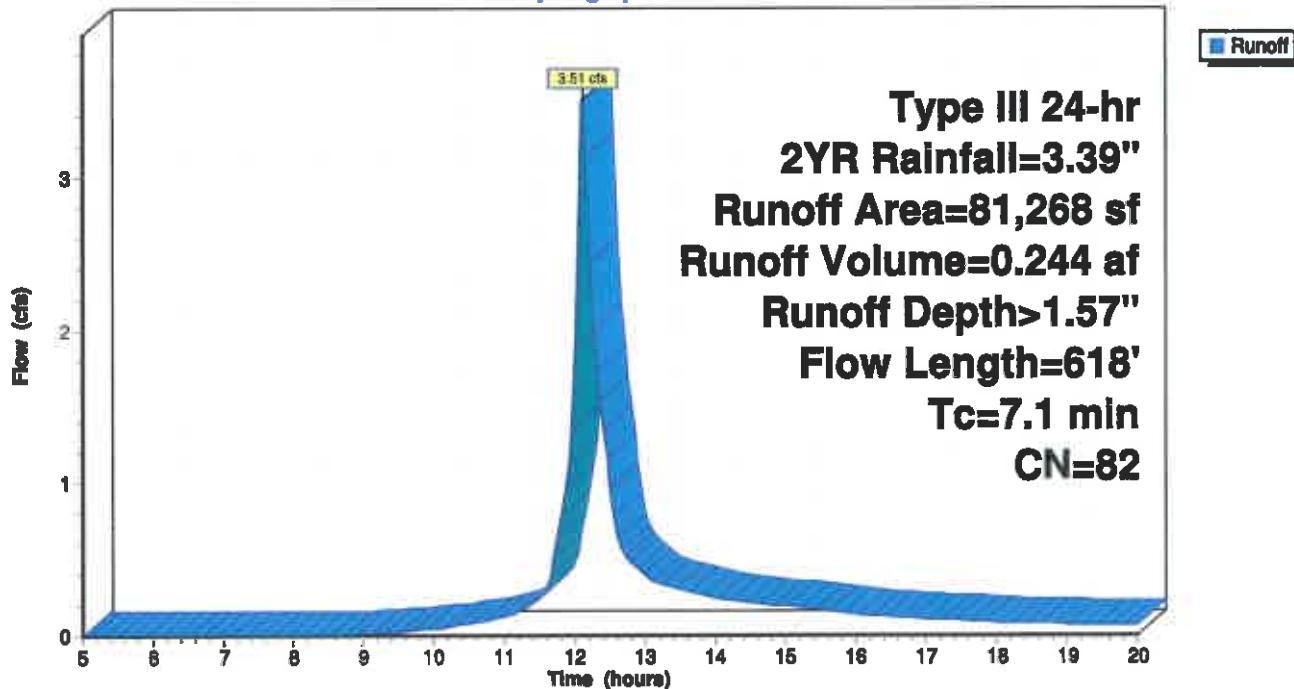
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 2YR Rainfall=3.39"*

Printed 8/29/2023

Page 14

**Subcatchment P-1: P-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

Printed 8/29/2023

Page 15

**Summary for Subcatchment P-2: P-2**

Runoff = 3.40 cfs @ 12.11 hrs, Volume= 0.237 af, Depth> 1.50"  
 Routed to Pond PND2 : BASIN#2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
27,755	98	Paved parking, HSG C
34,256	74	>75% Grass cover, Good, HSG C
20,380	70	Woods, Good, HSG C
82,391	81	Weighted Average
54,636		66.31% Pervious Area
27,755		33.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.5	50	0.0450	0.19		Sheet Flow, TRAVEL PATH A TO B Cultivated: Residue>20% n= 0.170 P2= 3.20"
0.7	135	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.9	145	0.0650	1.27		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
7.1	330	Total			

**PRE-POST DEVELOPMENT**

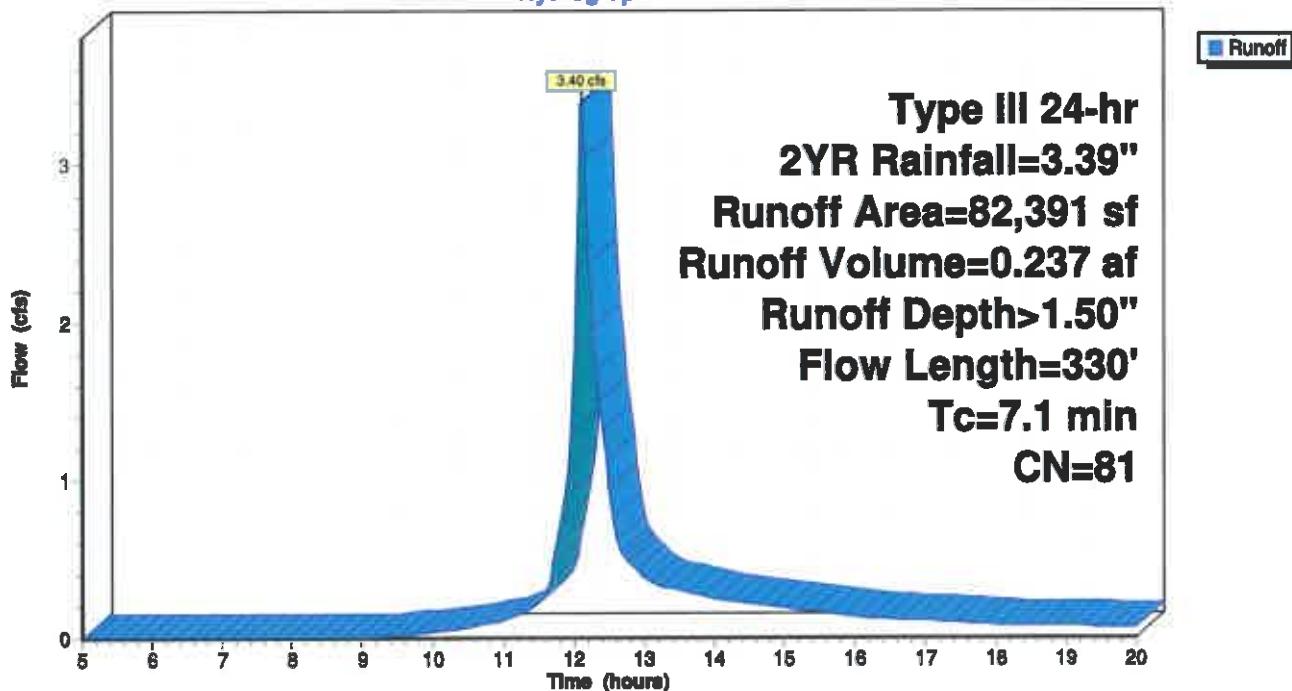
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 16

**Subcatchment P-2: P-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 17

**Summary for Subcatchment P-3: P-3**

Runoff = 0.45 cfs @ 12.09 hrs, Volume= 0.031 af, Depth> 1.95"  
 Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
4,498	98	Paved parking, HSG C
3,774	74	>75% Grass cover, Good, HSG C
8,272	87	Weighted Average
3,774		45.62% Pervious Area
4,498		54.38% Impervious Area

Tc (min)	Length (feet)	Slope ft/ft)	Velocity ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TRAVEL PATH

**PRE-POST DEVELOPMENT**

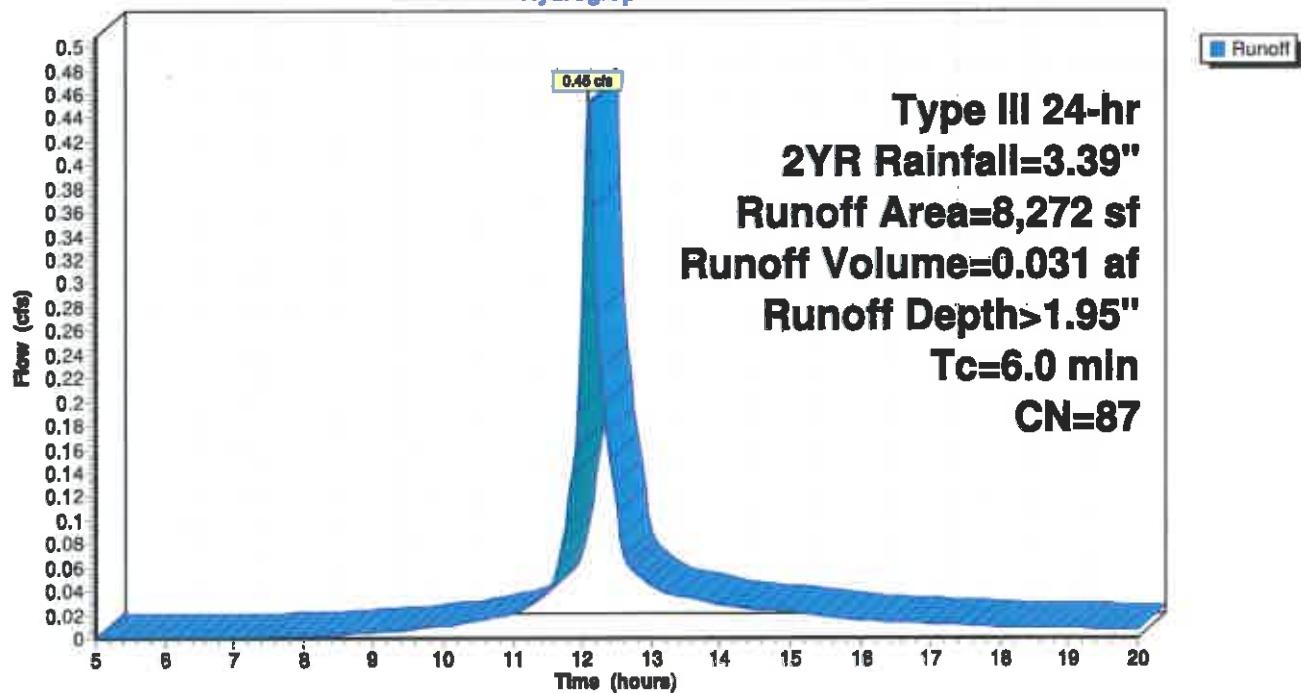
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 18

**Subcatchment P-3: P-3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 19

**Summary for Subcatchment P-4: P-4**

Runoff = 1.70 cfs @ 12.09 hrs, Volume= 0.116 af, Depth> 1.07"  
 Routed to Pond PND3 : BASIN3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description			
4,207	98	Paved parking, HSG C			
22,144	74	>75% Grass cover, Good, HSG C			
30,555	70	Woods, Good, HSG C			
56,906	74	Weighted Average			
52,699		92.61% Pervious Area			
4,207		7.39% Impervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
0.5	100	0.4500	3.35		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
0.1	25	0.0250	3.21		Shallow Concentrated Flow, TRAVEL PATH D TO E Paved Kv= 20.3 fps
0.4	250	0.0250	10.82	13.28	Pipe Channel, TRAVEL PATH E TO F 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.010
5.5	505	Total			

**PRE-POST DEVELOPMENT**

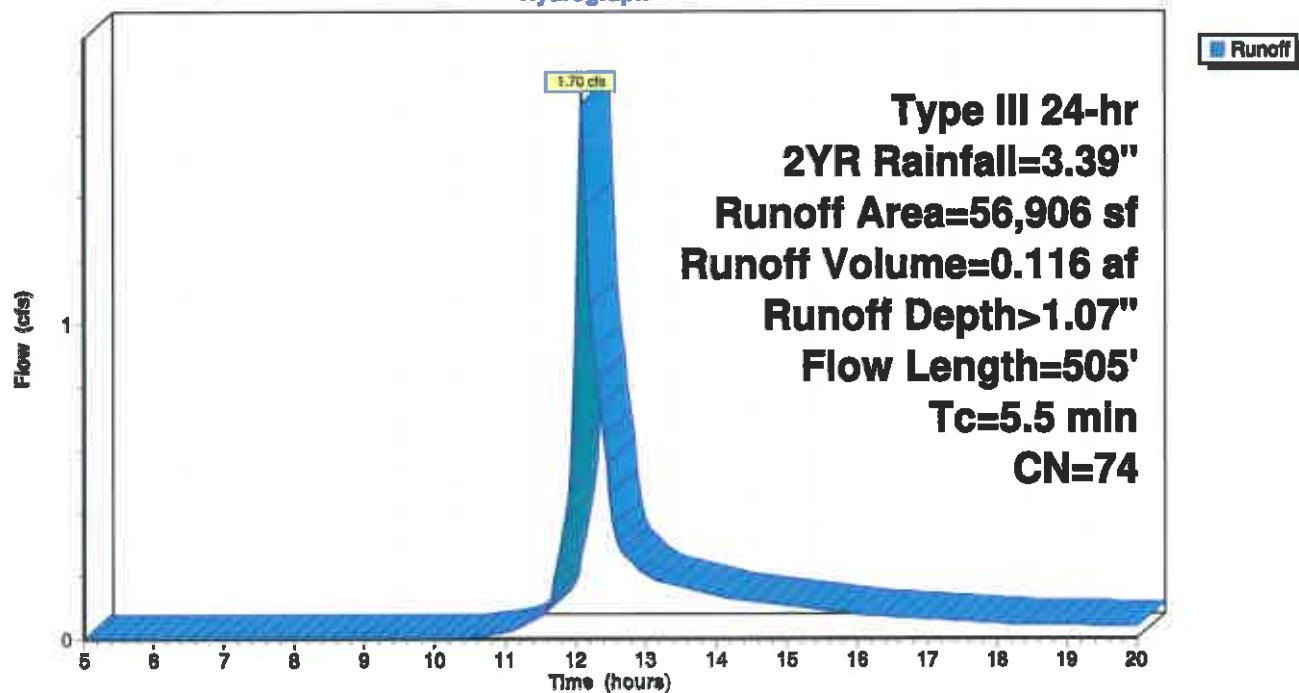
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 20

**Subcatchment P-4: P-4****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 21

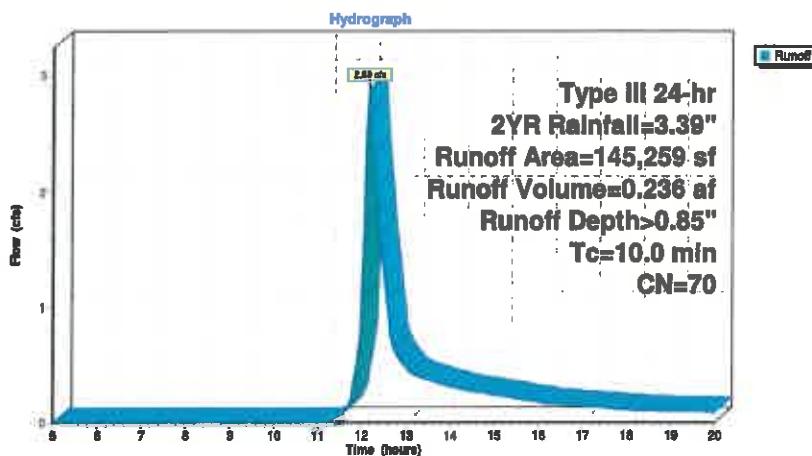
**Summary for Subcatchment P-5: P-5**

Runoff = 2.89 cfs @ 12.16 hrs, Volume= 0.236 af, Depth> 0.85"  
Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
145,259	70	Woods, Good, HSG C
145,259		100.00% Pervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
10.0					Direct Entry, TRAVEL PATH

**Subcatchment P-5: P-5**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 22

**Summary for Subcatchment P-6: P-6**

Runoff = 1.83 cfs @ 12.13 hrs, Volume= 0.141 af, Depth> 0.90"  
 Routed to Reach IP-P2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
15,023	74	>75% Grass cover, Good, HSG C
66,668	70	Woods, Good, HSG C
81,691	71	Weighted Average
81,691		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.9	184	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
3.1	195	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
8.1	429	Total			

**PRE-POST DEVELOPMENT**

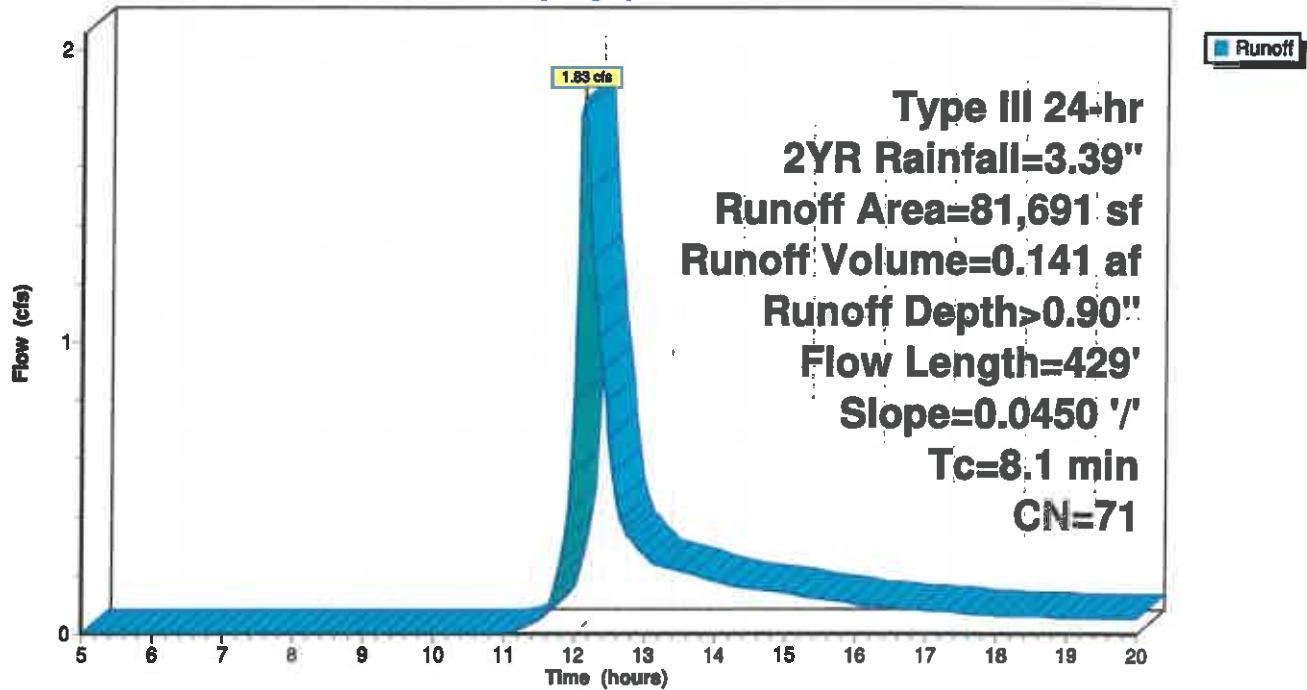
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 23

**Subcatchment P-6: P-6****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 24

**Summary for Subcatchment P-7: BUILDING**

Runoff = 1.65 cfs @ 12.09 hrs, Volume= 0.126 af, Depth> 2.95"  
Routed to Pond PND4 : U/G BASIN

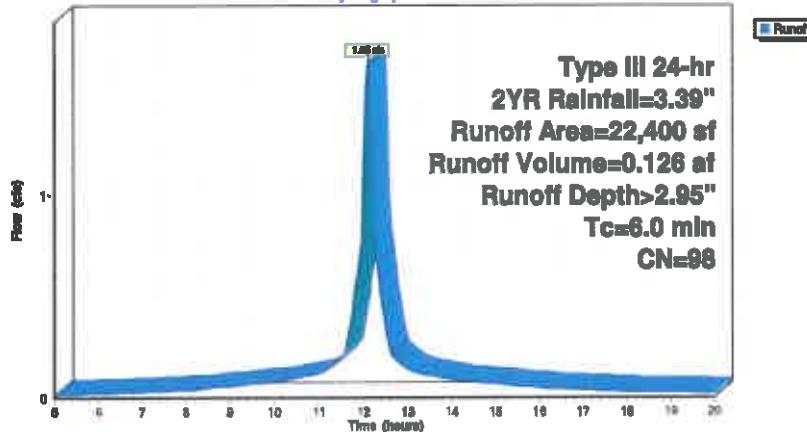
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2YR Rainfall=3.39"

Area (sf)	CN	Description
22,400	98	Roofs, HSG C
22,400		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TRAVEL PATH

**Subcatchment P-7: BUILDING**

Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

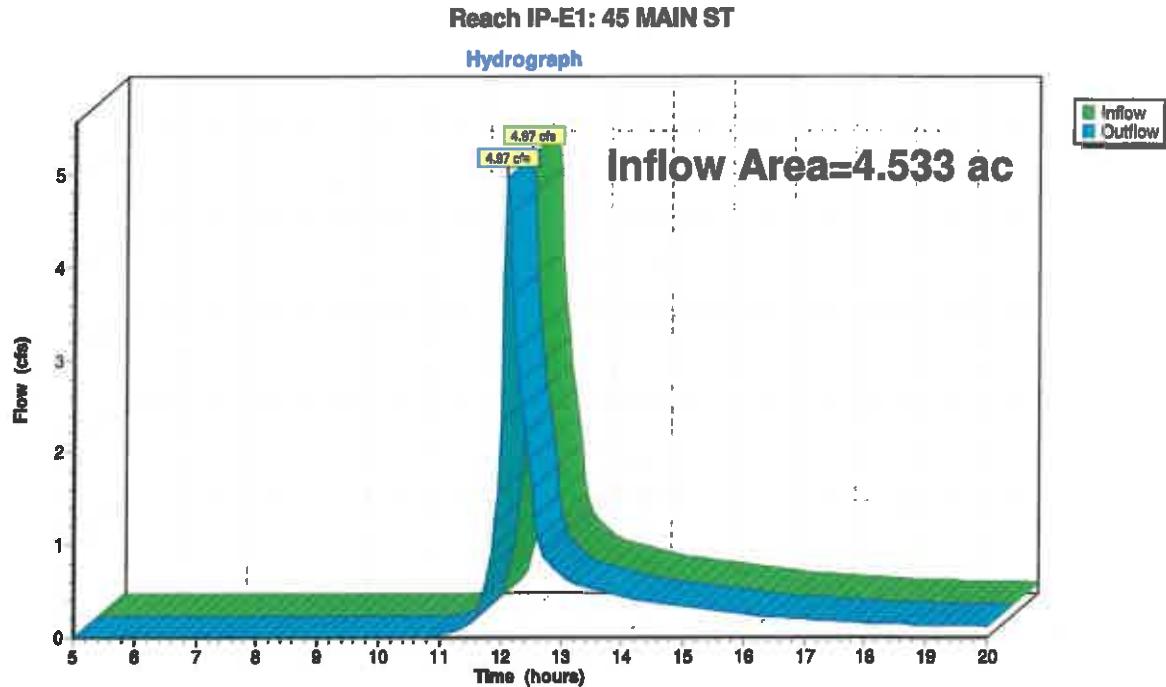
Printed 8/29/2023

Page 25

**Summary for Reach IP-E1: 45 MAIN ST**

Inflow Area = 4.533 ac, 3.58% Impervious, Inflow Depth > 0.95" for 2YR event  
Inflow = 4.97 cfs @ 12.11 hrs, Volume= 0.361 af  
Outflow = 4.97 cfs @ 12.11 hrs, Volume= 0.361 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

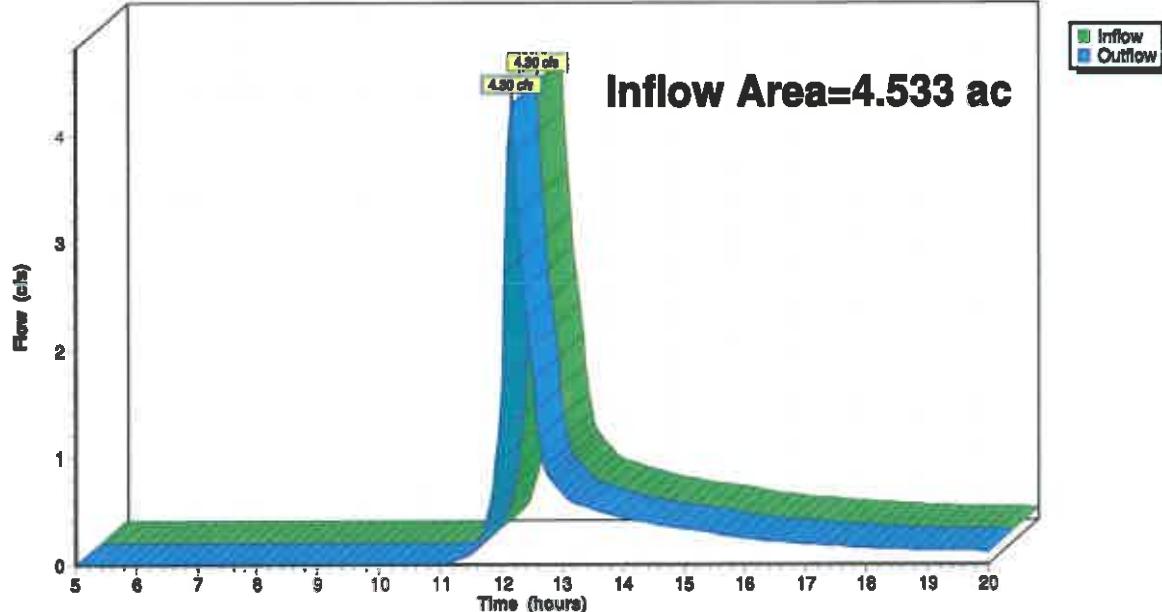
Printed 8/29/2023

Page 26

**Summary for Reach IP-E2: SCHOOL ST**

Inflow Area = 4.533 ac, 2.56% Impervious, Inflow Depth > 0.90" for 2YR event  
Inflow = 4.30 cfs @ 12.15 hrs, Volume= 0.341 af  
Outflow = 4.30 cfs @ 12.15 hrs, Volume= 0.341 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

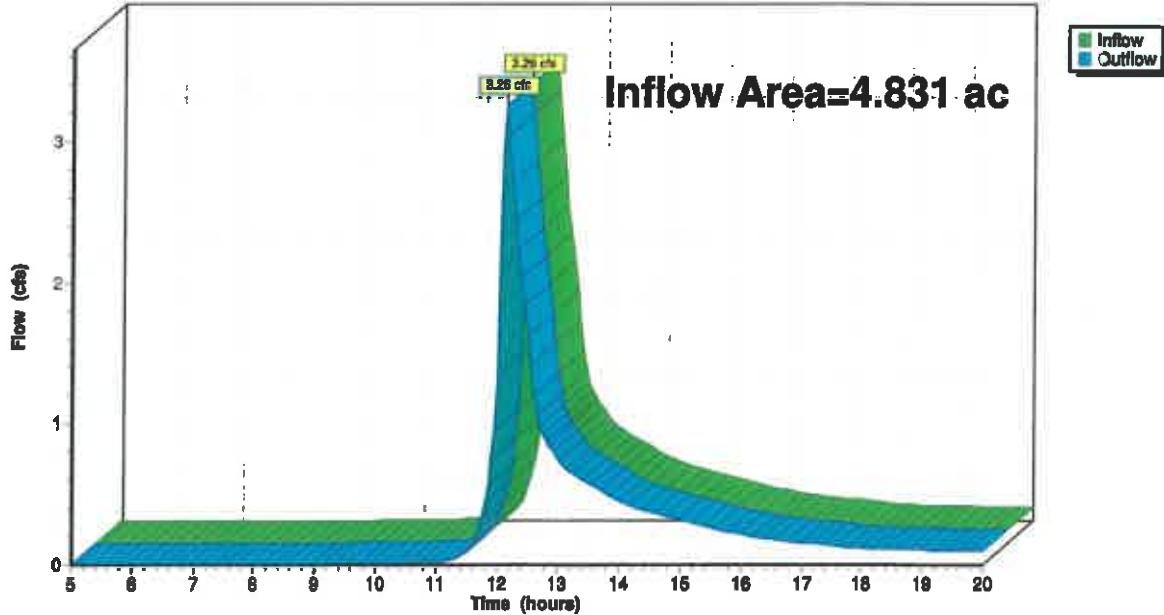
Printed 8/29/2023

Page 27

**Summary for Reach IP-P1: 45 MAIN ST**

Inflow Area = 4.831 ac, 4.14% Impervious, Inflow Depth > 0.77" for 2YR event  
Inflow = 3.26 cfs @ 12.15 hrs, Volume= 0.308 af  
Outflow = 3.26 cfs @ 12.15 hrs, Volume= 0.309 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 2YR Rainfall=3.39"*

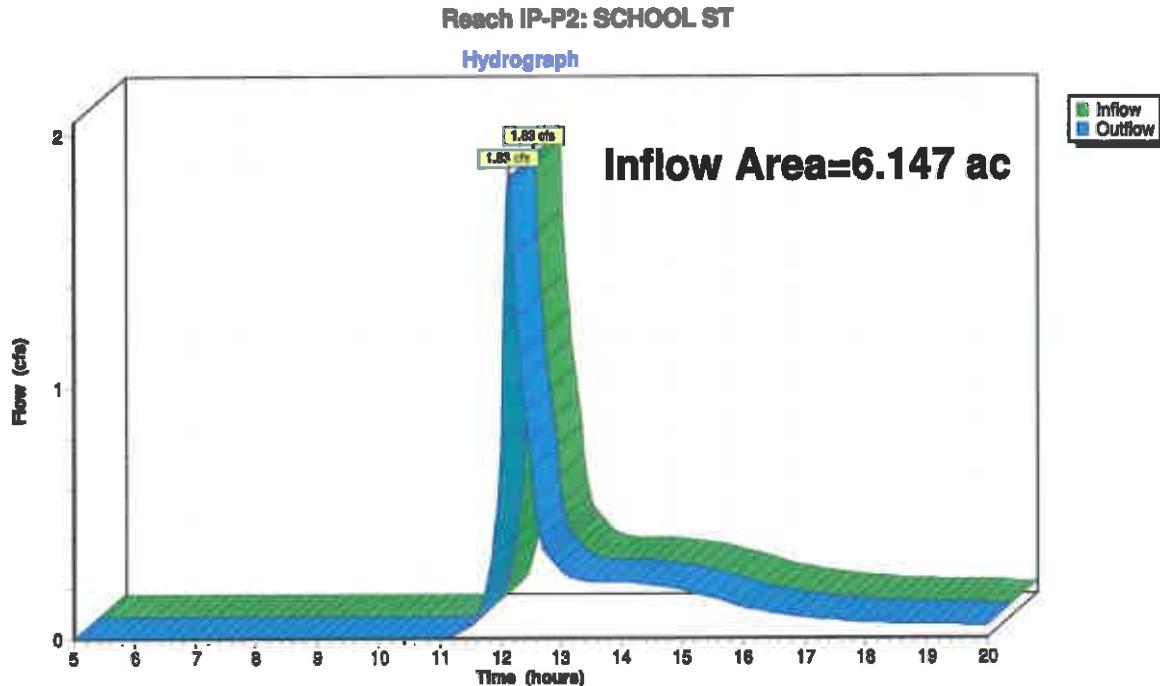
Printed 8/29/2023

Page 28

**Summary for Reach IP-P2: SCHOOL ST**

Inflow Area = 6.147 ac, 30.84% Impervious, Inflow Depth > 0.30" for 2YR event  
Inflow = 1.83 cfs @ 12.13 hrs, Volume= 0.151 af  
Outflow = 1.83 cfs @ 12.13 hrs, Volume= 0.151 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 2

**Summary for Pond PND1: PND 1**

Inflow Area = 2.380 ac, 52.89% Impervious, Inflow Depth > 1.23" for 2YR event  
 Inflow = 3.51 cfs @ 12.11 hrs, Volume= 0.244 af  
 Outflow = 0.17 cfs @ 15.40 hrs, Volume= 0.119 af, Atten= 95%, Lag= 197.7 min  
 Discarded = 0.17 cfs @ 15.40 hrs, Volume= 0.119 af  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 323.27' @ 15.40 hrs Surf.Area= 3,060 sf Storage= 6,513 cf

Plug-Flow detention time= 219.1 min calculated for 0.119 af (49% of inflow)  
 Center-of-Mass det. time= 135.8 min ( 933.1 - 797.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	320.00'	25,250 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
320.00	1,100	0	0
322.00	2,125	3,225	3,225
324.00	3,600	5,725	8,950
326.00	6,100	9,700	18,650
327.00	7,100	6,600	25,250

Device	Routing	Invert	Outlet Devices
--------	---------	--------	----------------

#1	Discarded	320.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	325.00'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

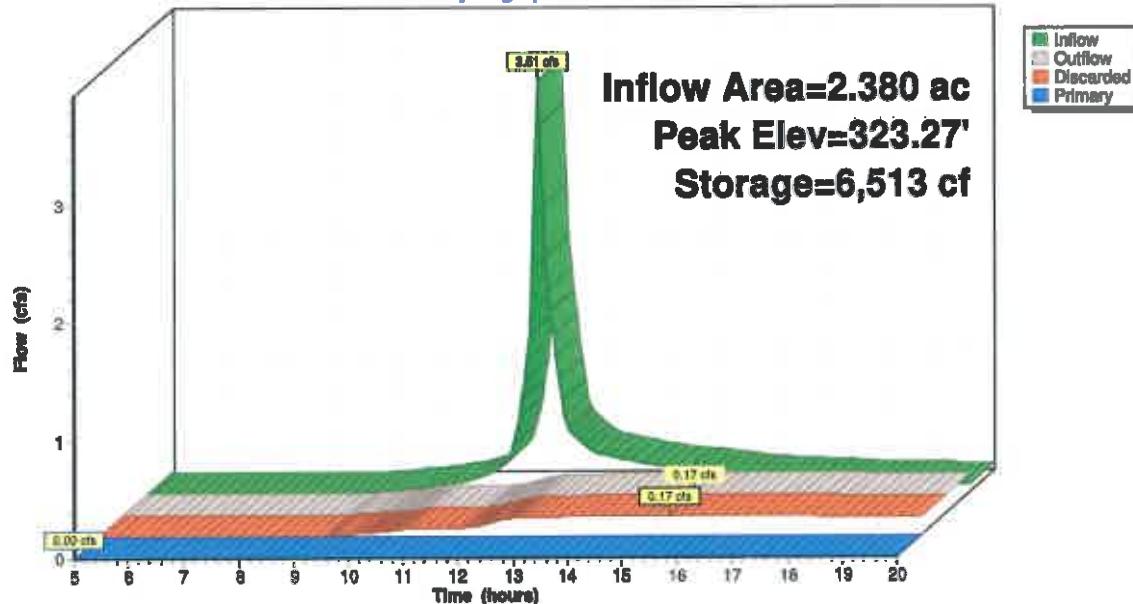
*Type III 24-hr 2YR Rainfall=3.39"*

Printed 8/29/2023

Page 30

**Discarded OutFlow** Max=0.17 cfs @ 15.40 hrs HW=323.27' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.17 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=320.00' (Free Discharge)  
2=Orifice/Grate (Controls 0.00 cfs)  
3=Orifice/Grate (Controls 0.00 cfs)  
4=Orifice/Grate (Controls 0.00 cfs)

**Pond PND1: PND 1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2YR Rainfall=3.39"

Printed 8/29/2023

Page 31

**Summary for Pond PND2: BASIN#2**

Inflow Area = 1.891 ac, 33.69% Impervious, Inflow Depth > 1.50" for 2YR event  
 Inflow = 3.40 cfs @ 12.11 hrs, Volume= 0.237 af  
 Outflow = 0.21 cfs @ 14.54 hrs, Volume= 0.125 af, Atten= 94%, Lag= 145.9 min  
 Discarded = 0.16 cfs @ 14.54 hrs, Volume= 0.114 af  
 Primary = 0.06 cfs @ 14.54 hrs, Volume= 0.010 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 324.63' @ 14.54 hrs Surf.Area= 2,800 sf Storage= 5,943 cf

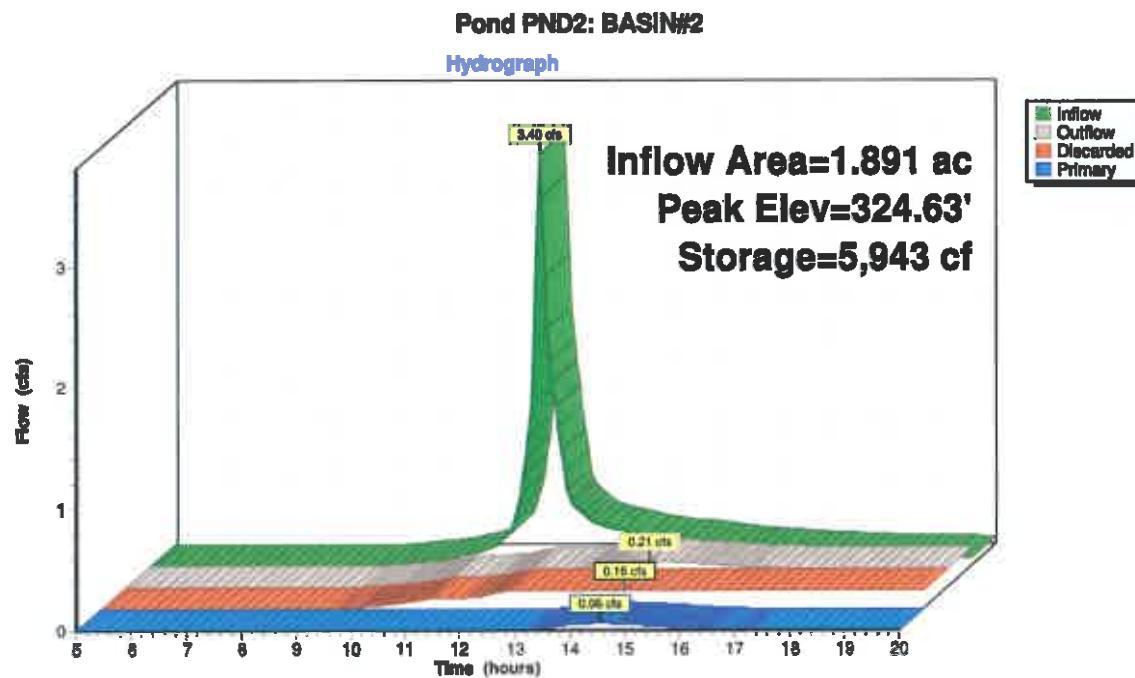
Plug-Flow detention time= 207.0 min calculated for 0.125 af (53% of inflow)  
 Center-of-Mass det. time= 124.7 min ( 924.5 - 799.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	322.00'	13,609 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
322.00	1,600	0	0
324.00	2,638	4,238	4,238
326.00	3,155	5,793	10,031
327.00	4,000	3,578	13,609

Device	Routing	Invert	Outlet Devices
#1	Discarded	322.00'	2.400 in/hr Exfiltration over Surface area
#2	Primary	324.50'	8.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	325.70'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	326.50'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**Discarded OutFlow** Max=0.16 cfs @ 14.54 hrs HW=324.63' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.16 cfs)

**Primary OutFlow** Max=0.06 cfs @ 14.54 hrs HW=324.63' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.06 cfs @ 1.21 fps)  
3=Orifice/Grate (Controls 0.00 cfs)  
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 33

**Summary for Pond PND3: BASIN3**

Inflow Area = 1.306 ac, 7.39% Impervious, Inflow Depth > 1.07" for 2YR event  
 Inflow = 1.70 cfs @ 12.09 hrs, Volume= 0.116 af  
 Outflow = 0.35 cfs @ 12.57 hrs, Volume= 0.093 af, Atten= 80%, Lag= 28.6 min  
 Discarded = 0.08 cfs @ 12.57 hrs, Volume= 0.051 af  
 Primary = 0.27 cfs @ 12.57 hrs, Volume= 0.042 af  
 Routed to Reach IP-P1 : 45 MAIN ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 332.82' @ 12.57 hrs Surf.Area= 1,387 sf Storage= 1,967 cf

Plug-Flow detention time= 121.9 min calculated for 0.093 af (80% of inflow)  
 Center-of-Mass det. time= 68.8 min ( 884.1 - 815.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	331.00'	5,380 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
331.00	510	0	0
332.00	1,250	880	880
335.00	1,750	4,500	5,380

Device	Routing	Invert	Outlet Devices
#1	Discarded	331.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	332.25'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	333.50'	25.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3d s/n 13057 © 2023 HydroCAD Software Solutions LLC

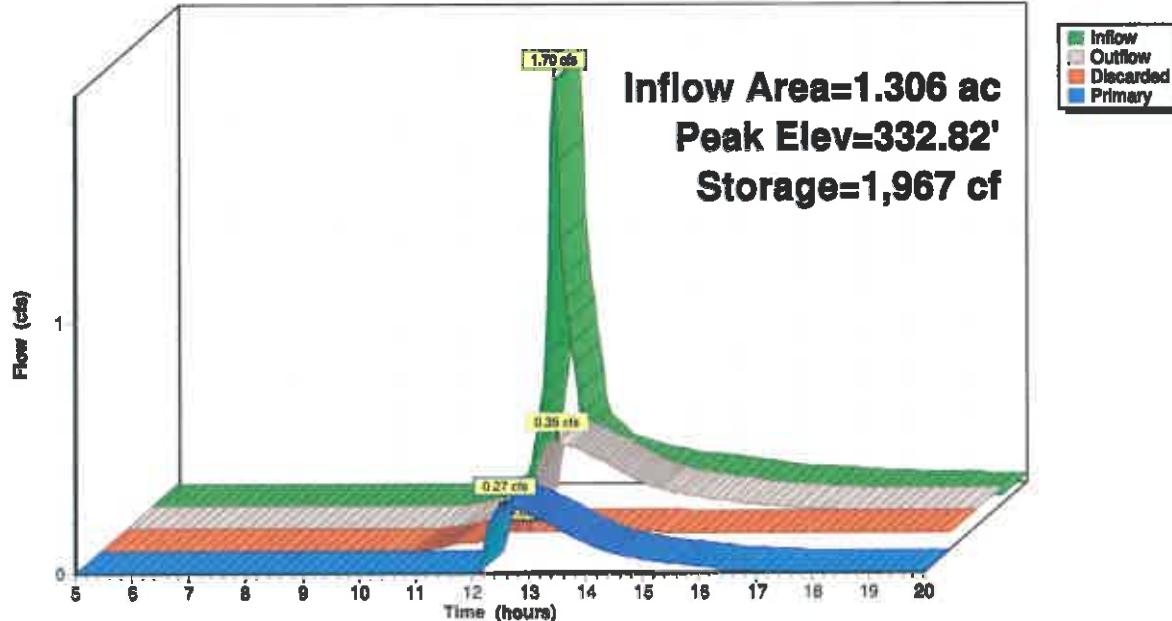
**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 34

**Discarded OutFlow** Max=0.08 cfs @ 12.57 hrs HW=332.82' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Primary OutFlow** Max=0.27 cfs @ 12.57 hrs HW=332.82' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.27 cfs @ 3.07 fps)  
3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

**Pond PND3: BASIN3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 2YR Rainfall=3.39"**

Printed 8/29/2023

Page 35

**Summary for Pond PND4: U/G BASIN**

Inflow Area = 0.514 ac, 100.00% Impervious, Inflow Depth > 2.95" for 2YR event  
 Inflow = 1.65 cfs @ 12.08 hrs, Volume= 0.126 af  
 Outflow = 0.20 cfs @ 11.65 hrs, Volume= 0.126 af, Atten= 88%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 11.65 hrs, Volume= 0.126 af  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af  
 Routed to Pond PND1 : PND 1

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 324.55' @ 12.66 hrs Surf.Area= 3,637 sf Storage= 1,896 cf

Plug-Flow detention time= 67.6 min calculated for 0.126 af (99% of Inflow)  
 Center-of-Mass det. time= 86.1 min ( 804.1 - 738.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	324.00'	2,587 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 12,739 cf Overall - 6,270 cf Embedded = 6,468 cf x 40.0% Voids
#2	324.00'	6,270 cf	Culitec R-330XLHD x 120 Inside #1 Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 1 rows
8,857 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
324.00	3,673	0	0
324.50	3,637	1,828	1,828
327.00	3,637	9,093	10,920
327.50	3,637	1,819	12,739

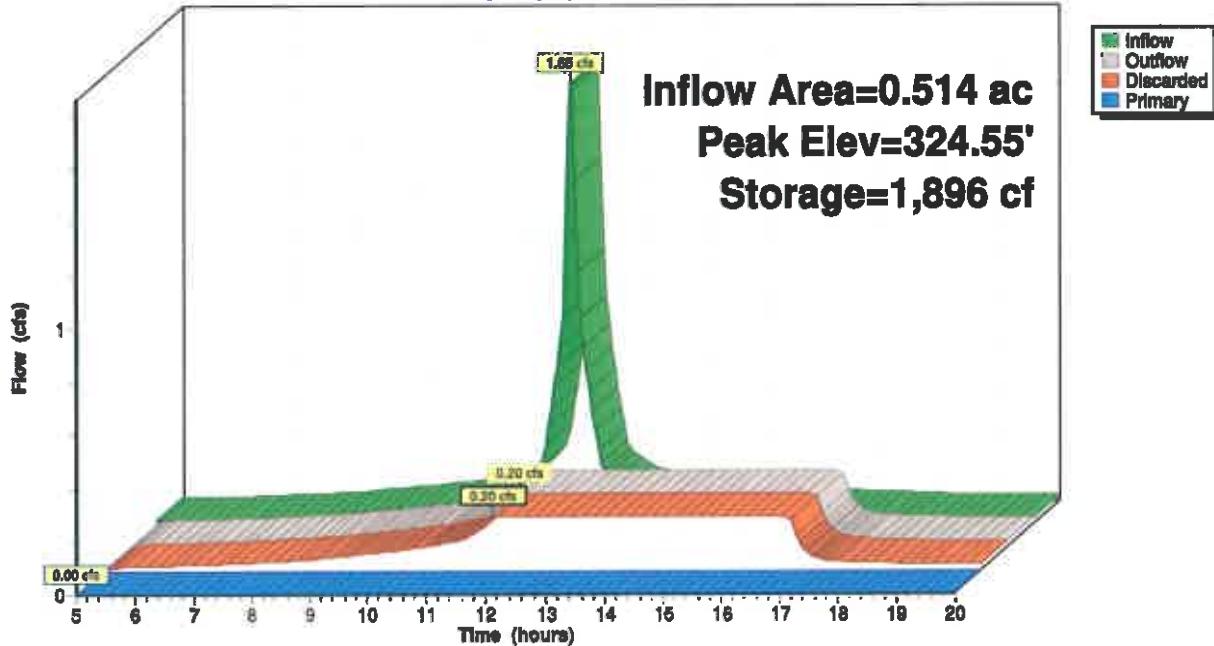
Device	Routing	Invert	Outlet Devices
#1	Discarded	324.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	326.50'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**Discarded OutFlow** Max=0.20 cfs @ 11.65 hrs HW=324.04' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.20 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=324.00' (Free Discharge)  
2=Orifice/Grate (Controls 0.00 cfs)

#### Pond PND4: U/G BASIN

##### Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 37

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

**Subcatchment E-1: DA E-1**Runoff Area=197,469 sf 3.58% Impervious Runoff Depth>2.11"  
Flow Length=560' Slope=0.0450 '/' Tc=7.1 min CN=72 Runoff=11.43 cfs 0.797 af**Subcatchment E-2: DA E-2**Runoff Area=197,469 sf 2.56% Impervious Runoff Depth>2.03"  
Flow Length=470' Tc=9.3 min CN=71 Runoff=10.14 cfs 0.766 af**Subcatchment P-1: P-1**Runoff Area=81,268 sf 39.90% Impervious Runoff Depth>2.98"  
Flow Length=618' Tc=7.1 min CN=82 Runoff=6.59 cfs 0.463 af**Subcatchment P-2: P-2**Runoff Area=82,391 sf 33.69% Impervious Runoff Depth>2.88"  
Flow Length=330' Tc=7.1 min CN=81 Runoff=6.49 cfs 0.455 af**Subcatchment P-3: P-3**Runoff Area=8,272 sf 54.38% Impervious Runoff Depth>3.46"  
Tc=6.0 min CN=87 Runoff=0.78 cfs 0.055 af**Subcatchment P-4: P-4**Runoff Area=56,906 sf 7.39% Impervious Runoff Depth>2.27"  
Flow Length=505' Tc=5.5 min CN=74 Runoff=3.71 cfs 0.248 af**Subcatchment P-5: P-5**Runoff Area=145,259 sf 0.00% Impervious Runoff Depth>1.95"  
Tc=10.0 min CN=70 Runoff=7.03 cfs 0.542 af**Subcatchment P-6: P-6**Runoff Area=81,691 sf 0.00% Impervious Runoff Depth>2.03"  
Flow Length=429' Slope=0.0450 '/' Tc=8.1 min CN=71 Runoff=4.38 cfs 0.317 af**Subcatchment P-7: BUILDING**Runoff Area=22,400 sf 100.00% Impervious Runoff Depth>4.52"  
Tc=6.0 min CN=98 Runoff=2.51 cfs 0.194 af**Reach IP-E1: 45 MAIN ST**Inflow=11.43 cfs 0.797 af  
Outflow=11.43 cfs 0.797 af**Reach IP-E2: SCHOOL ST**Inflow=10.14 cfs 0.766 af  
Outflow=10.14 cfs 0.766 af

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 38

**Reach IP-P1: 45 MAIN ST**Inflow=9.99 cfs 0.756 af  
Outflow=9.99 cfs 0.756 af**Reach IP-P2: SCHOOL ST**Inflow=4.49 cfs 0.619 af  
Outflow=4.49 cfs 0.619 af**Pond PND1: PND 1**Peak Elev=324.51' Storage=10,936 cf Inflow=8.59 cfs 0.463 af  
Discarded=0.24 cfs 0.162 af Primary=0.49 cfs 0.105 af Outflow=0.72 cfs 0.268 af**Pond PND2: BASIN#2**Peak Elev=325.58' Storage=8,719 cf Inflow=6.49 cfs 0.455 af  
Discarded=0.17 cfs 0.131 af Primary=1.45 cfs 0.186 af Outflow=1.62 cfs 0.327 af**Pond PND3: BASIN3**Peak Elev=333.60' Storage=3,092 cf Inflow=3.71 cfs 0.248 af  
Discarded=0.08 cfs 0.059 af Primary=2.56 cfs 0.160 af Outflow=2.64 cfs 0.219 af**Pond PND4: U/G BASIN**Peak Elev=325.00' Storage=3,390 cf Inflow=2.51 cfs 0.194 af  
Discarded=0.20 cfs 0.187 af Primary=0.00 cfs 0.000 af Outflow=0.20 cfs 0.187 af**Total Runoff Area = 20.044 ac Runoff Volume = 3.835 af Average Runoff Depth = 2.30"**  
**88.16% Pervious = 17.670 ac 11.84% Impervious = 2.374 ac**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 39

**Summary for Subcatchment E-1: DA E-1**

Runoff = 11.43 cfs @ 12.11 hrs, Volume= 0.797 af, Depth> 2.11"  
 Routed to Reach IP-E1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description		
7,074	98	Paved parking, HSG C		
35,876	74	>75% Grass cover, Good, HSG C		
154,519	70	Woods, Good, HSG C		
197,469	72	Weighted Average		
190,395		96.42% Pervious Area		
7,074		3.58% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
0.2	40	0.0450	3.42	<b>Shallow Concentrated Flow, TRAVEL PATH A TO B</b> Unpaved Kv= 16.1 fps
0.5	110	0.0450	3.42	<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
6.4	410	0.0450	1.06	<b>Shallow Concentrated Flow, TRAVEL PATH C TO D</b> Woodland Kv= 5.0 ips
7.1	560			Total

**PRE-POST DEVELOPMENT**

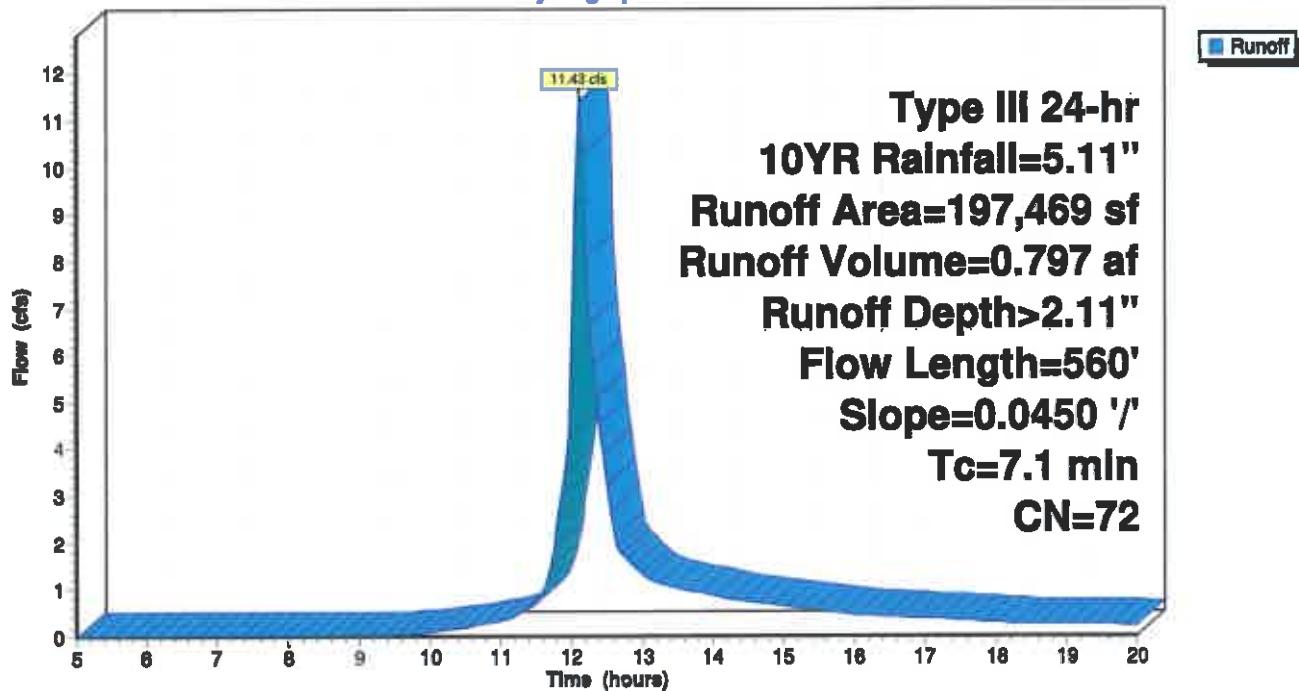
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-Sc s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 40

**Subcatchment E-1: DA E-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 41

**Summary for Subcatchment E-2: DA E-2**

Runoff = 10.14 cfs @ 12.14 hrs, Volume= 0.766 af, Depth> 2.03"  
 Routed to Reach IP-E2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description		
5,057	98	Paved parking, HSG C		
30,786	74	>75% Grass cover, Good, HSG C		
161,626	70	Woods, Good, HSG C		
197,469	71	Weighted Average		
192,412		97.44% Pervious Area		
5,057		2.56% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
3.4	40	0.0450	0.20	Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42	Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
2.9	225	0.0650	1.27	Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
2.6	125	0.0250	0.79	Shallow Concentrated Flow, TRAVEL PATH D TO E Woodland Kv= 5.0 fps
9.3	470	Total		

**PRE-POST DEVELOPMENT**

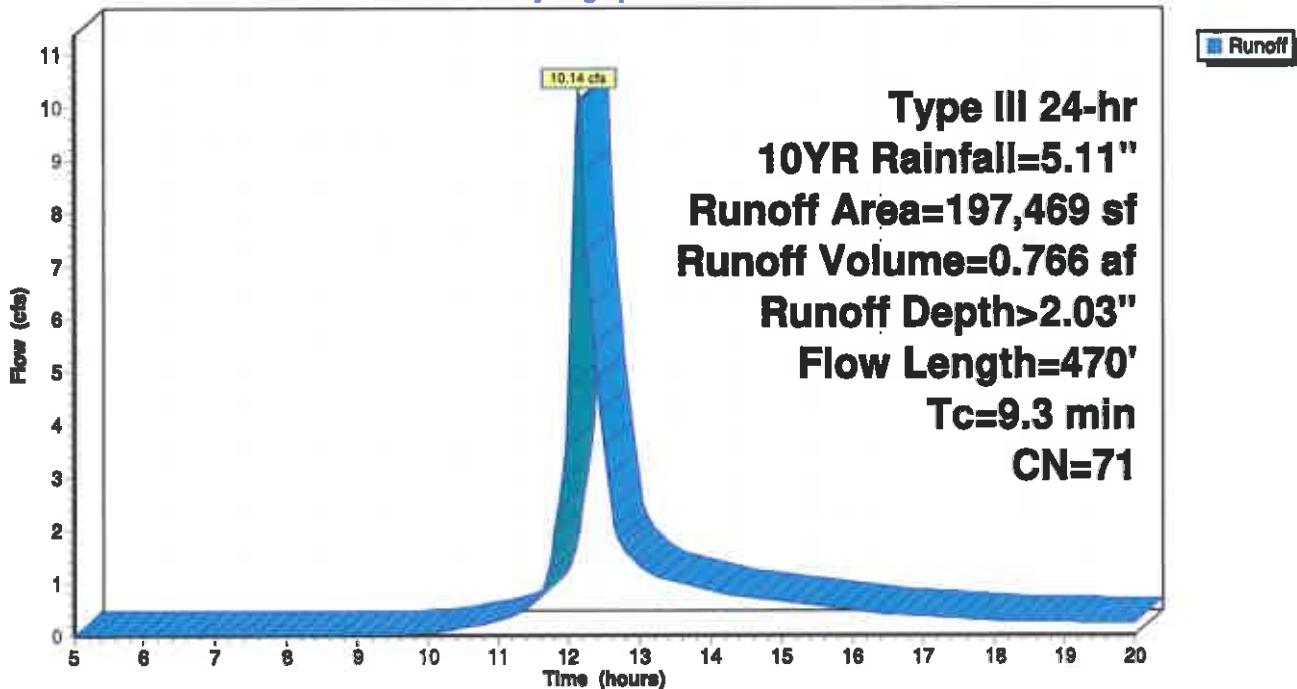
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 10YR Rainfall=5.11"*

Printed 8/29/2023

Page 42

**Subcatchment E-2: DA E-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 43

**Summary for Subcatchment P-1: P-1**

Runoff = 6.59 cfs @ 12.10 hrs, Volume= 0.463 af, Depth> 2.98"  
 Routed to Pond PND1 : PND 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description		
32,428	98	Paved parking, HSG C		
26,882	74	>75% Grass cover, Good, HSG C		
21,958	70	Woods, Good, HSG C		
81,268	82	Weighted Average		
48,840		60.10% Pervious Area		
32,428		39.90% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20	Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42	Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.6	100	0.0450	1.06	Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
0.6	100	0.0200	2.87	Shallow Concentrated Flow, TRAVEL PATH D TO E Paved Kv= 20.3 fps
0.4	288	0.0250	12.22	Pipe Channel, TRAVEL PATH E TO F 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.010
7.1	618	Total		

**PRE-POST DEVELOPMENT**

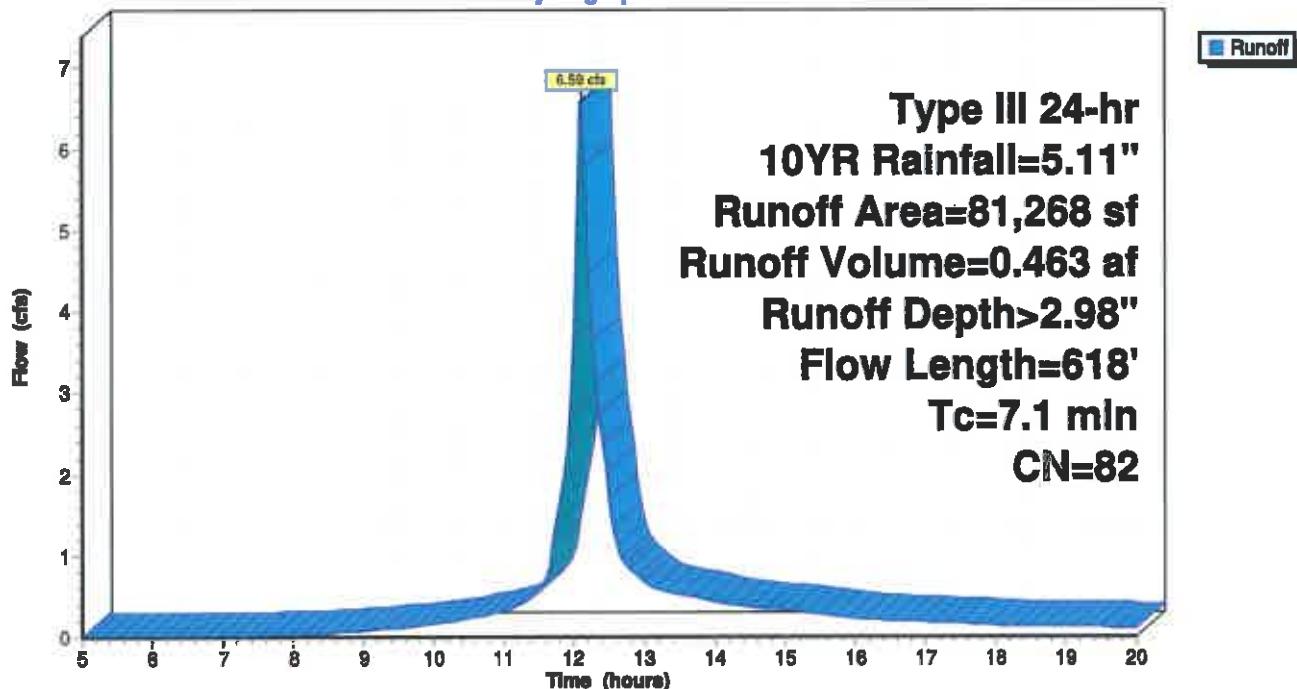
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 44

**Subcatchment P-1: P-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 45

**Summary for Subcatchment P-2: P-2**

Runoff = 6.49 cfs @ 12.10 hrs, Volume= 0.455 af, Depth> 2.88"  
 Routed to Pond PND2 : BASIN#2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description		
27,755	98	Paved parking, HSG C		
34,256	74	>75% Grass cover, Good, HSG C		
20,380	70	Woods, Good, HSG C		
82,391	81	Weighted Average		
54,636		66.31% Pervious Area		
27,755		33.69% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
4.5	50	0.0450	0.19	Sheet Flow, TRAVEL PATH A TO B Cultivated: Residue>20% n= 0.170 P2= 3.20"
0.7	135	0.0450	3.42	Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.9	145	0.0650	1.27	Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
7.1	330	Total		

**PRE-POST DEVELOPMENT**

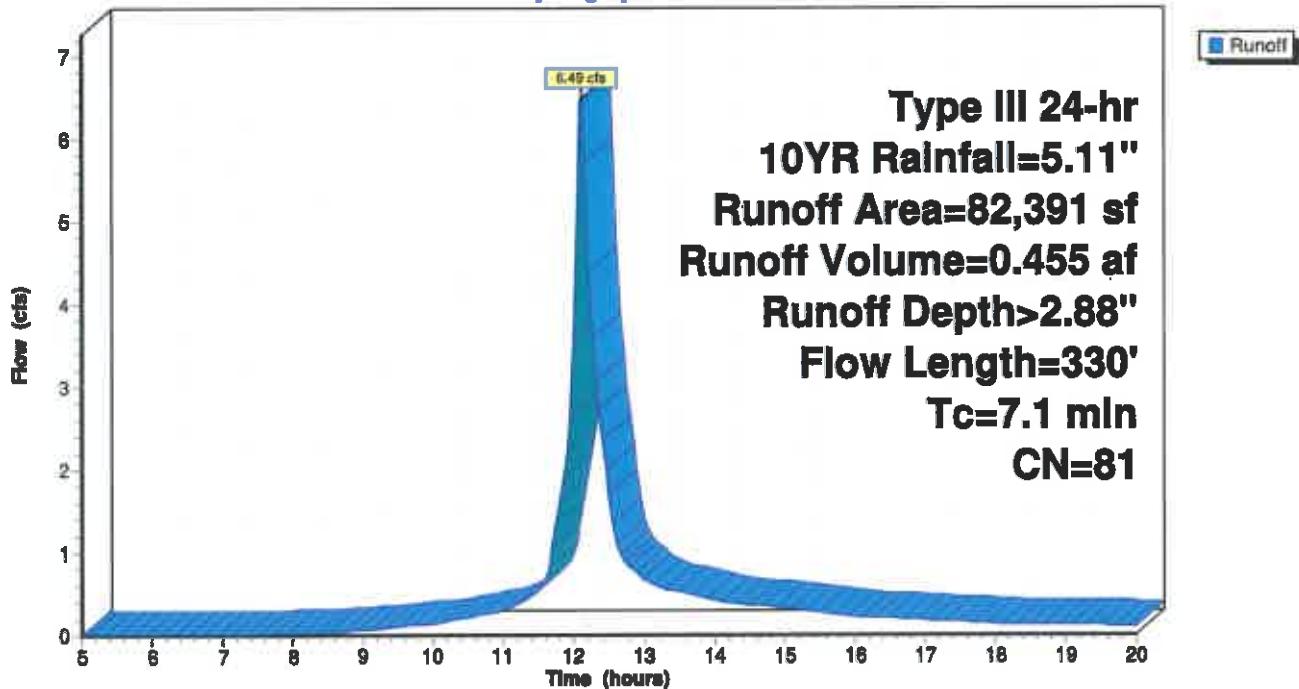
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 46

**Subcatchment P-2: P-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 47

**Summary for Subcatchment P-3: P-3**

Runoff = 0.78 cfs @ 12.09 hrs, Volume= 0.055 af, Depth> 3.46"  
Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description
4,498	98	Paved parking, HSG C
3,774	74	>75% Grass cover, Good, HSG C
8,272	87	Weighted Average
3,774		45.62% Pervious Area
4,498		54.38% Impervious Area

Tc (min)	Length (feet)	Slope ft/ft	Velocity ft/sec	Capacity cfs	Description
6.0					Direct Entry, TRAVEL PATH

**PRE-POST DEVELOPMENT**

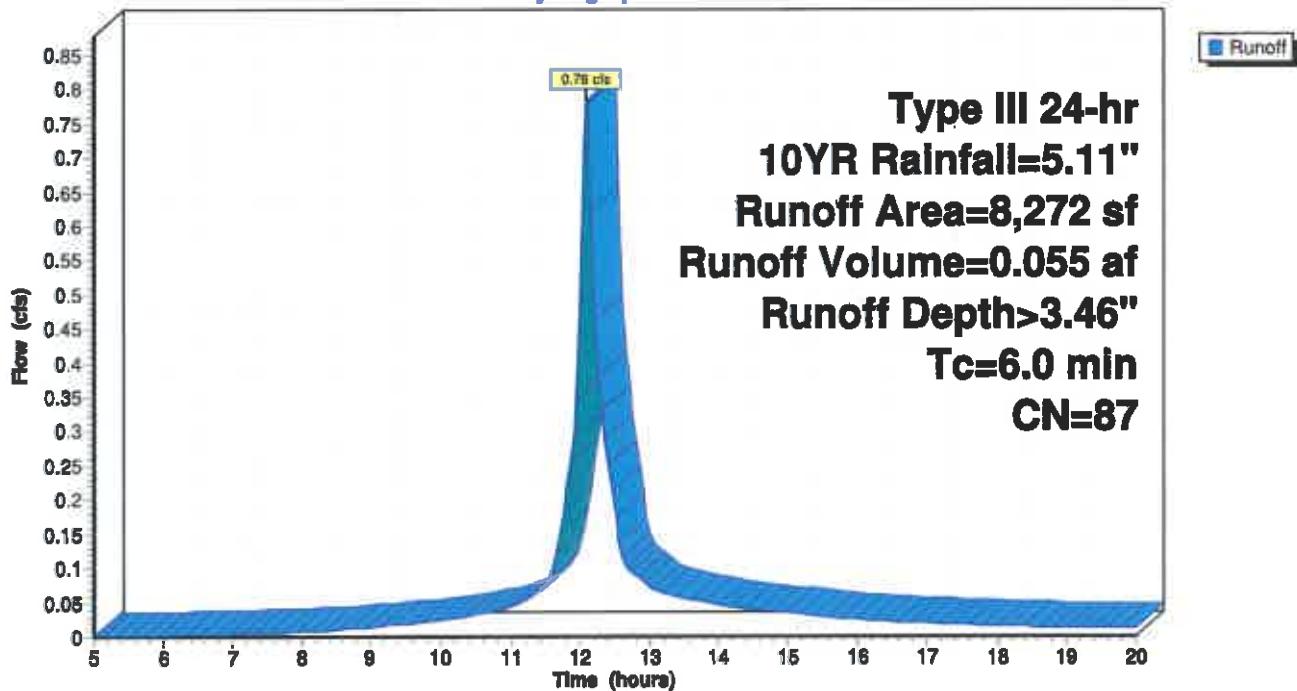
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 48

**Subcatchment P-3: P-3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 49

**Summary for Subcatchment P-4: P-4**

Runoff = 3.71 cfs @ 12.09 hrs, Volume= 0.248 af, Depth> 2.27"  
 Routed to Pond PND3 : BASIN3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description
4,207	98	Paved parking, HSG C
22,144	74	>75% Grass cover, Good, HSG C
30,555	70	Woods, Good, HSG C
56,906	74	Weighted Average
52,699		92.61% Pervious Area
4,207		7.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		<b>Sheet Flow, TRAVEL PATH A TO B</b> Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
0.5	100	0.4500	3.35		<b>Shallow Concentrated Flow, TRAVEL PATH C TO D</b> Woodland Kv= 5.0 fps
0.1	25	0.0250	3.21		<b>Shallow Concentrated Flow, TRAVEL PATH D TO E</b> Paved Kv= 20.3 fps
0.4	250	0.0250	10.82	13.28	<b>Pipe Channel, TRAVEL PATH F TO E</b> 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.010
5.5	505	Total			

**PRE-POST DEVELOPMENT**

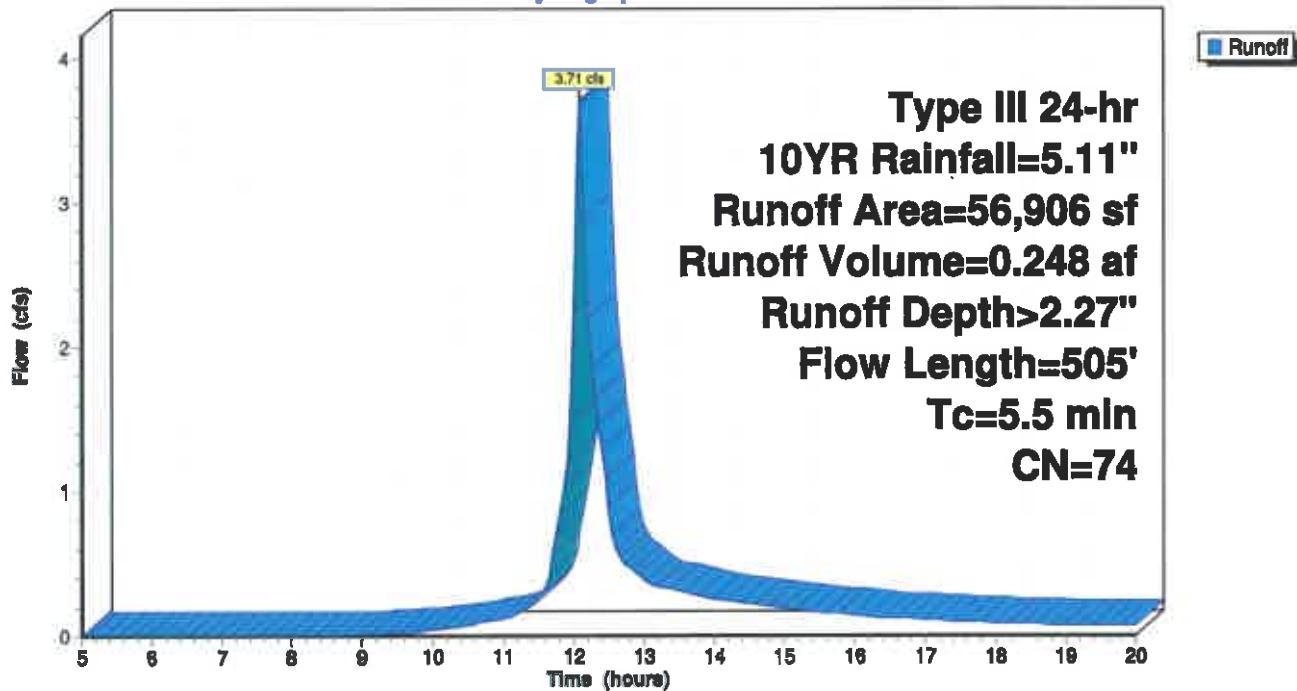
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 50

**Subcatchment P-4: P-4****Hydrograph**

## PRE-POST DEVELOPMENT

Prepared by D&L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 51

### **Summary for Subcatchment P-5: P-5**

Runoff = 7.03 cfs @ 12.15 hrs, Volume= 0.542 af, Depth> 1.95"  
Routed to Reach IP-P1 : 45 MAIN ST

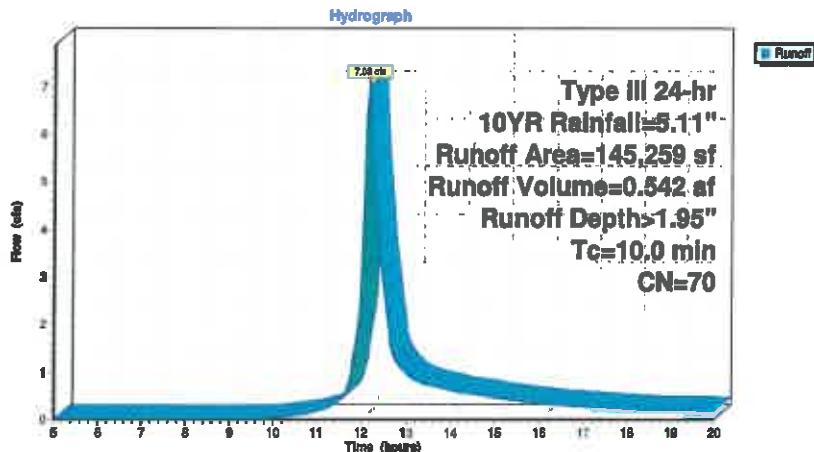
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description
145,259	70	Woods, Good, HSG C
145,259		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					<b>Direct Entry, TRAVEL PATH</b>

### **Direct Entry, TRAVEL PATH**

### **Subcatchment P-5: P-5**



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c in 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 52

**Summary for Subcatchment P-6: P-6**

Runoff = 4.38 cfs @ 12.12 hrs, Volume= 0.317 af, Depth> 2.03"  
 Routed to Reach IP-P2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description			
15,023	74	>75% Grass cover, Good, HSG C			
66,668	70	Woods, Good, HSG C			
81,691	71	Weighted Average			
81,691		100.00% Pervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.9	184	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
3.1	195	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
8.1	429	Total			

**PRE-POST DEVELOPMENT**

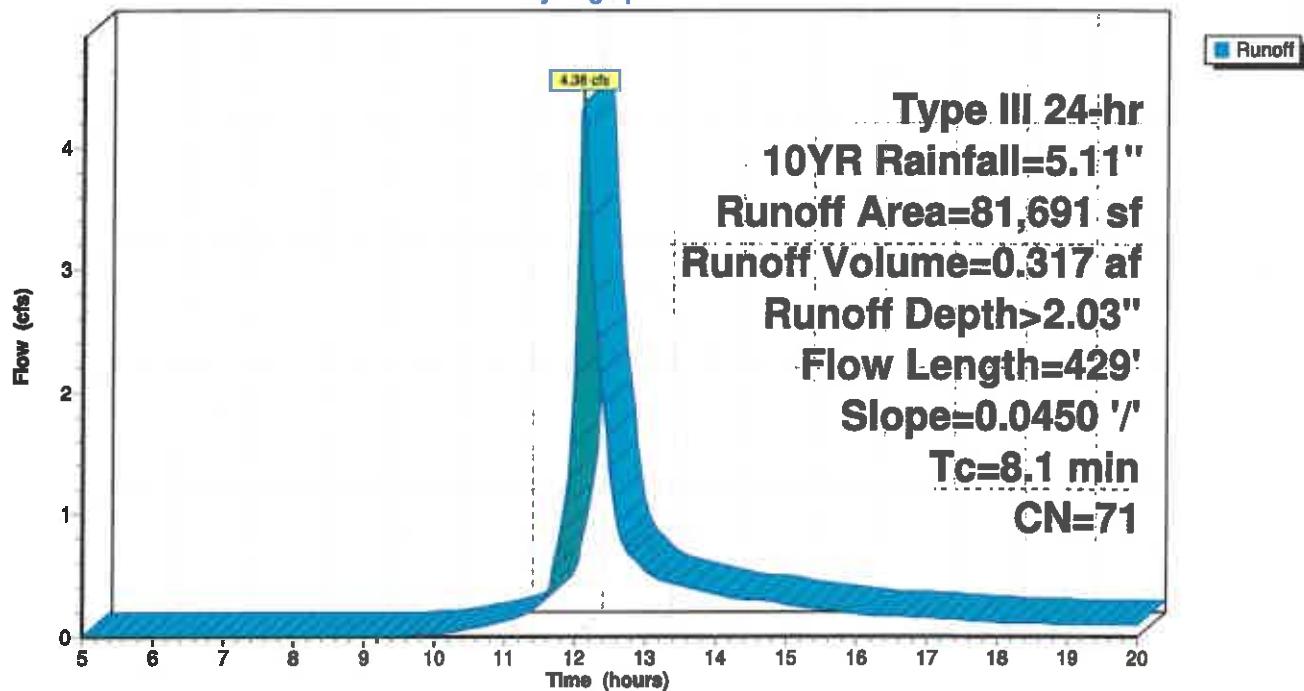
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 53

**Subcatchment P-6: P-6****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 54

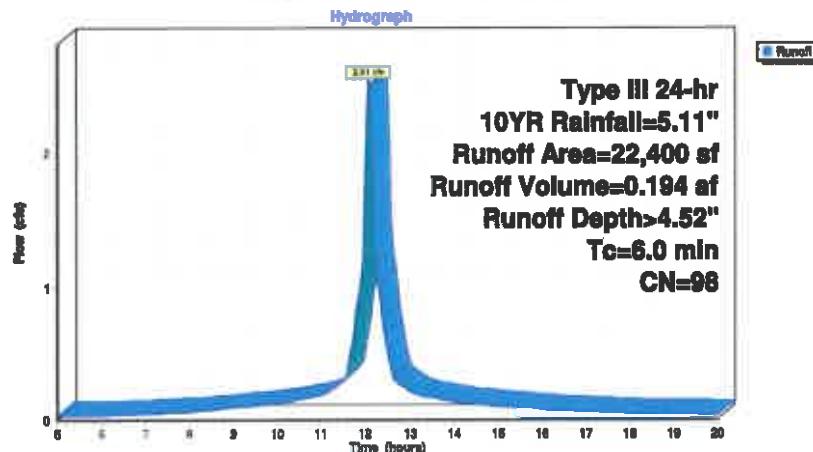
**Summary for Subcatchment P-7: BUILDING**

Runoff = 2.51 cfs @ 12.09 hrs, Volume= 0.194 af, Depth> 4.52"  
Routed to Pond PND4 : U/G BASIN

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10YR Rainfall=5.11"

Area (sf)	CN	Description
22,400	98	Roofs, HSG C
22,400		100.00% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
6.0	Direct Entry, TRAVEL PATH				

**Subcatchment P-7: BUILDING**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

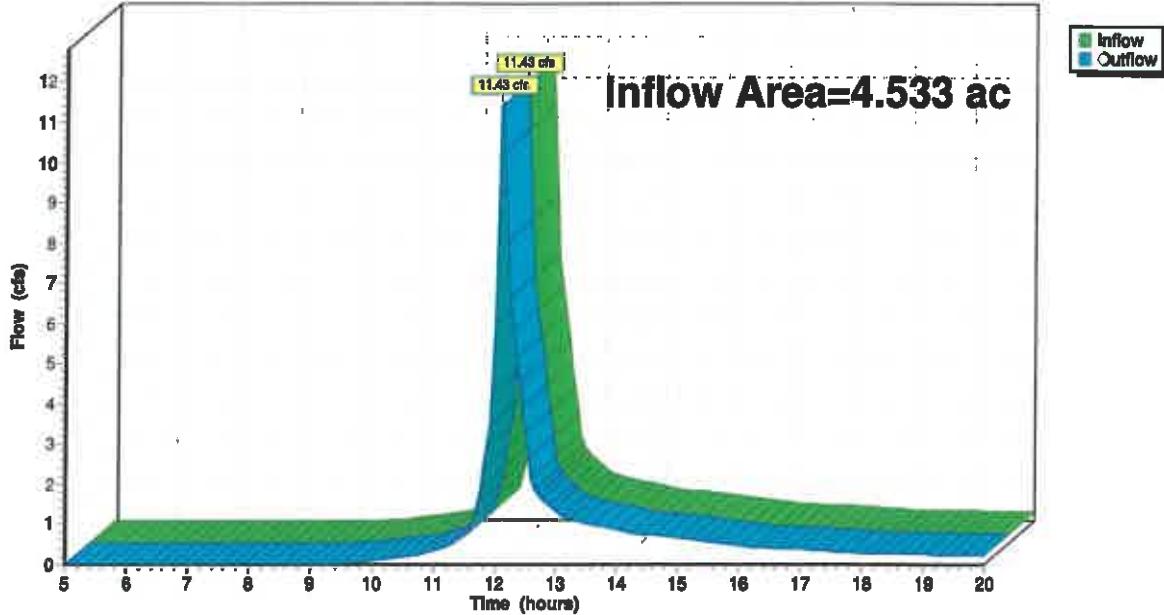
Printed 8/29/2023

Page 55

**Summary for Reach IP-E1: 45 MAIN ST**

Inflow Area = 4.533 ac, 3.58% Impervious, Inflow Depth > 2.11" for 10YR event  
Inflow = 11.43 cfs @ 12.11 hrs, Volume= 0.797 af  
Outflow = 11.43 cfs @ 12.11 hrs, Volume= 0.797 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

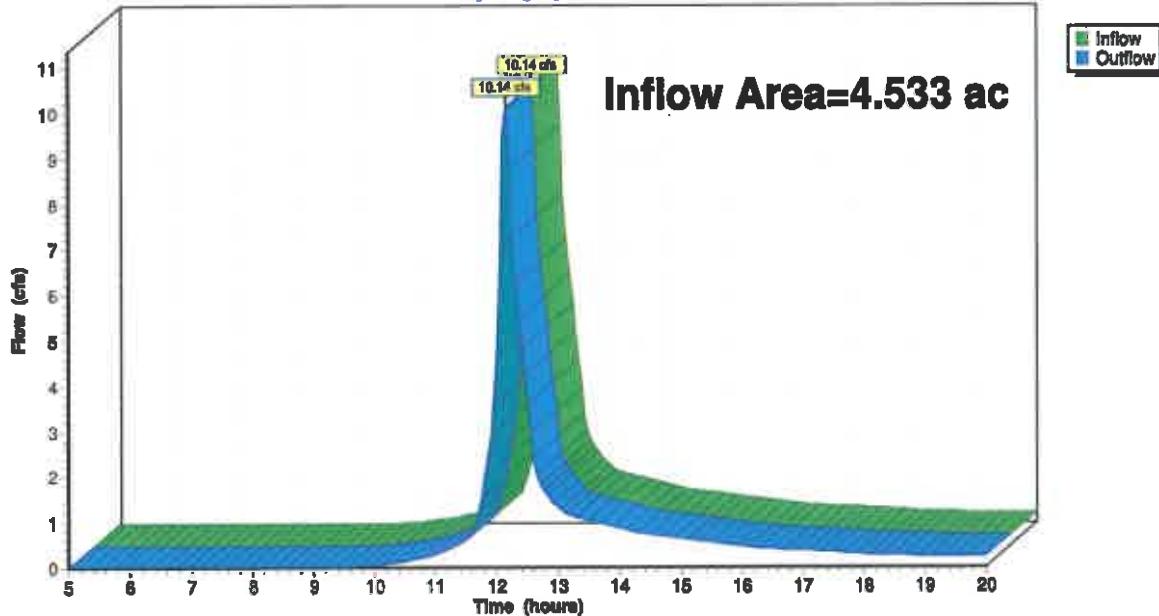
Printed 8/29/2023

Page 56

**Summary for Reach IP-E2: SCHOOL ST**

Inflow Area = 4.533 ac, 2.56% Impervious, Inflow Depth > 2.03" for 10YR event  
Inflow = 10.14 cfs @ 12.14 hrs, Volume= 0.766 af  
Outflow = 10.14 cfs @ 12.14 hrs, Volume= 0.766 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

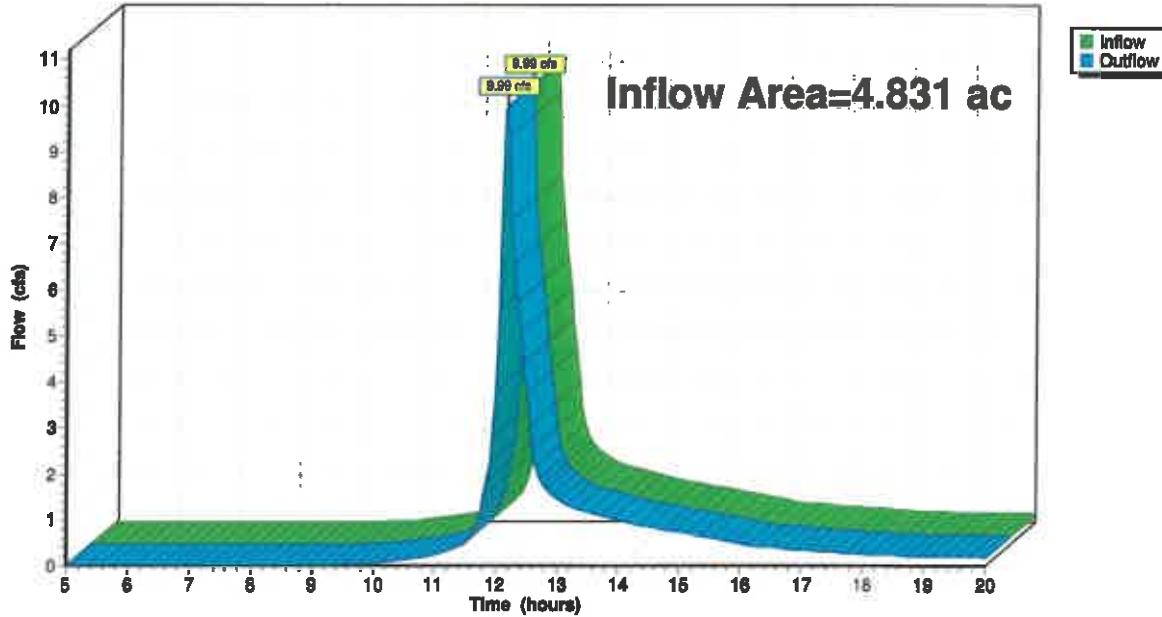
Printed 8/29/2023

Page 57

**Summary for Reach IP-P1: 45 MAIN ST**

Inflow Area = 4.831 ac, 4.14% Impervious, Inflow Depth > 1.88" for 10YR event  
Inflow = 9.99 cfs @ 12.17 hrs, Volume= 0.756 af  
Outflow = 9.99 cfs @ 12.17 hrs, Volume= 0.756 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

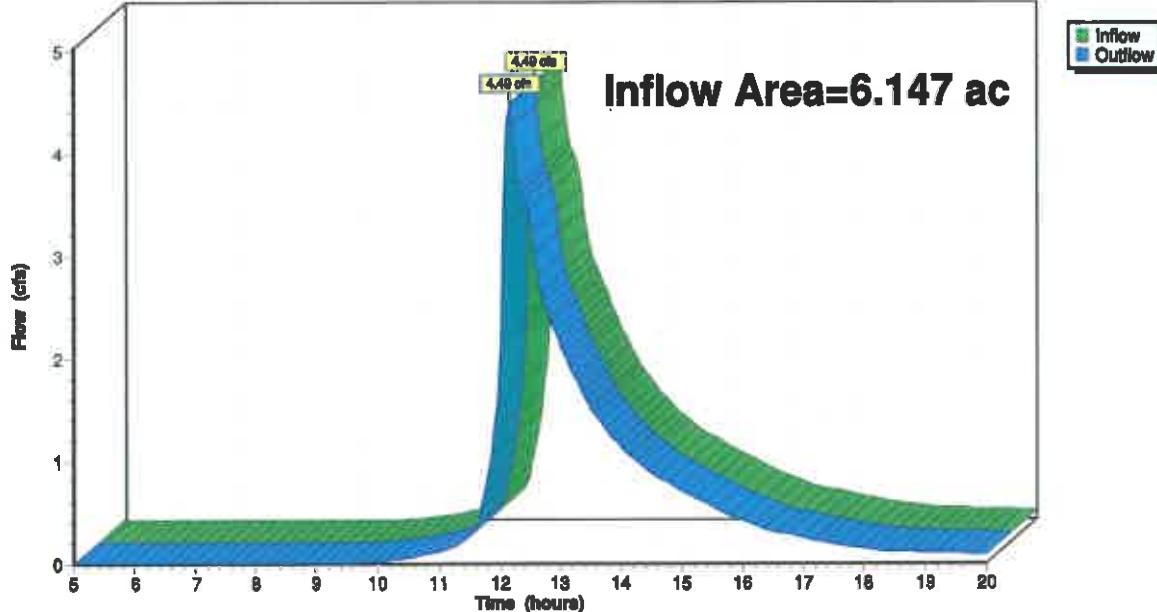
Printed 8/29/2023

Page 58

**Summary for Reach IP-P2: SCHOOL ST**

Inflow Area = 6.147 ac, 30.84% Impervious, Inflow Depth > 1.21" for 10YR event  
Inflow = 4.49 cfs @ 12.15 hrs, Volume= 0.619 af  
Outflow = 4.49 cfs @ 12.15 hrs, Volume= 0.619 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 59

**Summary for Pond PND1: PND 1**

Inflow Area = 2.380 ac, 52.89% Impervious, Inflow Depth > 2.33" for 10YR event  
 Inflow = 6.59 cfs @ 12.10 hrs, Volume= 0.463 af  
 Outflow = 0.72 cfs @ 12.93 hrs, Volume= 0.268 af, Atten= 89%, Lag= 49.5 min  
 Discarded = 0.24 cfs @ 12.93 hrs, Volume= 0.162 af  
 Primary = 0.49 cfs @ 12.93 hrs, Volume= 0.105 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 324.51' @ 12.93 hrs Surf.Area= 4,234 sf Storage= 10,936 cf

Plug-Flow detention time= 174.5 min calculated for 0.267 af (58% of inflow)  
 Center-of-Mass det. time= 98.7 min ( 881.3 - 782.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	320.00'	25,250 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
320.00	1,100	0	0
322.00	2,125	3,225	3,225
324.00	3,600	5,725	8,950
326.00	6,100	9,700	18,650
327.00	7,100	6,600	25,250

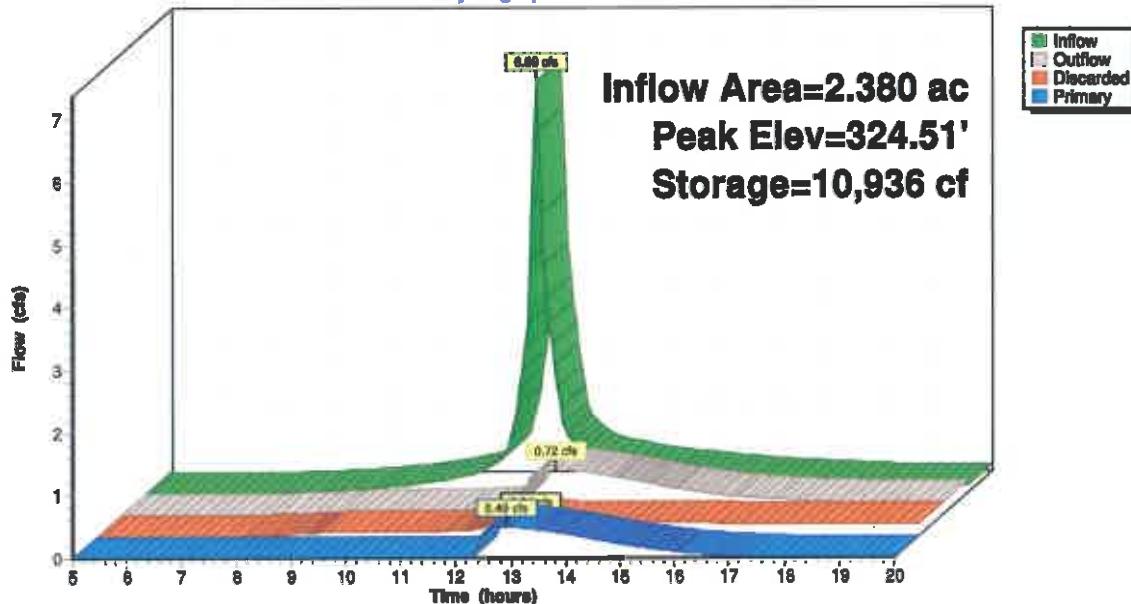
Device	Routing	Invert	Outlet Devices
#1	Discarded	320.00'	2,400 in/hr Exfiltration over Surface area
#2	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	325.00'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**Discarded OutFlow** Max=0.24 cfs @ 12.93 hrs HW=324.51' (Free Discharge)  
↑1=Exfiltration (Exfiltration Controls 0.24 cfs)

**Primary OutFlow** Max=0.49 cfs @ 12.93 hrs HW=324.51' (Free Discharge)  
↑2=Orifice/Grate (Orifice Controls 0.25 cfs @ 2.81 fps)  
3=Orifice/Grate (Orifice Controls 0.25 cfs @ 2.81 fps)  
4=Orifice/Grate (Controls 0.00 cfs)

#### Pond PND1: PND 1

##### Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 51

**Summary for Pond PND2: BASIN#2**

Inflow Area = 1.891 ac, 33.69% Impervious, Inflow Depth > 2.88" for 10YR event  
 Inflow = 6.49 cfs @ 12.10 hrs, Volume= 0.455 af  
 Outflow = 1.62 cfs @ 12.51 hrs, Volume= 0.327 af, Atten= 75%, Lag= 24.5 min  
 Discarded = 0.17 cfs @ 12.51 hrs, Volume= 0.131 af  
 Primary = 1.45 cfs @ 12.51 hrs, Volume= 0.196 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.58' @ 12.51 hrs Surf.Area= 3,046 sf Storage= 8,719 cf

Plug-Flow detention time= 122.9 min calculated for 0.326 af (72% of inflow)  
 Center-of-Mass det. time= 59.3 min ( 844.2 - 784.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	322.00'	13,609 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
322.00	1,600	0	0
324.00	2,638	4,238	4,238
326.00	3,155	5,793	10,031
327.00	4,000	3,578	13,609

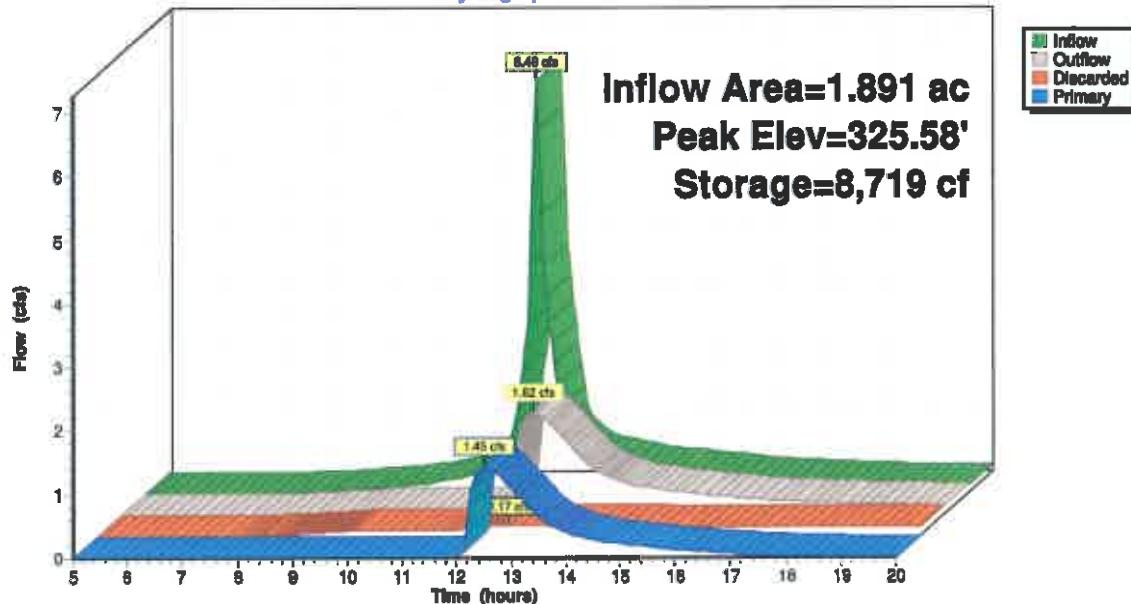
Device	Routing	Invert	Outlet Devices
#1	Discarded	322.00'	2.400 in/hr Exfiltration over Surface area
#2	Primary	324.50'	8.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	325.70'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	326.50'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**Discarded OutFlow** Max=0.17 cfs @ 12.51 hrs HW=325.57' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.17 cfs)

**Primary OutFlow** Max=1.45 cfs @ 12.51 hrs HW=325.57' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 1.45 cfs @ 4.15 fps)  
3=Orifice/Grate (Controls 0.00 cfs)  
4=Broad-Created Rectangular Weir (Controls 0.00 cfs)

### Pond PND2: BASIN#2

#### Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 63

**Summary for Pond PND3: BASIN3**

Inflow Area = 1.306 ac, 7.39% Impervious, Inflow Depth > 2.27" for 10YR event  
 Inflow = 3.71 cfs @ 12.09 hrs, Volume= 0.248 af  
 Outflow = 2.64 cfs @ 12.19 hrs, Volume= 0.219 af, Atten= 29%, Lag= 6.2 min  
 Discarded = 0.08 cfs @ 12.19 hrs, Volume= 0.059 af  
 Primary = 2.56 cfs @ 12.19 hrs, Volume= 0.160 af  
 Routed to Reach iP-P1 : 45 MAIN ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 333.60' @ 12.19 hrs Surf.Area= 1,517 sf Storage= 3,092 cf

Plug-Flow detention time= 79.1 min calculated for 0.218 af (88% of inflow)  
 Center-of-Mass det. time= 43.0 min ( 841.3 - 798.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	331.00'	5,380 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
331.00	510	0	0
332.00	1,250	880	880
335.00	1,750	4,500	5,380

Device	Routing	Invert	Outlet Devices
#1	Discarded	331.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	332.25'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	333.50'	25.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

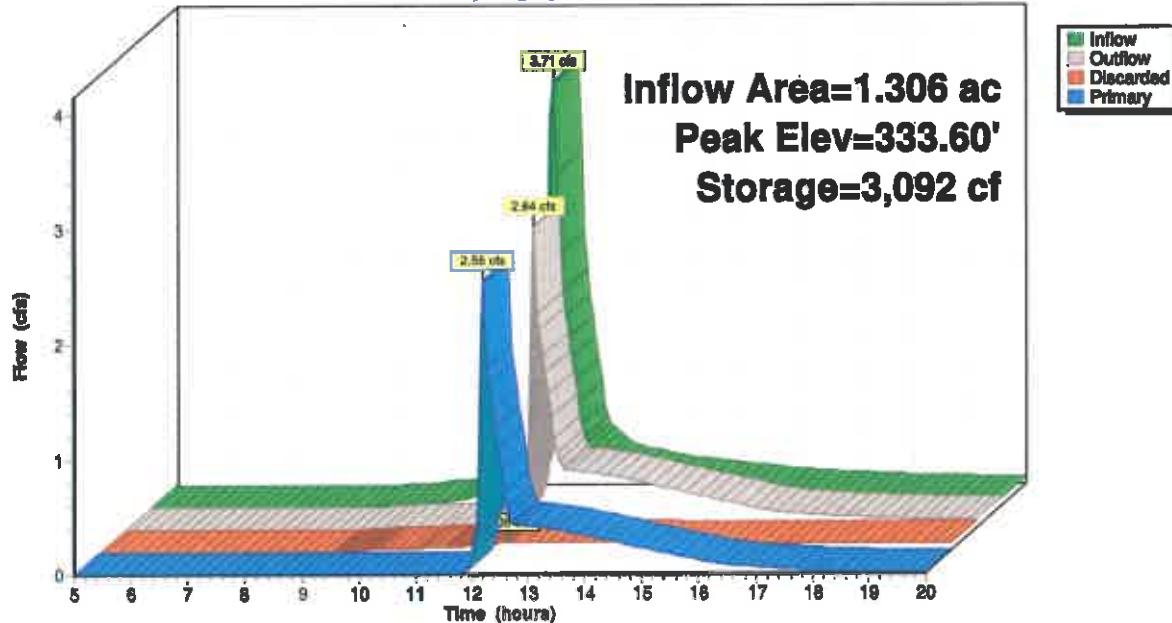
**Type III 24-hr 10YR Rainfall=5.11"**

Printed 8/29/2023

Page 64

**Discarded OutFlow** Max=0.08 cfs @ 12.19 hrs HW=333.60' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Primary OutFlow** Max=2.47 cfs @ 12.19 hrs HW=333.60' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.46 cfs @ 5.23 fps)  
3=Broad-Created Rectangular Weir (Weir Controls 2.01 cfs @ 0.84 fps)

**Pond PND3: BASIN3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10YR Rainfall=5.11"

Printed 8/29/2023

Page 65

**Summary for Pond PND4: U/G BASIN**

Inflow Area = 0.514 ac, 100.00% Impervious, Inflow Depth > 4.52" for 10YR event  
 Inflow = 2.51 cfs @ 12.09 hrs, Volume= 0.194 af  
 Outflow = 0.20 cfs @ 11.30 hrs, Volume= 0.187 af, Atten= 92%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 11.30 hrs, Volume= 0.187 af  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af  
 Routed to Pond PND1 : PND 1

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.00' @ 13.06 hrs Surf.Area= 3,637 sf Storage= 3,390 cf

Plug-Flow detention time= 135.0 min calculated for 0.187 af (96% of inflow)  
 Center-of-Mass det. time= 119.9 min ( 854.9 - 735.0 )

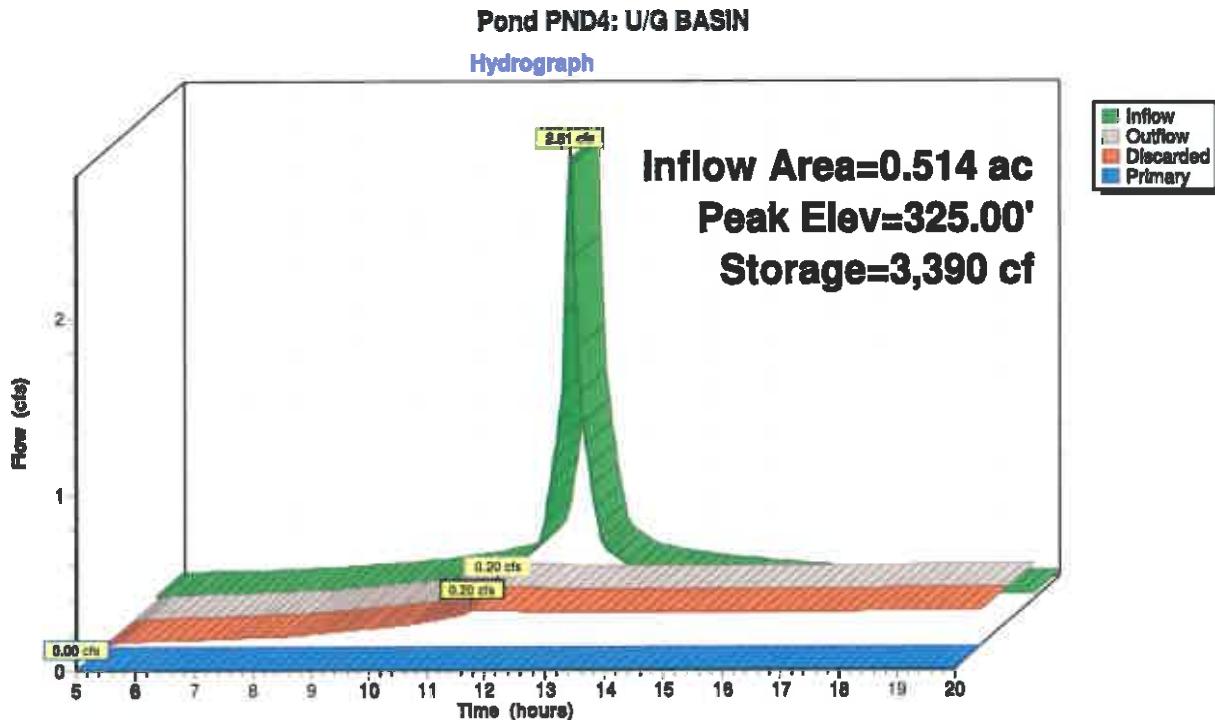
Volume	Invert	Avail.Storage	Storage Description
#1	324.00'	2,587 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 12,739 cf Overall - 6,270 cf Embedded = 6,468 cf x 40.0% Voids
#2	324.00'	6,270 cf	Cultec R-330XLHD x 120 Inside #1 Effective Size= 47.8" W x 30.0" H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0" W x 30.5" H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 1 rows
8,857 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
324.00	3,673	0	0
324.50	3,637	1,828	1,828
327.00	3,637	9,093	10,920
327.50	3,637	1,819	12,739

Device	Routing	Invert	Outlet Devices
#1	Discarded	324.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	326.50'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Discarded OutFlow Max=0.20 cfs @ 11.30 hrs HW=324.04' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.20 cfs)

Primary OutFlow Max=0.00 cfs @ 5.00 hrs HW=324.00' (Free Discharge)  
2=Orifice/Grate (Controls 0.00 cfs)



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 57

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

**Subcatchment E-1: DA E-1**

Runoff Area=197,469 sf 3.58% Impervious Runoff Depth>2.93"  
Flow Length=560' Slope=0.0450 '/' Tc=7.1 min CN=72 Runoff=15.89 cfs 1.105 af

**Subcatchment E-2: DA E-2**

Runoff Area=197,469 sf 2.56% Impervious Runoff Depth>2.83"  
Flow Length=470' Tc=9.3 min CN=71 Runoff=14.21 cfs 1.069 af

**Subcatchment P-1: P-1**

Runoff Area=81,268 sf 39.90% Impervious Runoff Depth>3.91"  
Flow Length=618' Tc=7.1 min CN=82 Runoff=8.57 cfs 0.608 af

**Subcatchment P-2: P-2**

Runoff Area=82,391 sf 33.69% Impervious Runoff Depth>3.81"  
Flow Length=330' Tc=7.1 min CN=81 Runoff=8.49 cfs 0.600 af

**Subcatchment P-3: P-3**

Runoff Area=8,272 sf 54.38% Impervious Runoff Depth>4.44"  
Tc=6.0 min CN=87 Runoff=0.99 cfs 0.070 af

**Subcatchment P-4: P-4**

Runoff Area=56,906 sf 7.39% Impervious Runoff Depth>3.12"  
Flow Length=505' Tc=5.5 min CN=74 Runoff=5.08 cfs 0.339 af

**Subcatchment P-5: P-5**

Runoff Area=145,259 sf 0.00% Impervious Runoff Depth>2.74"  
Tc=10.0 min CN=70 Runoff=8.83 cfs 0.760 af

**Subcatchment P-6: P-6**

Runoff Area=81,691 sf 0.00% Impervious Runoff Depth>2.83"  
Flow Length=429' Slope=0.0450 '/' Tc=8.1 min CN=71 Runoff=6.14 cfs 0.442 af

**Subcatchment P-7: BUILDING**

Runoff Area=22,400 sf 100.00% Impervious Runoff Depth>5.50"  
Tc=6.0 min CN=98 Runoff=3.05 cfs 0.236 af

**Reach IP-E1: 45 MAIN ST**

Inflow=15.89 cfs 1.105 af  
Outflow=15.89 cfs 1.105 af

**Reach IP-E2: SCHOOL ST**

Inflow=14.21 cfs 1.069 af  
Outflow=14.21 cfs 1.069 af

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 68

**Reach IP-P1: 45 MAIN ST**Inflow=16.23 cfs 1.076 af  
Outflow=16.23 cfs 1.076 af**Reach IP-P2: SCHOOL ST**Inflow=7.50 cfs 0.995 af  
Outflow=7.50 cfs 0.995 af**Pond PND1: PND 1**Peak Elev=325.15' Storage=13,937 cf Inflow=8.57 cfs 0.608 af  
Discarded=0.28 cfs 0.181 af Primary=0.91 cfs 0.224 af Outflow=1.19 cfs 0.405 af**Pond PND2: BASIN#2**Peak Elev=326.26' Storage=10,897 cf Inflow=8.49 cfs 0.600 af  
Discarded=0.19 cfs 0.140 af Primary=2.54 cfs 0.329 af Outflow=2.73 cfs 0.468 af**Pond PND3: BASIN3**Peak Elev=333.69' Storage=3,224 cf Inflow=5.08 cfs 0.339 af  
Discarded=0.09 cfs 0.063 af Primary=5.82 cfs 0.246 af Outflow=5.91 cfs 0.309 af**Pond PND4: U/G BASIN**Peak Elev=325.33' Storage=4,446 cf Inflow=3.05 cfs 0.236 af  
Discarded=0.20 cfs 0.195 af Primary=0.00 cfs 0.000 af Outflow=0.20 cfs 0.195 af**Total Runoff Area = 20.044 ac Runoff Volume = 5.231 af Average Runoff Depth = 3.13"**  
**88.16% Pervious = 17.670 ac 11.84% Impervious = 2.374 ac**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 69

**Summary for Subcatchment E-1: DA E-1**

Runoff = 15.89 cfs @ 12.11 hrs, Volume= 1.105 af, Depth> 2.93"  
 Routed to Reach IP-E1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
7,074	98	Paved parking, HSG C
35,876	74	>75% Grass cover, Good, HSG C
154,519	70	Woods, Good, HSG C
197,469	72	Weighted Average
190,395		96.42% Pervious Area
7,074		3.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.2	40	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH A TO B</b>
					Unpaved Kv= 16.1 fps
0.5	110	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b>
					Unpaved Kv= 16.1 fps
6.4	410	0.0450	1.06		<b>Shallow Concentrated Flow, TRAVEL PATH C TO D</b>
					Woodland Kv= 5.0 fps
7.1	560				<b>Total</b>

**PRE-POST DEVELOPMENT**

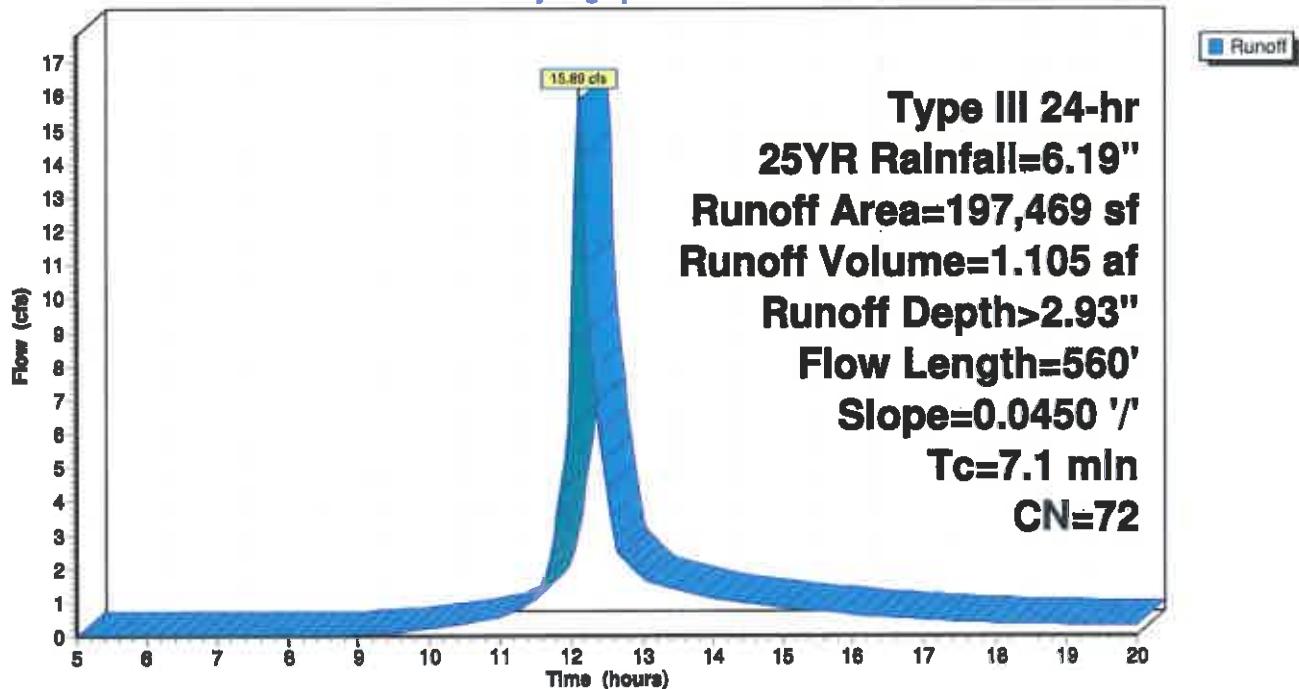
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 70

**Subcatchment E-1: DA E-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 71

**Summary for Subcatchment E-2: DA E-2**

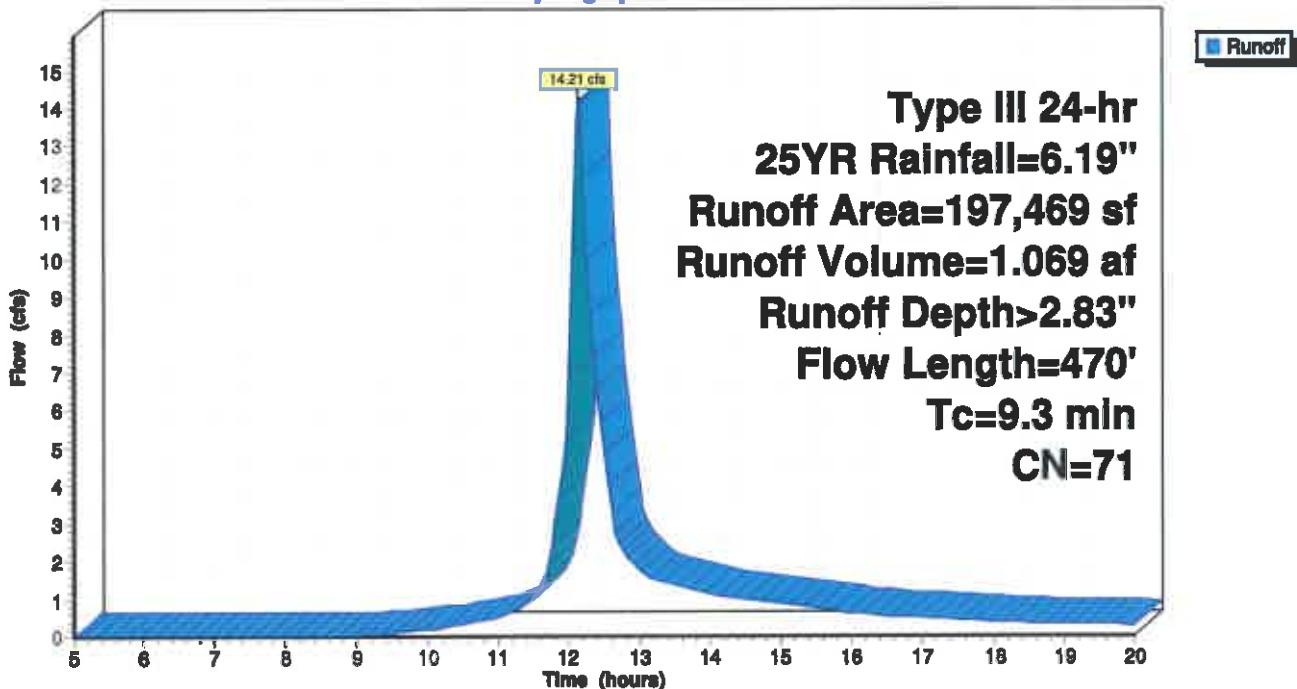
Runoff = 14.21 cfs @ 12.14 hrs, Volume= 1.069 af, Depth> 2.83"  
 Routed to Reach IP-E2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description		
5,057	98	Paved parking, HSG C		
30,786	74	>75% Grass cover, Good, HSG C		
161,626	70	Woods, Good, HSG C		
197,469	71	Weighted Average		
192,412		97.44% Pervious Area		
5,057		2.56% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)		
		Velocity (ft/sec)	Capacity (cfs)	Description
3.4	40	0.0450	0.20	Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42	Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
2.9	225	0.0650	1.27	Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
2.6	125	0.0250	0.79	Shallow Concentrated Flow, TRAVEL PATH D TO E Woodland Kv= 5.0 fps
9.3	470	Total		

### **Subcatchment E-2: DA E-2**

## Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 73

**Summary for Subcatchment P-1: P-1**

Runoff = 8.57 cfs @ 12.10 hrs, Volume= 0.608 af, Depth> 3.91"  
 Routed to Pond PND1 : PND 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
32,428	98	Paved parking, HSG C
26,882	74	>75% Grass cover, Good, HSG C
21,958	70	Woods Good, HSG C
81,268	82	Weighted Average
48,840		60.10% Pervious Area
32,428		39.90% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		<b>Sheet Flow, TRAVEL PATH A TO B</b> Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
1.6	100	0.0450	1.06		<b>Shallow Concentrated Flow, TARVEL PATH C TO D</b> Woodland Kv= 5.0 fps
0.6	100	0.0200	2.87		<b>Shallow Concentrated Flow, TARVEL PATH D TO E</b> Paved Kv= 20.3 fps
0.4	288	0.0250	12.22	21.59	<b>Pipe Channel, TARVEL PATH E TO F</b> 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.010
7.1	618	Total			

**PRE-POST DEVELOPMENT**

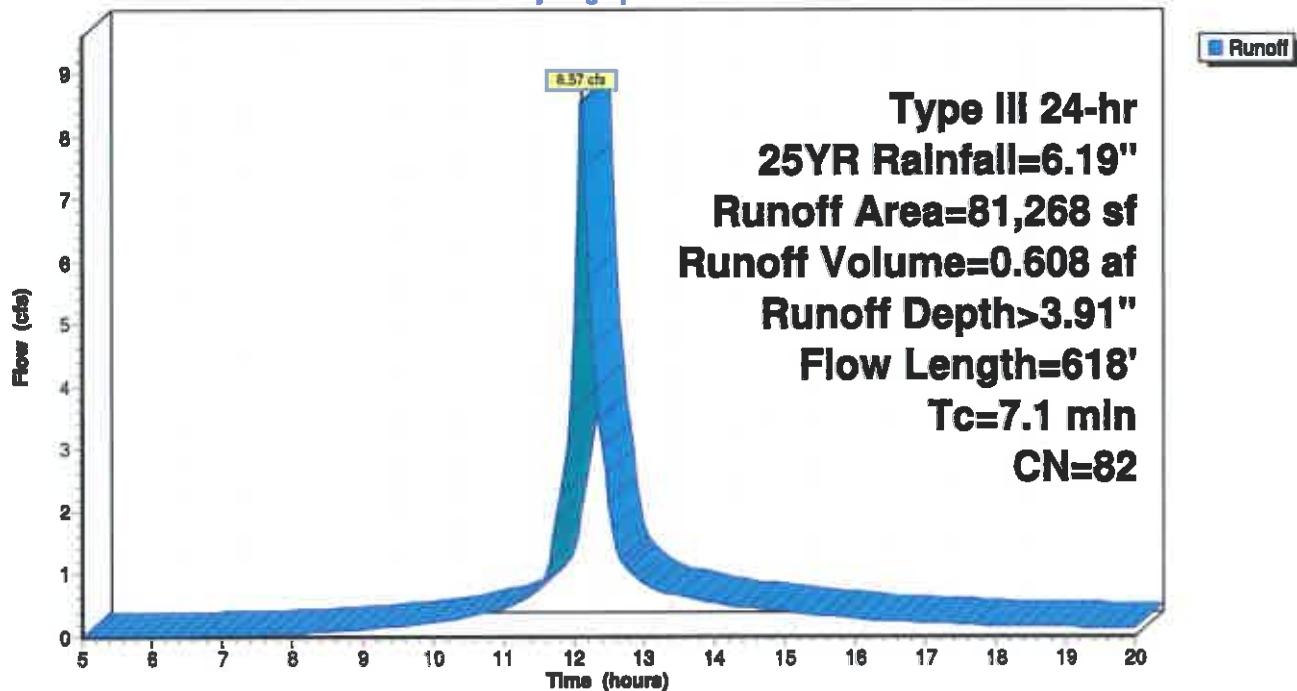
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 74

**Subcatchment P-1: P-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 75

**Summary for Subcatchment P-2: P-2**

Runoff = 8.49 cfs @ 12.10 hrs, Volume= 0.600 af, Depth> 3.81"  
 Routed to Pond PND2 : BASIN#2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
27,755	98	Paved parking, HSG C
34,256	74	>75% Grass cover, Good, HSG C
20,380	70	Woods Good, HSG C
82,391	81	Weighted Average
54,636		66.31% Pervious Area
27,755		33.69% Impervious Area
Tc (min)	Length (feet)	Slope (ft/ft)
4.5	50	0.0450
0.7	135	0.0450
1.9	145	0.0650
7.1	330	Total
Velocity (ft/sec)	Capacity (cfs)	Description
0.19		Sheet Flow, TRAVEL PATH A TO B Cultivated: Residue>20% n= 0.170 P2= 3.20"
3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
1.27		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps

**PRE-POST DEVELOPMENT**

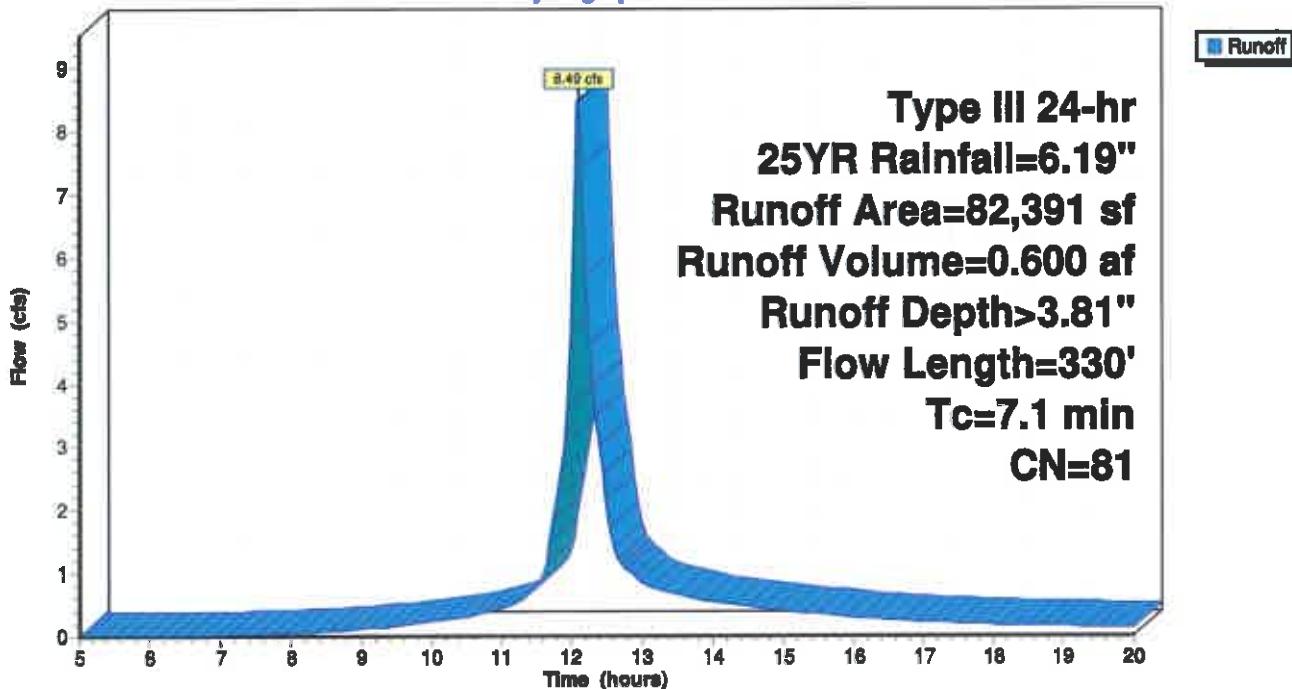
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 76

**Subcatchment P-2: P-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 77

**Summary for Subcatchment P-3: P-3**

Runoff = 0.99 cfs @ 12.09 hrs, Volume= 0.070 af, Depth> 4.44"  
Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
4,498	98	Paved parking, HSG C
3,774	74	>75% Grass cover, Good, HSG C
8,272	87	Weighted Average
3,774		45.62% Pervious Area
4,498		54.38% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
Direct Entry, TRAVEL PATH					

6.0

**PRE-POST DEVELOPMENT**

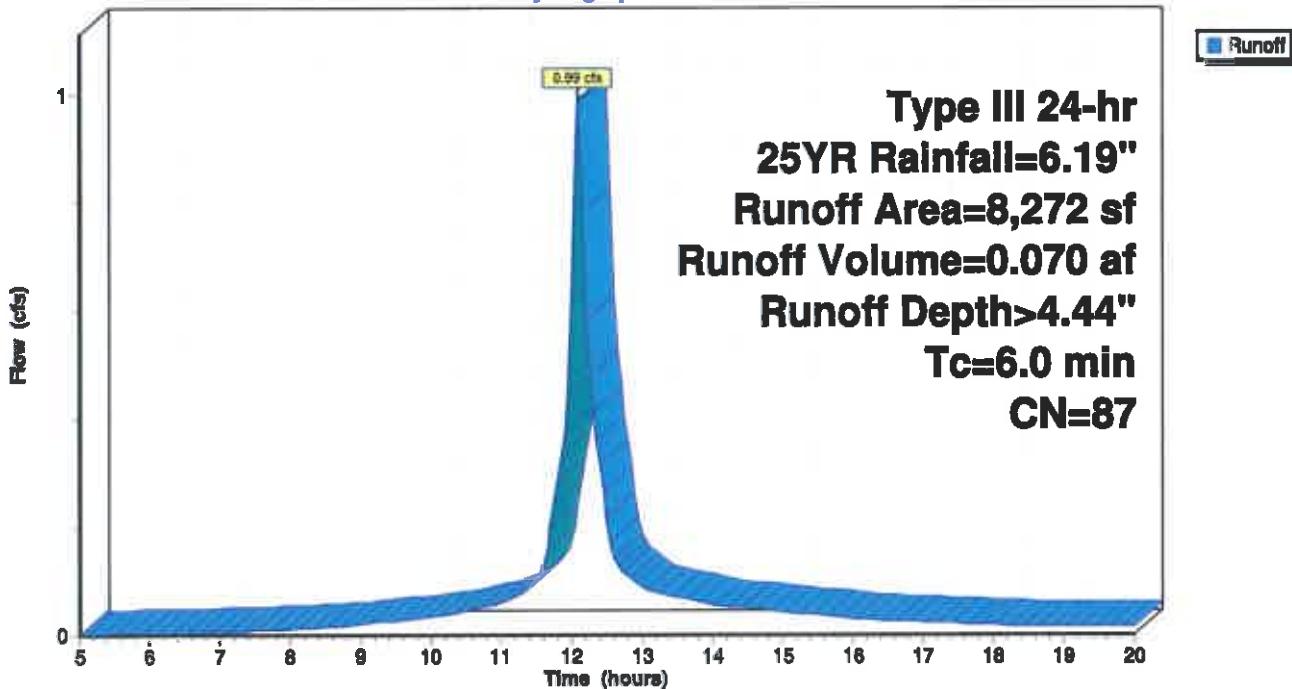
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 78

**Subcatchment P-3: P-3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 79

**Summary for Subcatchment P-4: P-4**

Runoff = 5.08 cfs @ 12.09 hrs, Volume= 0.339 af, Depth> 3.12"  
 Routed to Pond PND3 : BASIN3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description			
4,207	98	Paved parking, HSG C			
22,144	74	>75% Grass cover, Good, HSG C			
30,555	70	Woods Good, HSG C			
56,806				Weighted Average	
52,699				92.61% Pervious Area	
4,207				7.39% Impervious Area	
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
0.5	100	0.4500	3.35		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
0.1	25	0.0250	3.21		Shallow Concentrated Flow, TRAVEL PATH D TO E Paved Kv= 20.3 fps
0.4	250	0.0250	10.82	13.28	Pipe Channel, TRAVEL PATH F TO E 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.010
5.5	505	Total			

**PRE-POST DEVELOPMENT**

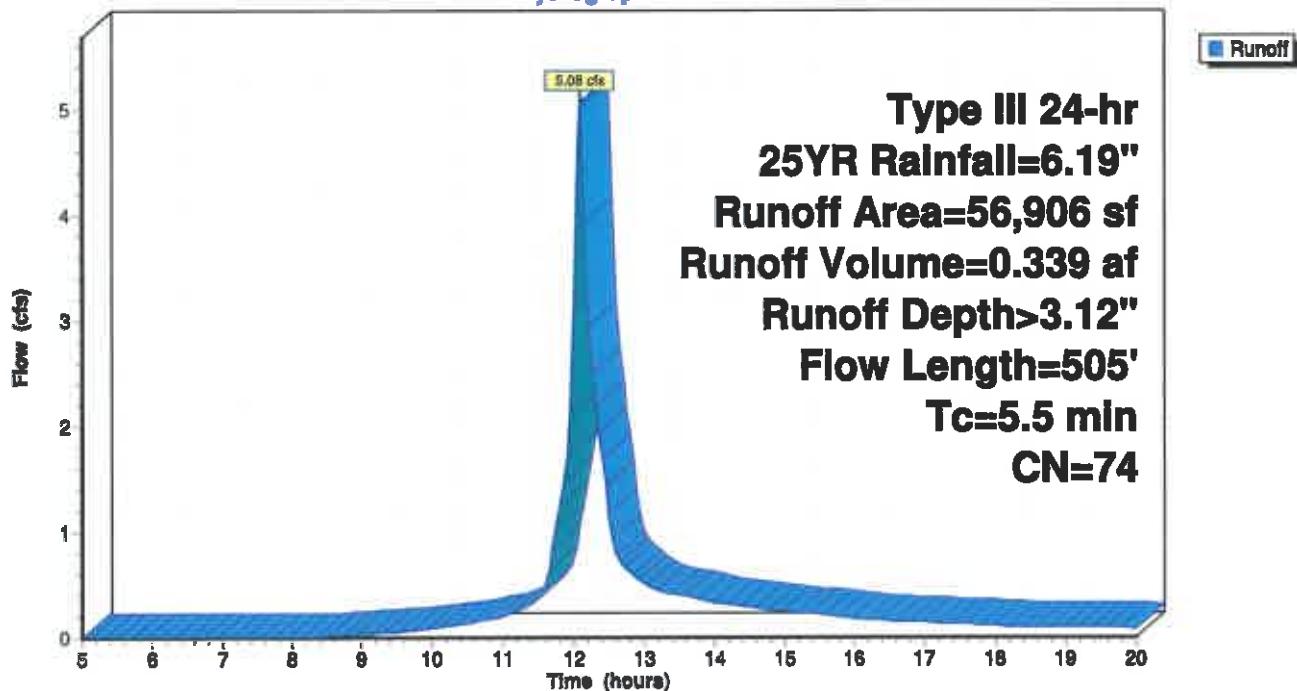
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 80

**Subcatchment P-4; P-4****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 81

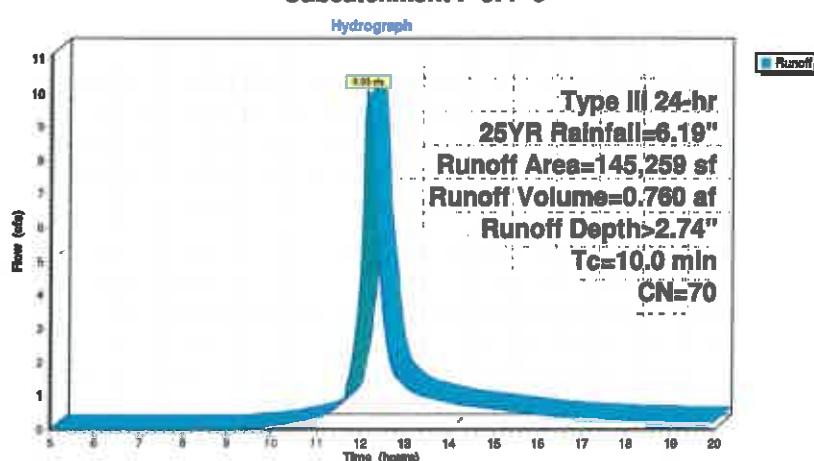
**Summary for Subcatchment P-5: P-5**

Runoff = 9.93 cfs @ 12.15 hrs, Volume= 0.760 af, Depth> 2.74"  
Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
145,259	70	Woods, Good, HSG C
145,259		100.00% Pervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
10.0	Direct Entry, TRAVEL PATH				

**Subcatchment P-5: P-5**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 82

**Summary for Subcatchment P-6: P-6**

Runoff = 6.14 cfs @ 12.12 hrs, Volume= 0.442 af, Depth> 2.83"  
 Routed to Reach IP-P2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description			
15,023	74	>75% Grass cover, Good, HSG C			
66,668	70	Woods, Good, HSG C			
81,691	71	Weighted Average			
81,691		100.00% Pervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.9	184	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
3.1	195	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
8.1	429	Total			

**PRE-POST DEVELOPMENT**

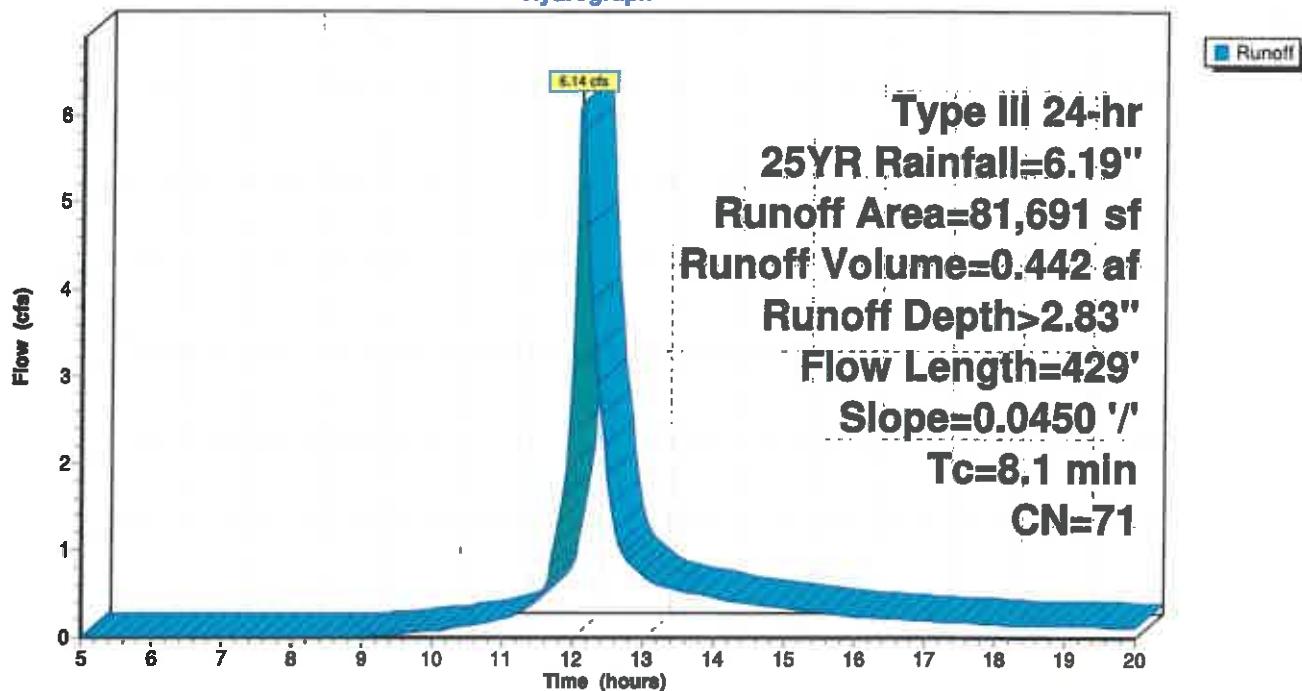
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 83

**Subcatchment P-6: P-6****Hydrograph**

### Summary for Subcatchment P-7: BUILDING

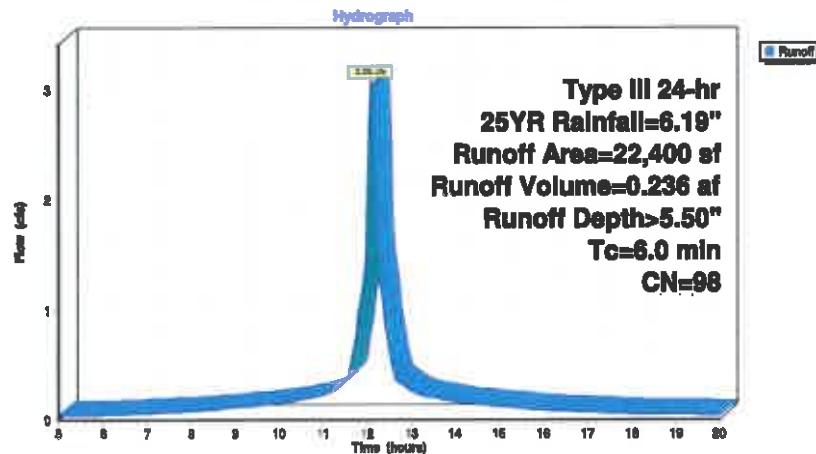
Runoff = 3.05 cfs @ 12.09 hrs, Volume= 0.236 af, Depth> 5.50"  
Routed to Pond PND4 : U/G BASIN

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25YR Rainfall=6.19"

Area (sf)	CN	Description
22,400	98	Roofs, HSG C
22,400		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TRAVEL PATH

### Subcatchment P-7: BUILDING



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

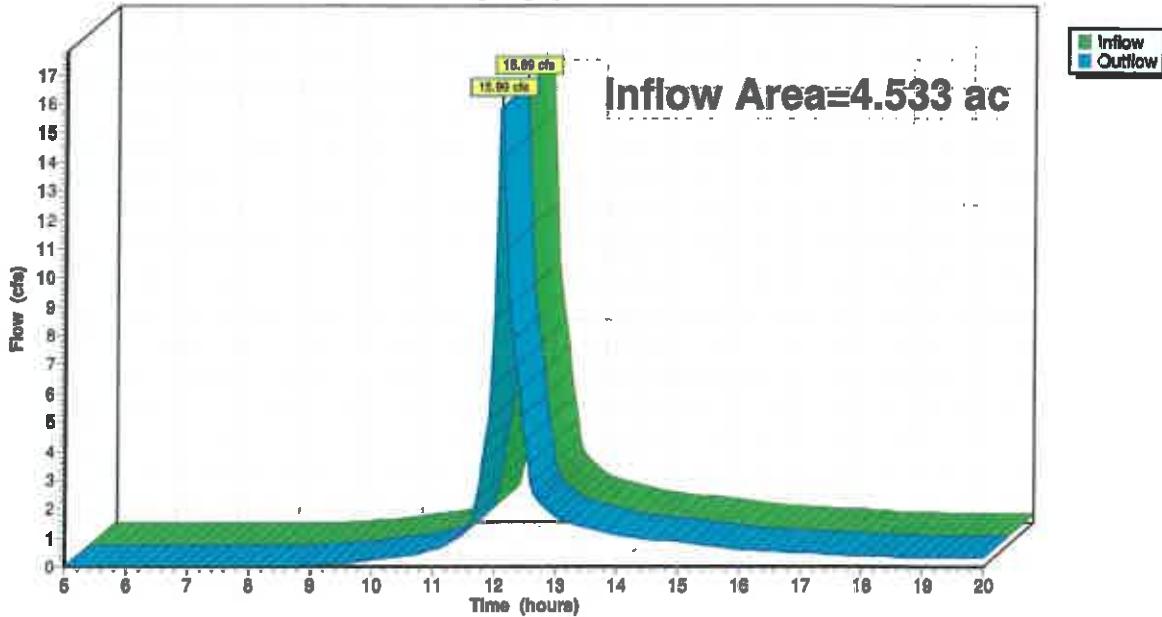
Printed 8/29/2023

Page 85

**Summary for Reach IP-E1: 45 MAIN ST**

Inflow Area = 4.533 ac, 3.58% Impervious, Inflow Depth > 2.93" for 25YR event  
Inflow = 15.89 cfs @ 12.11 hrs, Volume= 1.105 af  
Outflow = 15.89 cfs @ 12.11 hrs, Volume= 1.105 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 86

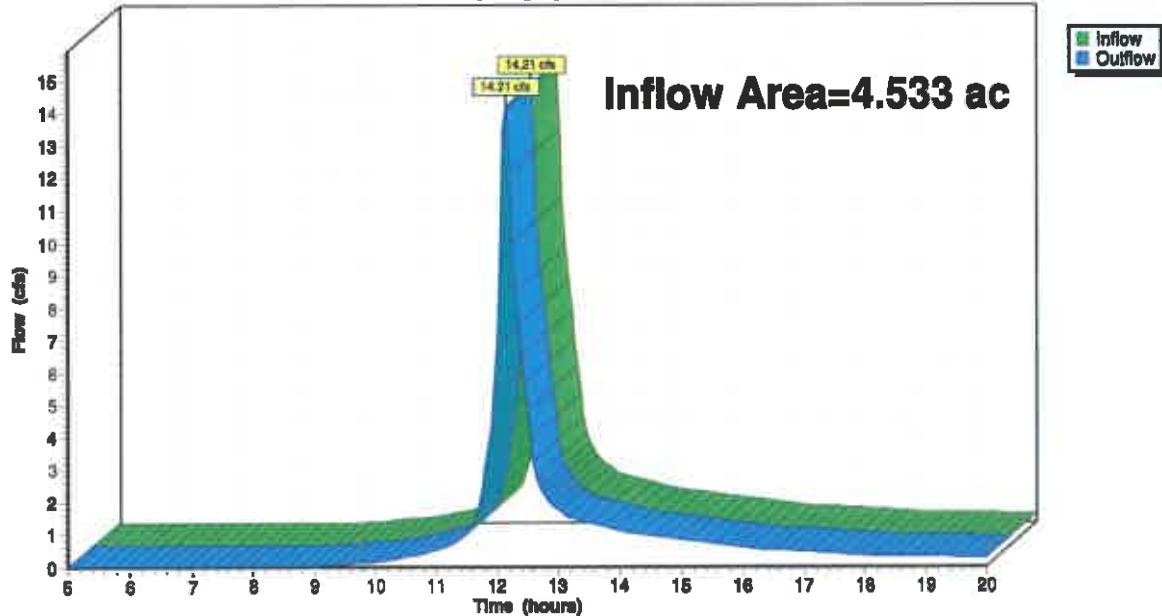
**Summary for Reach IP-E2: SCHOOL ST**

Inflow Area = 4.533 ac, 2.56% Impervious, Inflow Depth &gt; 2.83" for 25YR event

Inflow = 14.21 cfs @ 12.14 hrs, Volume= 1.069 af

Outflow = 14.21 cfs @ 12.14 hrs, Volume= 1.069 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

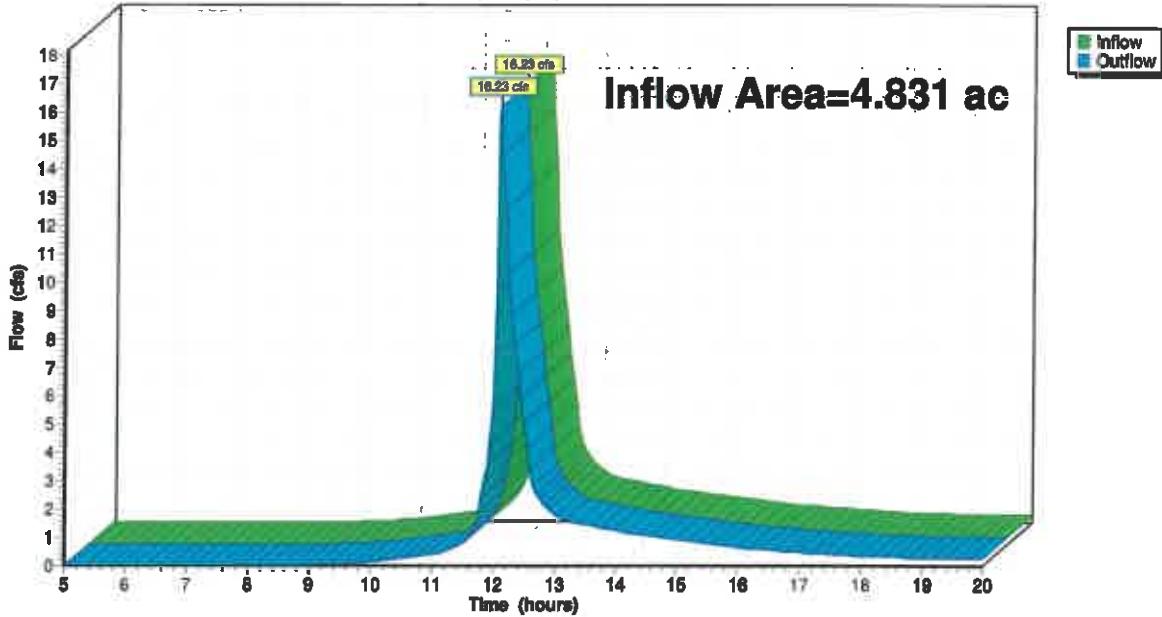
Printed 8/29/2023

Page 87

**Summary for Reach IP-P1: 45 MAIN ST**

Inflow Area = 4.831 ac, 4.14% Impervious, Inflow Depth > 2.67" for 25YR event  
Inflow = 16.23 cfs @ 12.12 hrs, Volume= 1.076 af  
Outflow = 16.23 cfs @ 12.12 hrs, Volume= 1.076 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 88

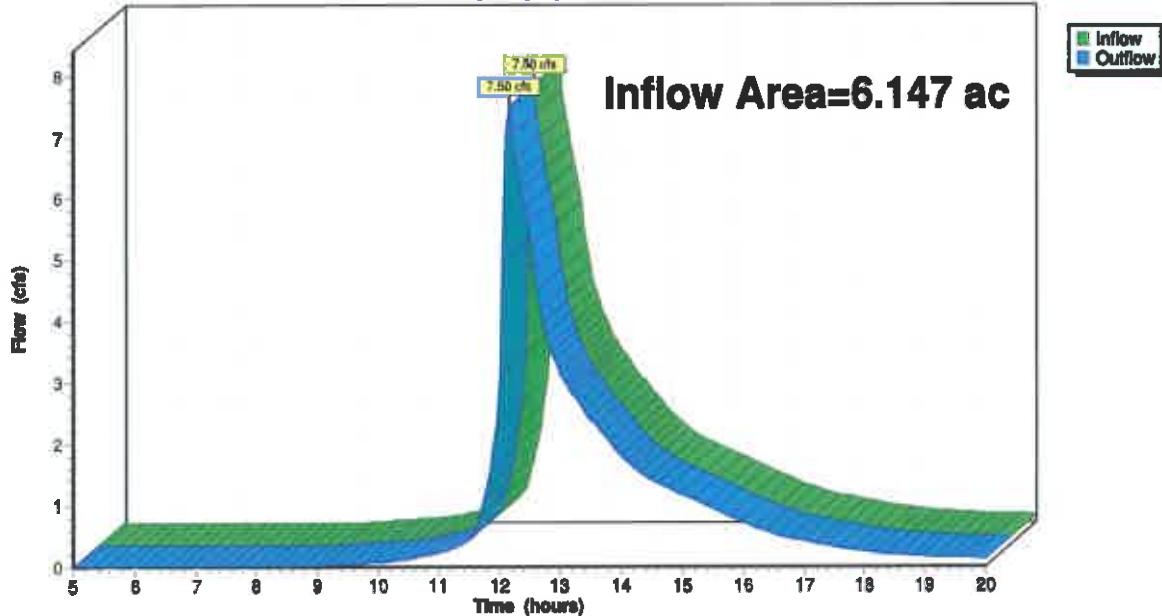
**Summary for Reach IP-P2: SCHOOL ST**

Inflow Area = 6.147 ac, 30.84% Impervious, Inflow Depth &gt; 1.94" for 25YR event

Inflow = 7.50 cfs @ 12.15 hrs, Volume= 0.995 af

Outflow = 7.50 cfs @ 12.15 hrs, Volume= 0.995 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 89

**Summary for Pond PND1: PND 1**

Inflow Area = 2.380 ac, 52.89% Impervious, Inflow Depth > 3.07" for 25YR event  
 Inflow = 8.57 cfs @ 12.10 hrs, Volume= 0.608 af  
 Outflow = 1.19 cfs @ 12.68 hrs, Volume= 0.405 af, Atten= 86%, Lag= 34.7 min  
 Discarded = 0.28 cfs @ 12.68 hrs, Volume= 0.181 af  
 Primary = 0.91 cfs @ 12.68 hrs, Volume= 0.224 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.15' @ 12.68 hrs Surf.Area= 5,042 sf Storage= 13,937 cf

Plug-Flow detention time= 158.8 min calculated for 0.404 af (66% of inflow)  
 Center-of-Mass det. time= 90.2 min ( 866.3 - 776.2 )

Volume	Invert	Avail.Storage	Storage Description
#1	320.00'	25,250 cf	Custom Stage Data (Prismatic) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
320.00	1,100	0	0
322.00	2,125	3,225	3,225
324.00	3,600	5,725	8,950
326.00	6,100	9,700	18,650
327.00	7,100	6,600	25,250

Device	Routing	Invert	Outlet Devices
#1	Discarded	320.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	325.00'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

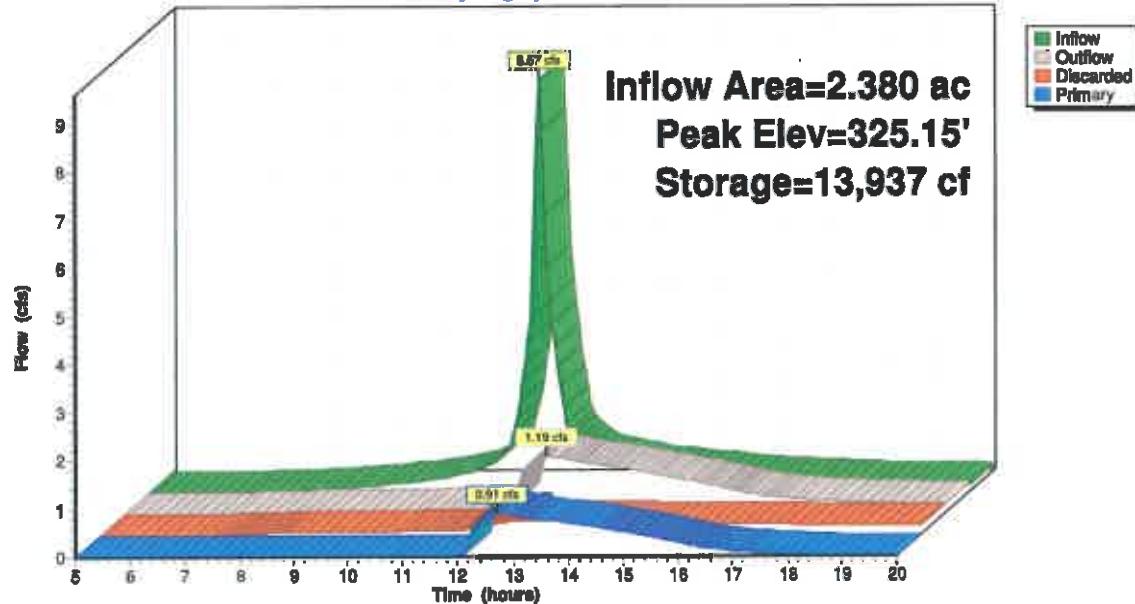
Printed 8/29/2023

Page 80

Discarded OutFlow Max=0.28 cfs @ 12.68 hrs HW=325.15' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.28 cfs)

Primary OutFlow Max=0.90 cfs @ 12.68 hrs HW=325.15' (Free Discharge)

- 2=Orifice/Grate (Orifice Controls 0.42 cfs @ 4.78 fps)
- 3=Orifice/Grate (Orifice Controls 0.42 cfs @ 4.78 fps)
- 4=Orifice/Grate (Orifice Controls 0.07 cfs @ 1.33 fps)

**Pond PND1: PND 1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 91

**Summary for Pond PND2: BASIN#2**

Inflow Area = 1.891 ac, 33.69% Impervious, Inflow Depth > 3.81" for 25YR event  
 Inflow = 8.49 cfs @ 12.10 hrs, Volume= 0.600 af  
 Outflow = 2.73 cfs @ 12.44 hrs, Volume= 0.468 af, Atten= 68%, Lag= 20.0 min  
 Discarded = 0.19 cfs @ 12.44 hrs, Volume= 0.140 af  
 Primary = 2.54 cfs @ 12.44 hrs, Volume= 0.329 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 326.26' @ 12.44 hrs Surf.Area= 3,379 sf Storage= 10,897 cf

Plug-Flow detention time= 106.3 min calculated for 0.467 af (78% of inflow)  
 Center-of-Mass det. time= 51.0 min ( 829.4 - 778.4 )

Volume	Invert	Avail.Storage	Storage Description
#1	322.00'	13,609 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
322.00	1,600	0	0
324.00	2,638	4,238	4,238
326.00	3,155	5,793	10,031
327.00	4,000	3,578	13,609

Device	Routing	Invert	Outlet Devices
#1	Discarded	322.00'	2.400 in/hr Exfiltration over Surface area
#2	Primary	324.50'	8.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	325.70'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	326.50'	10.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

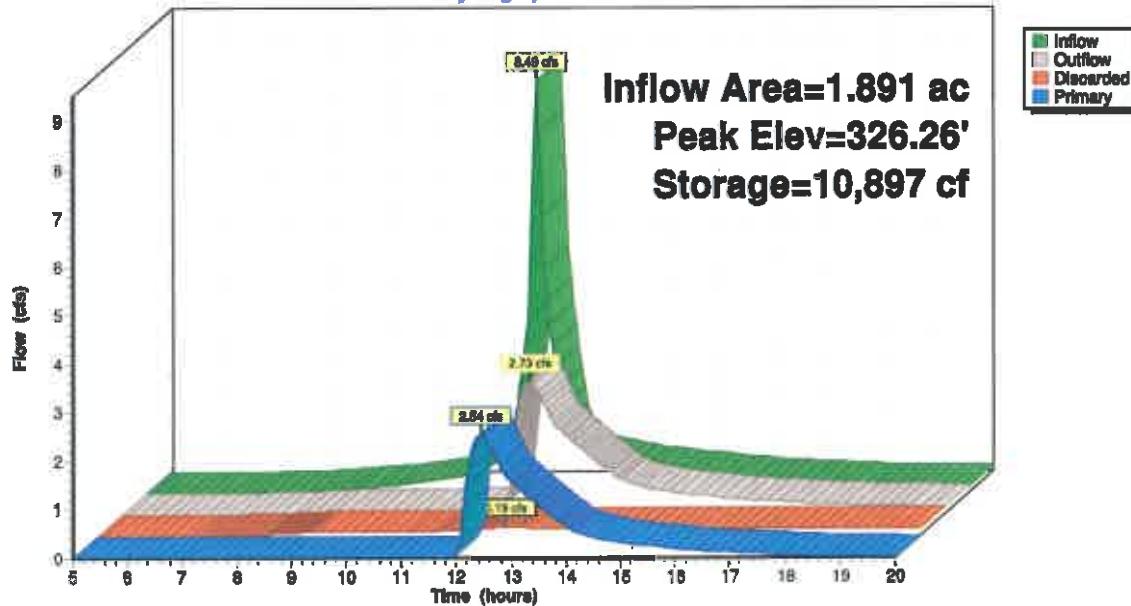
**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 92

Discarded OutFlow Max=0.19 cfs @ 12.44 hrs HW=326.26' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.19 cfs)

Primary OutFlow Max=2.54 cfs @ 12.44 hrs HW=326.26' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 2.01 cfs @ 5.76 fps)  
3=Orifice/Grate (Orifice Controls 0.53 cfs @ 2.69 fps)  
4=Broad-Created Rectangular Weir (Controls 0.00 cfs)

**Pond PND2: BASIN#2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 93

**Summary for Pond PND3: BASIN3**

Inflow Area = 1.306 ac, 7.39% Impervious, Inflow Depth > 3.12" for 25YR event  
 Inflow = 5.08 cfs @ 12.09 hrs, Volume= 0.339 af  
 Outflow = 5.91 cfs @ 12.11 hrs, Volume= 0.309 af, Atten= 0%, Lag= 1.3 min  
 Discarded = 0.09 cfs @ 12.11 hrs, Volume= 0.063 af  
 Primary = 5.82 cfs @ 12.11 hrs, Volume= 0.246 af  
 Routed to Reach IP-P1 : 45 MAIN ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 333.69' @ 12.11 hrs Surf.Area= 1,531 sf Storage= 3,224 cf

Plug-Flow detention time= 65.5 min calculated for 0.308 af (91% of inflow)  
 Center-of-Mass det. time= 36.0 min ( 827.2 - 791.2 )

Volume	Invert	Avail.Storage	Storage Description
#1	331.00'	5,380 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
331.00	510	0	0
332.00	1,250	880	880
335.00	1,750	4,500	5,380

Device	Routing	Invert	Outlet Devices
#1	Discarded	331.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	332.25'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	333.50'	25.0' long x 1.0' breadth Broad-Created Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

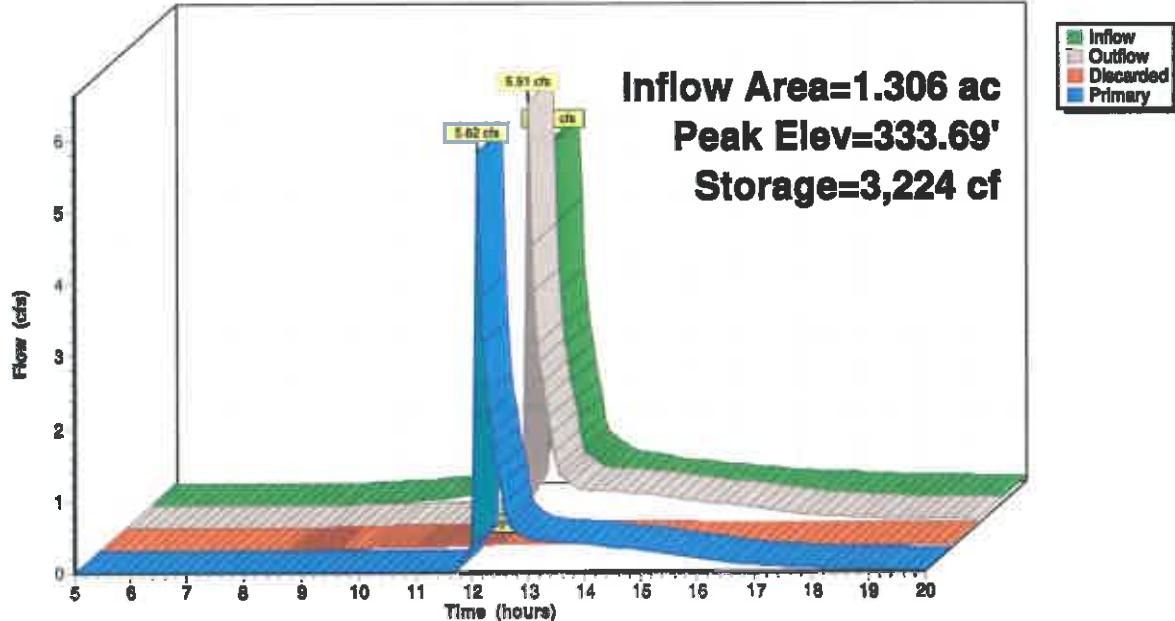
**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 94

**Discarded OutFlow** Max=0.08 cfs @ 12.11 hrs HW=333.67' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Primary OutFlow** Max=5.43 cfs @ 12.11 hrs HW=333.68' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.47 cfs @ 5.40 fps)  
3=Broad-Created Rectangular Weir (Weir Controls 4.96 cfs @ 1.13 fps)

**Pond PND3: BASIN3****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25YR Rainfall=6.19"

Printed 8/29/2023

Page 95

**Summary for Pond PND4: U/G BASIN**

Inflow Area = 0.514 ac, 100.00% Impervious, Inflow Depth > 5.50" for 25YR event  
 Inflow = 3.05 cfs @ 12.09 hrs, Volume= 0.236 af  
 Outflow = 0.20 cfs @ 10.95 hrs, Volume= 0.195 af, Atten= 93%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 10.95 hrs, Volume= 0.195 af  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af  
 Routed to Pond PND1 : PND 1

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.33' @ 13.51 hrs Surf.Area= 3,637 sf Storage= 4,446 cf

Plug-Flow detention time= 155.4 min calculated for 0.195 af (83% of inflow)  
 Center-of-Mass det. time= 106.1 min ( 840.1 - 734.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	324.00'	2,587 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 12,739 cf Overall - 6,270 cf Embedded = 6,468 cf x 40.0% Voids
#2	324.00'	6,270 cf	Cultec R-330XLHD x 120 Inside #1 Effective Size= 47.8" W x 30.0" H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0" W x 30.5" H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 1 rows
8,857 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
324.00	3,673	0	0
324.50	3,637	1,828	1,828
327.00	3,637	9,093	10,920
327.50	3,637	1,819	12,739

Device	Routing	Invert	Outlet Devices
#1	Discarded	324.00'	2,400 In/hr Exfiltration over Surface area
#2	Primary	326.50'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

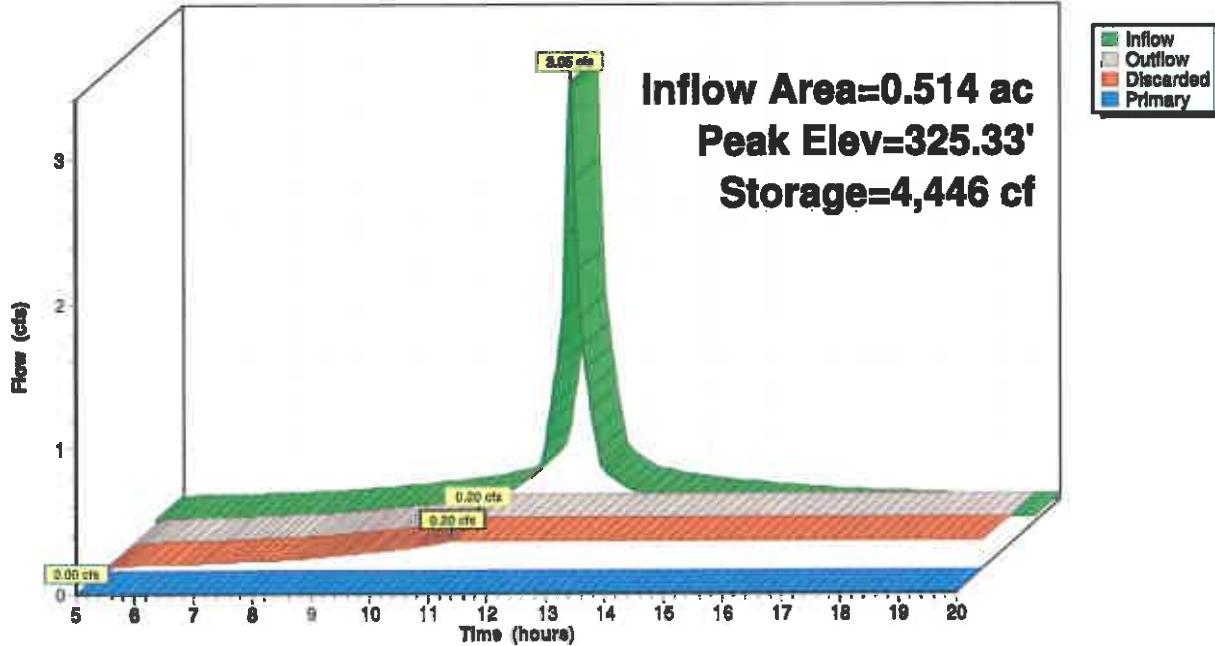
**Type III 24-hr 25YR Rainfall=6.19"**

Printed 8/29/2023

Page 96

Discarded OutFlow Max=0.20 cfs @ 10.95 hrs HW=324.04' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.20 cfs)

Primary OutFlow Max=0.00 cfs @ 5.00 hrs HW=324.00' (Free Discharge)  
2=Orifice/Grate (Controls 0.00 cfs)

**Pond PND4: U/G BASIN****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 97

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

**Subcatchment E-1: DA E-1**

Runoff Area=197,469 sf 3.58% Impervious Runoff Depth>4.26"  
Flow Length=560' Slope=0.0450 '/' Tc=7.1 min CN=72 Runoff=23.04 cfs 1.610 af

**Subcatchment E-2: DA E-2**

Runoff Area=197,469 sf 2.56% Impervious Runoff Depth>4.15"  
Flow Length=470' Tc=9.3 min CN=71 Runoff=20.77 cfs 1.567 af

**Subcatchment P-1: P-1**

Runoff Area=81,268 sf 39.90% Impervious Runoff Depth>5.39"  
Flow Length=618' Tc=7.1 min CN=82 Runoff=11.63 cfs 0.838 af

**Subcatchment P-2: P-2**

Runoff Area=82,391 sf 33.69% Impervious Runoff Depth>5.28"  
Flow Length=330' Tc=7.1 min CN=81 Runoff=11.59 cfs 0.832 af

**Subcatchment P-3: P-3**

Runoff Area=8,272 sf 54.38% Impervious Runoff Depth>5.96"  
Tc=6.0 min CN=87 Runoff=1.31 cfs 0.094 af

**Subcatchment P-4: P-4**

Runoff Area=56,906 sf 7.39% Impervious Runoff Depth>4.49"  
Flow Length=505' Tc=5.5 min CN=74 Runoff=7.25 cfs 0.488 af

**Subcatchment P-5: P-5**

Runoff Area=145,259 sf 0.00% Impervious Runoff Depth>4.04"  
Tc=10.0 min CN=70 Runoff=14.84 cfs 1.122 af

**Subcatchment P-6: P-6**

Runoff Area=81,691 sf 0.00% Impervious Runoff Depth>4.15"  
Flow Length=429' Slope=0.0450 '/' Tc=8.1 min CN=71 Runoff=8.98 cfs 0.649 af

**Subcatchment P-7: BUILDING**

Runoff Area=22,400 sf 100.00% Impervious Runoff Depth>7.01"  
Tc=6.0 min CN=98 Runoff=3.87 cfs 0.300 af

**Reach IP-E1: 45 MAIN ST**

Inflow=23.04 cfs 1.610 af  
Outflow=23.04 cfs 1.610 af

**Reach IP-E2: SCHOOL ST**

Inflow=20.77 cfs 1.567 af  
Outflow=20.77 cfs 1.567 af

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 98

**Reach IP-P1: 45 MAIN ST**Inflow=22.39 cfs 1.603 af  
Outflow=22.39 cfs 1.603 af**Reach IP-P2: SCHOOL ST**Inflow=15.27 cfs 1.615 af  
Outflow=15.27 cfs 1.615 af**Pond PND1: PND 1**Peak Elev=325.97' Storage=18,453 cf Inflow=11.63 cfs 0.838 af  
Discarded=0.34 cfs 0.205 af Primary=1.93 cfs 0.423 af Outflow=2.27 cfs 0.628 af**Pond PND2: BASIN#2**Peak Elev=326.79' Storage=12,783 cf Inflow=11.59 cfs 0.832 af  
Discarded=0.21 cfs 0.153 af Primary=7.36 cfs 0.543 af Outflow=7.58 cfs 0.696 af**Pond PND3: BASIN3**Peak Elev=333.71' Storage=3,267 cf Inflow=7.25 cfs 0.488 af  
Discarded=0.09 cfs 0.070 af Primary=7.18 cfs 0.387 af Outflow=7.24 cfs 0.456 af**Pond PND4: U/G BASIN**Peak Elev=325.96' Storage=6,278 cf Inflow=3.87 cfs 0.300 af  
Discarded=0.20 cfs 0.207 af Primary=0.00 cfs 0.000 af Outflow=0.20 cfs 0.207 af**Total Runoff Area = 20.044 ac Runoff Volume = 7,500 af Average Runoff Depth = 4.49"**  
**88.16% Pervious = 17.670 ac 11.84% Impervious = 2.374 ac**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 99

**Summary for Subcatchment E-1: DA E-1**

Runoff = 23.04 cfs @ 12.10 hrs, Volume= 1.610 af, Depth> 4.26"  
 Routed to Reach IP-E1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description			
7,074	98	Paved parking, HSG C			
35,876	74	>75% Grass cover, Good, HSG C			
154,519	70	Woods Good, HSG C			
197,469	72	Weighted Average			
190,395		96.42% Pervious Area			
7,074		3.58% Impervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.2	40	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH A TO B Unpaved Kv= 16.1 fps
0.5	110	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
6.4	410	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
7.1	560				Total

**PRE-POST DEVELOPMENT**

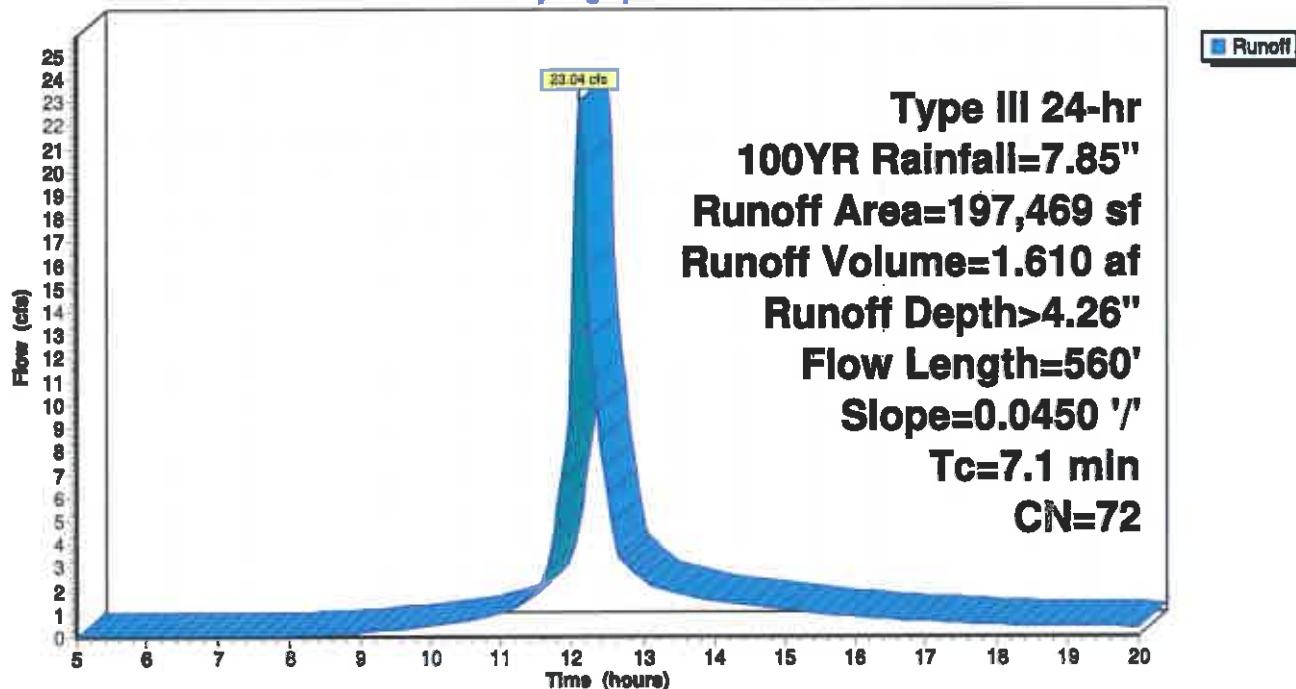
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 100

**Subcatchment E-1: DA E-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 101

**Summary for Subcatchment E-2: DA E-2**

Runoff = 20.77 cfs @ 12.13 hrs, Volume= 1.567 af, Depth> 4.15"  
 Routed to Reach IP-E2 : SCHOOL ST

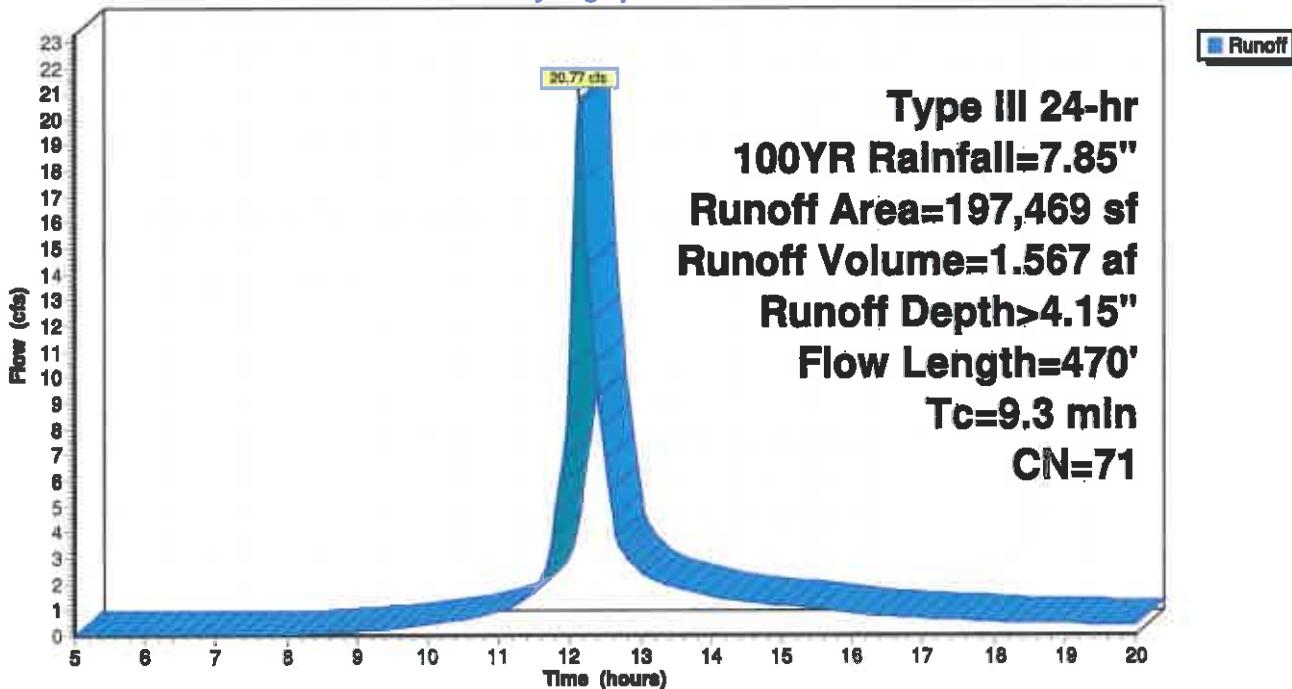
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description
5,057	98	Paved parking, HSG C
30,786	74	>75% Grass cover, Good, HSG C
161,626	70	Woods, Good, HSG C
197,469	71	Weighted Average
192,412		97.44% Pervious Area
5,057		2.56% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.4	40	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
2.9	225	0.0650	1.27		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
2.6	125	0.0250	0.79		Shallow Concentrated Flow, TARVEL PATH D TO E Woodland Kv= 5.0 fps
9.3	470	Total			

**Subcatchment E-2: DA E-2**

**Hydrograph**



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 103

**Summary for Subcatchment P-1: P-1**

Runoff = 11.63 cfs @ 12.10 hrs, Volume= 0.838 af, Depth> 5.39"  
 Routed to Pond PND1 : PND 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description
32,428	98	Paved parking, HSG C
26,882	74	>75% Grass cover, Good, HSG C
21,958	70	Woods, Good, HSG C
81,268	82	Weighted Average
48,840		60.10% Pervious Area
32,428		39.90% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		<b>Sheet Flow, TRAVEL PATH A TO B</b> Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
1.6	100	0.0450	1.06		<b>Shallow Concentrated Flow, TARVEL PATH C TO D</b> Woodland Kv= 5.0 fps
0.6	100	0.0200	2.87		<b>Shallow Concentrated Flow, TARVEL PATH D TO E</b> Paved Kv= 20.3 fps
0.4	288	0.0250	12.22	21.59	<b>Pipe Channel, TARVEL PATH E TO F</b> 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.010
7.1	618	Total			

**PRE-POST DEVELOPMENT**

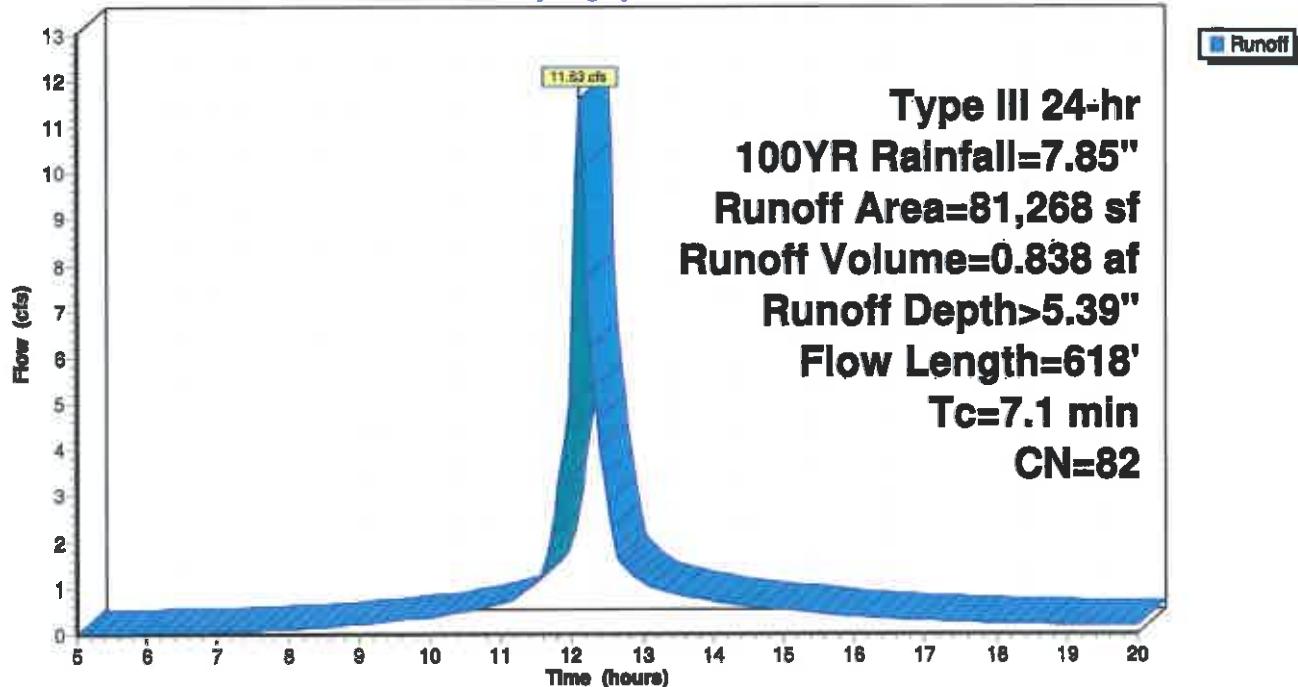
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 104

**Subcatchment P-1: P-1****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 105

**Summary for Subcatchment P-2: P-2**

Runoff = 11.59 cfs @ 12.10 hrs, Volume= 0.832 af, Depth> 5.28"  
 Routed to Pond PND2 : BASIN#2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description			
27,755	98	Paved parking, HSG C			
34,256	74	>75% Grass cover, Good, HSG C			
20,380	70	Woods, Good, HSG C			
82,391	81	Weighted Average			
54,636		66.31% Pervious Area			
27,755		33.69% Impervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.5	50	0.0450	0.19		<b>Sheet Flow, TRAVEL PATH A TO B</b> Cultivated: Residue>20% n= 0.170 P2= 3.20"
0.7	135	0.0450	3.42		<b>Shallow Concentrated Flow, TRAVEL PATH B TO C</b> Unpaved Kv= 16.1 fps
1.9	145	0.0650	1.27		<b>Shallow Concentrated Flow, TRAVEL PATH C TO D</b> Woodland Kv= 5.0 fps
7.1	330				<b>Total</b>

**PRE-POST DEVELOPMENT**

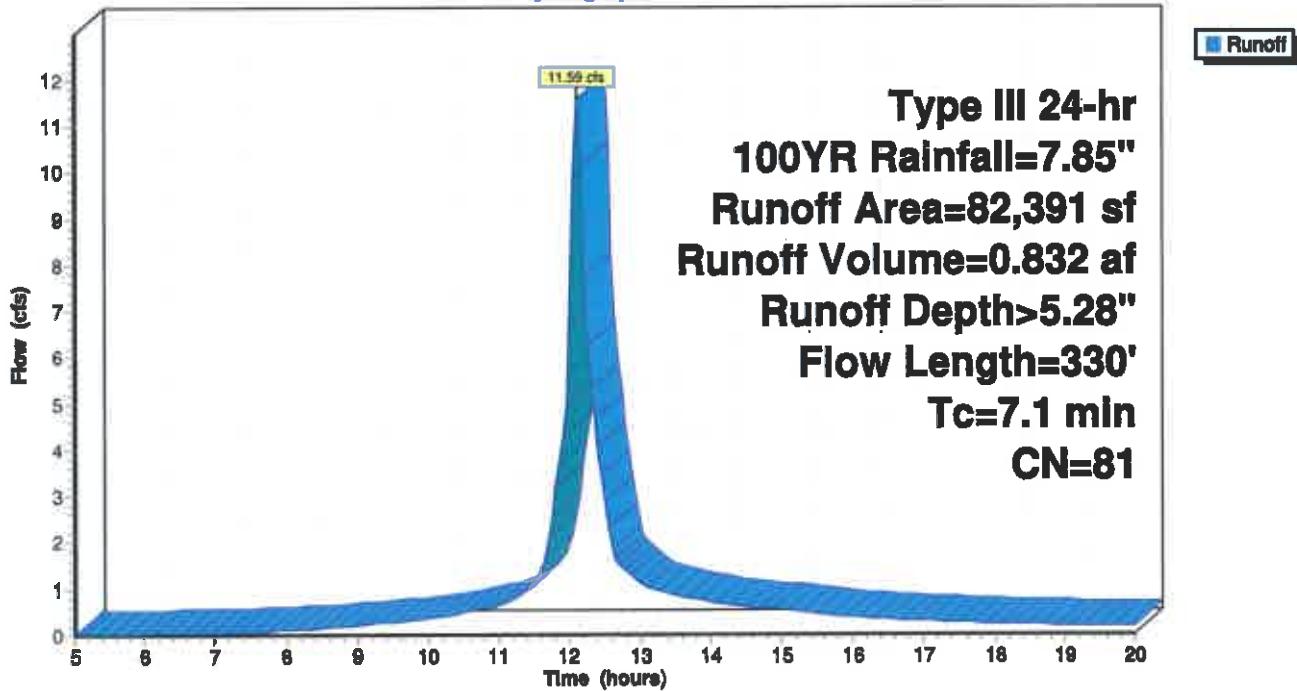
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 106

**Subcatchment P-2: P-2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 100YR Rainfall=7.85"*

Printed 8/29/2023

Page 107

**Summary for Subcatchment P-3: P-3**

Runoff = 1.31 cfs @ 12.09 hrs, Volume= 0.094 af, Depth> 5.96"  
 Routed to Reach IP-P1 : 45 MAIN ST

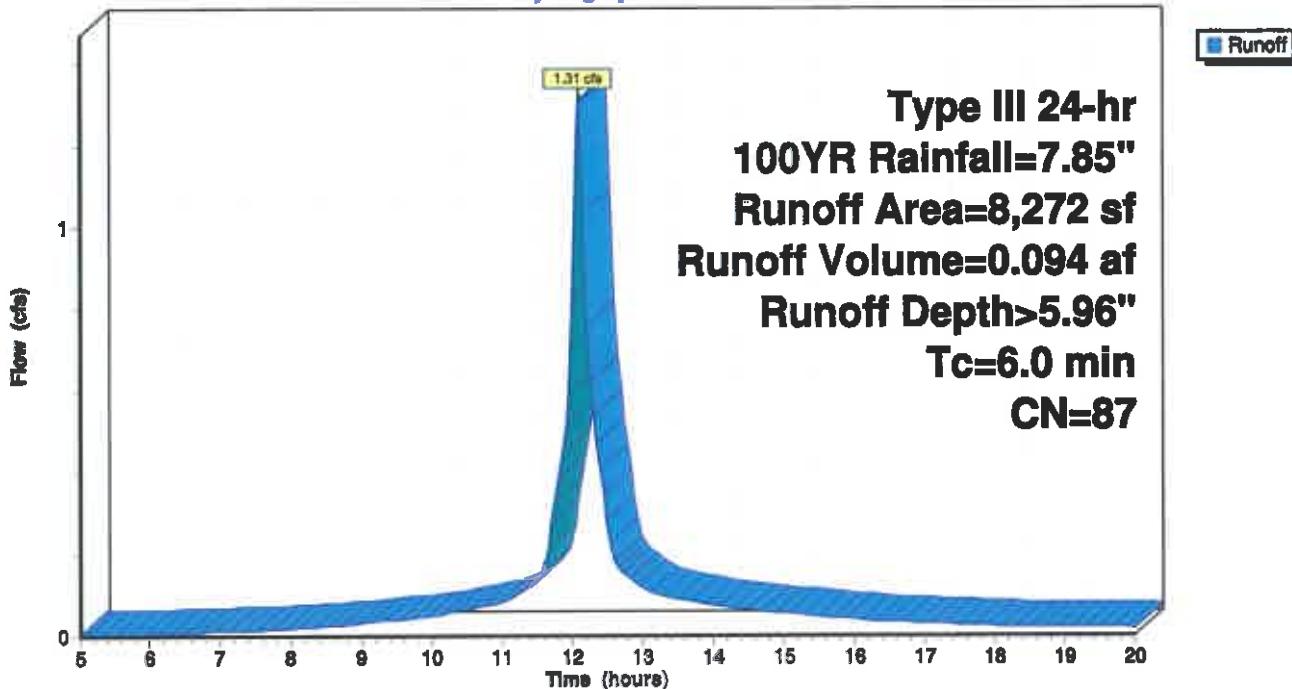
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description
4,498	98	Paved parking, HSG C
3,774	74	>75% Grass cover, Good, HSG C
8,272	87	Weighted Average
3,774		45.62% Pervious Area
4,498		54.38% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
Direct Entry, TRAVEL PATH					

**Subcatchment P-3: P-3**

**Hydrograph**



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 109

**Summary for Subcatchment P-4: P-4**

Runoff = 7.25 cfs @ 12.08 hrs, Volume= 0.488 af, Depth> 4.49"  
 Routed to Pond PND3 : BASIN3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description			
4,207	98	Paved parking, HSG C			
22,144	74	>75% Grass cover, Good, HSG C			
30,555	70	Woods, Good, HSG C			
56,806	74	Weighted Average			
52,699		92.61% Pervious Area			
4,207		7.39% Impervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.4	80	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C
0.5	100	0.4500	3.35		Unpaved Kv= 16.1 fps Shallow Concentrated Flow, TRAVEL PATH C TO D
0.1	25	0.0250	3.21		Woodland Kv= 5.0 fps Shallow Concentrated Flow, TRAVEL PATH D TO E
0.4	250	0.0250	10.82	13.28	Paved Kv= 20.3 fps Pipe Channel, TRAVEL PATH F TO E 15.0" Round Area= 1.2 sf Perlm= 3.9' r= 0.31' n= 0.010
5.5	505	Total			

**PRE-POST DEVELOPMENT**

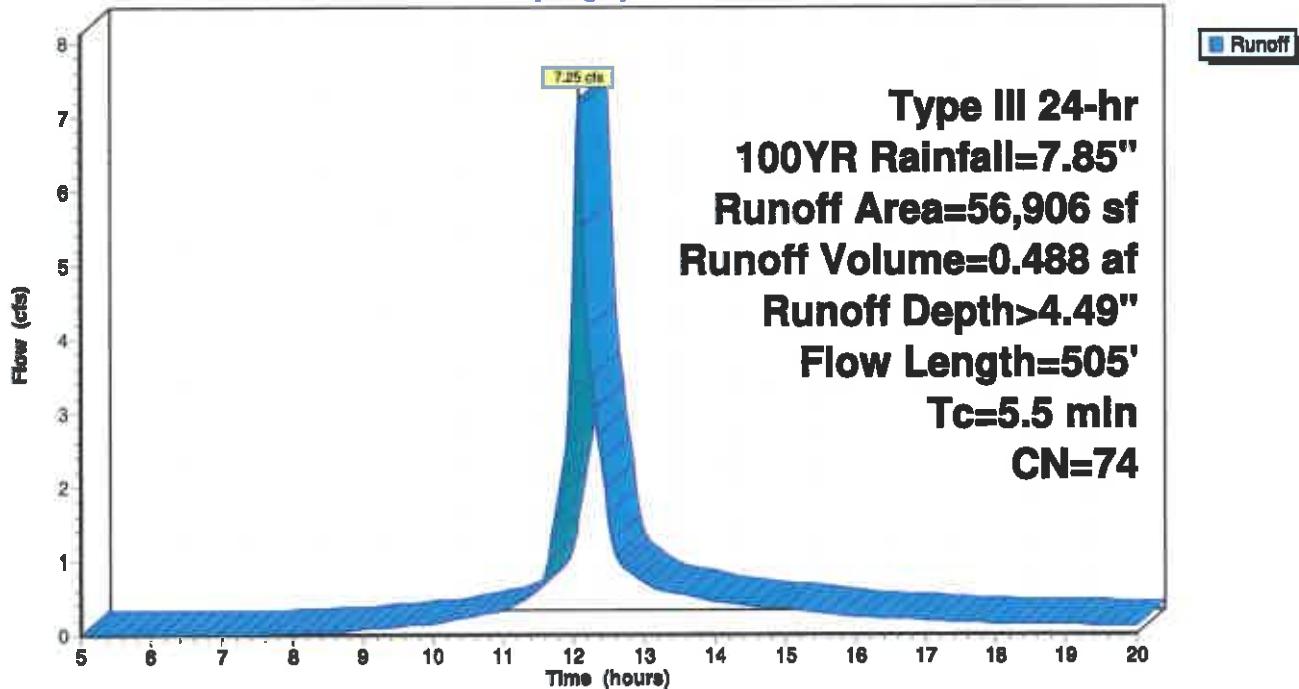
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 110

**Subcatchment P-4: P-4****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 111

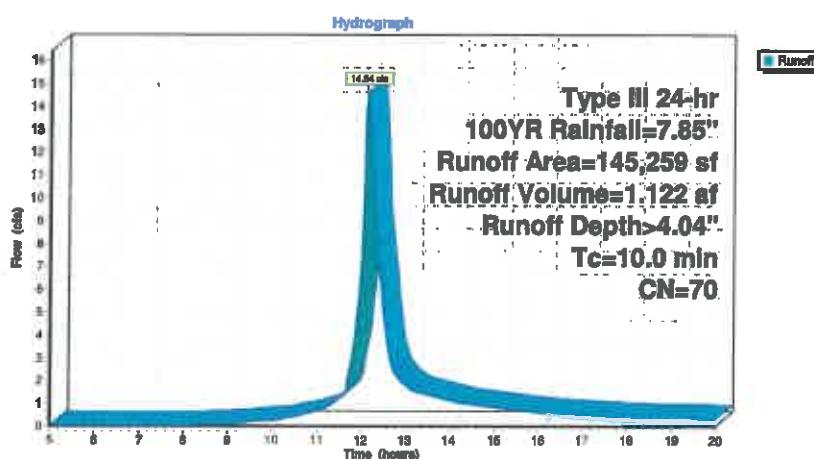
**Summary for Subcatchment P-5: P-5**

Runoff = 14.64 cfs @ 12.14 hrs, Volume= 1.122 af, Depth> 4.04"  
Routed to Reach IP-P1 : 45 MAIN ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description
145,259	70	Woods, Good, HSG C
145,259		100.00% Pervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
10.0	Direct Entry, TRAVEL PATH				

**Subcatchment P-5: P-5**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20.3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 112

**Summary for Subcatchment P-6: P-6**

Runoff = 8.98 cfs @ 12.12 hrs, Volume= 0.649 af, Depth> 4.15"  
 Routed to Reach IP-P2 : SCHOOL ST

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description			
15,023	74	>75% Grass cover, Good, HSG C			
66,668	70	Woods, Good, HSG C			
81,691	71	Weighted Average			
81,691		100.00% Pervious Area			
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.1	50	0.0450	0.20		Sheet Flow, TRAVEL PATH A TO B Grass: Short n= 0.150 P2= 3.20"
0.9	184	0.0450	3.42		Shallow Concentrated Flow, TRAVEL PATH B TO C Unpaved Kv= 16.1 fps
3.1	195	0.0450	1.06		Shallow Concentrated Flow, TRAVEL PATH C TO D Woodland Kv= 5.0 fps
8.1	429	Total			

**PRE-POST DEVELOPMENT**

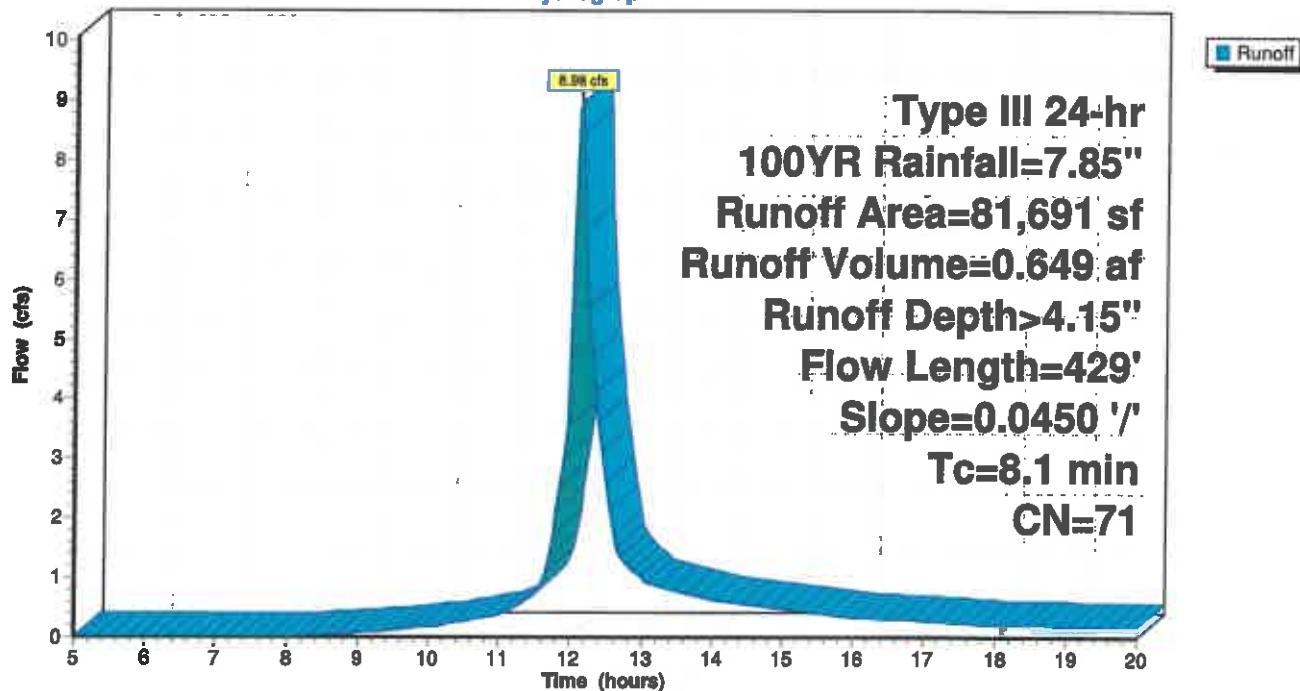
Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 113

**Subcatchment P-6: P-6****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 114

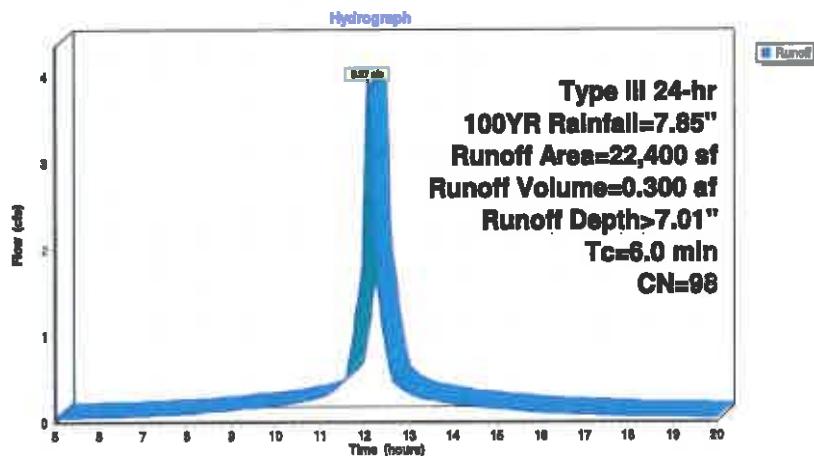
**Summary for Subcatchment P-7: BUILDING**

Runoff = 3.87 cfs @ 12.09 hrs, Volume= 0.300 af, Depth> 7.01"  
Routed to Pond PND4 : U/G BASIN

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100YR Rainfall=7.85"

Area (sf)	CN	Description
22,400	98	Roofs, HSG C
22,400		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TRAVEL PATH

**Subcatchment P-7: BUILDING**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 100YR Rainfall=7.85"*

Printed 8/29/2023

Page 115

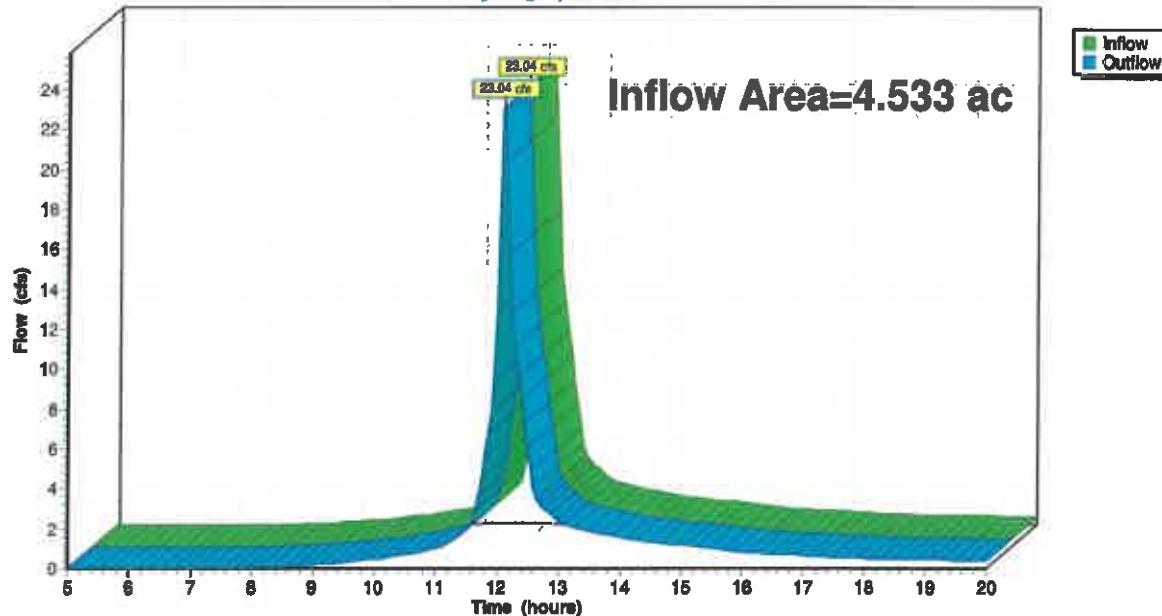
**Summary for Reach IP-E1: 45 MAIN ST**

Inflow Area = 4.533 ac, 3.58% Impervious, Inflow Depth &gt; 4.26" for 100YR event

Inflow = 23.04 cfs @ 12.10 hrs, Volume= 1.610 af

Outflow = 23.04 cfs @ 12.10 hrs, Volume= 1.610 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

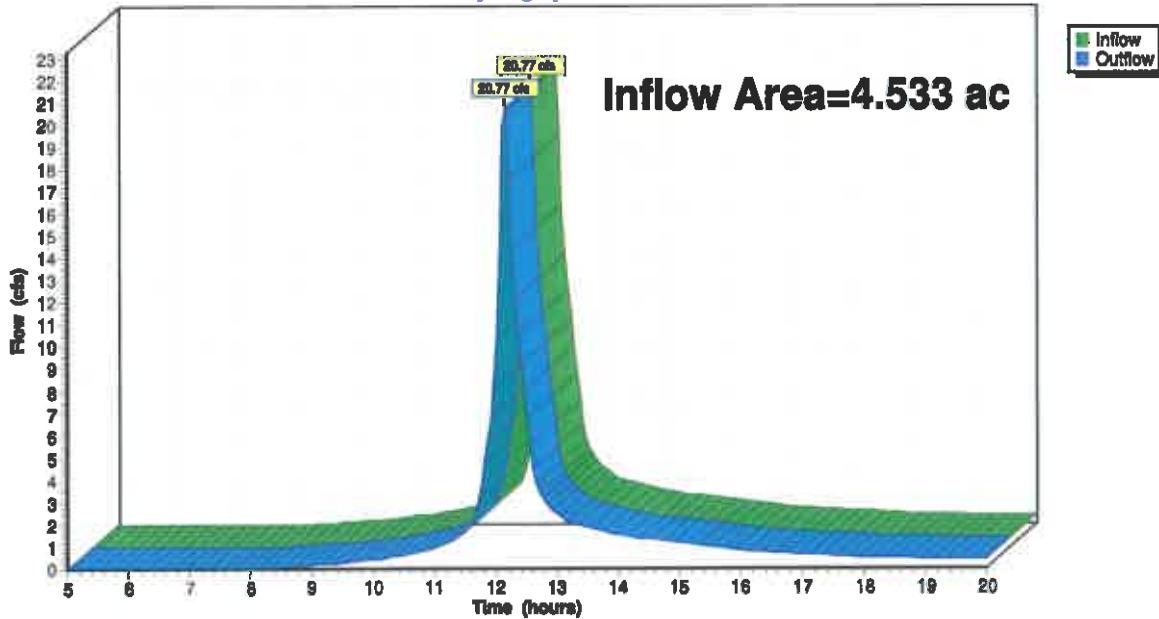
Printed 8/28/2023

Page 116

**Summary for Reach IP-E2: SCHOOL ST**

Inflow Area = 4.533 ac, 2.56% Impervious, Inflow Depth > 4.15" for 100YR event  
Inflow = 20.77 cfs @ 12.13 hrs, Volume= 1.567 af  
Outflow = 20.77 cfs @ 12.13 hrs, Volume= 1.567 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-E2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

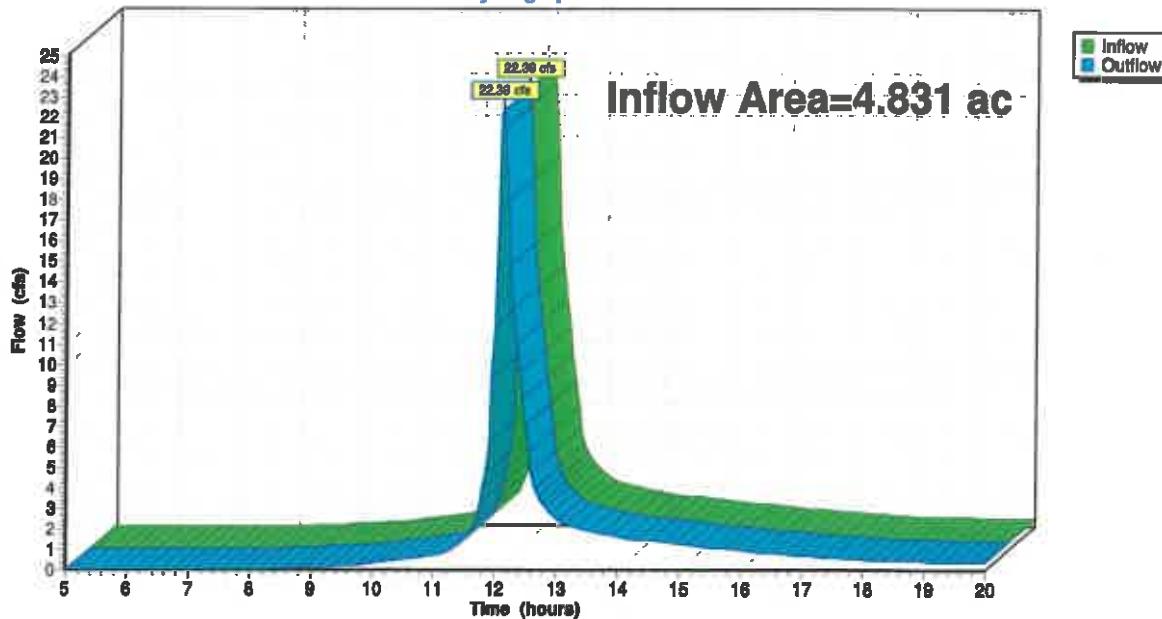
Printed 8/29/2023

Page 117

**Summary for Reach IP-P1: 45 MAIN ST**

Inflow Area = 4.831 ac, 4.14% Impervious, Inflow Depth > 3.98" for 100YR event  
Inflow = 22.39 cfs @ 12.12 hrs, Volume= 1.603 af  
Outflow = 22.39 cfs @ 12.12 hrs, Volume= 1.603 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P1: 45 MAIN ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100YR Rainfall=7.85"

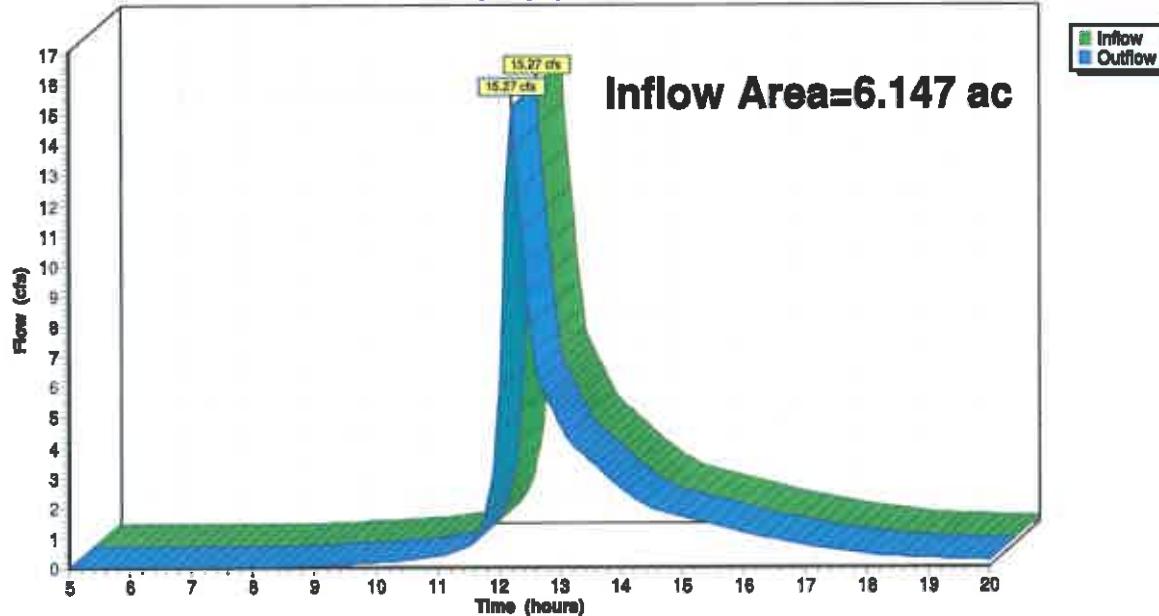
Printed 8/29/2023

Page 118

**Summary for Reach IP-P2: SCHOOL ST**

Inflow Area = 6.147 ac, 30.84% Impervious, Inflow Depth > 3.15" for 100YR event  
Inflow = 15.27 cfs @ 12.20 hrs, Volume= 1.615 af  
Outflow = 15.27 cfs @ 12.20 hrs, Volume= 1.615 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach IP-P2: SCHOOL ST****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 100YR Rainfall=7.85"*

Printed 8/29/2023

Page 119

**Summary for Pond PND1: PND 1**

Inflow Area = 2.380 ac, 52.89% Impervious, Inflow Depth > 4.23" for 100YR event  
 Inflow = 11.63 cfs @ 12.10 hrs, Volume= 0.838 af  
 Outflow = 2.27 cfs @ 12.56 hrs, Volume= 0.628 af, Atten= 81%, Lag= 27.4 min  
 Discarded = 0.34 cfs @ 12.56 hrs, Volume= 0.205 af  
 Primary = 1.93 cfs @ 12.56 hrs, Volume= 0.423 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.97' @ 12.56 hrs Surf.Area= 6,059 sf Storage= 18,453 cf

Plug-Flow detention time= 144.8 min calculated for 0.628 af (75% of inflow)  
 Center-of-Mass det. time= 84.4 min ( 852.9 - 768.5 )

Volume	Invert	Avail.Storage	Storage Description
--------	--------	---------------	---------------------

#1	320.00'	25,250 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
----	---------	-----------	---

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
320.00	1,100	0	0
322.00	2,125	3,225	3,225
324.00	3,600	5,725	8,950
326.00	6,100	9,700	18,650
327.00	7,100	6,600	25,250

Device	Routing	Invert	Outlet Devices
--------	---------	--------	----------------

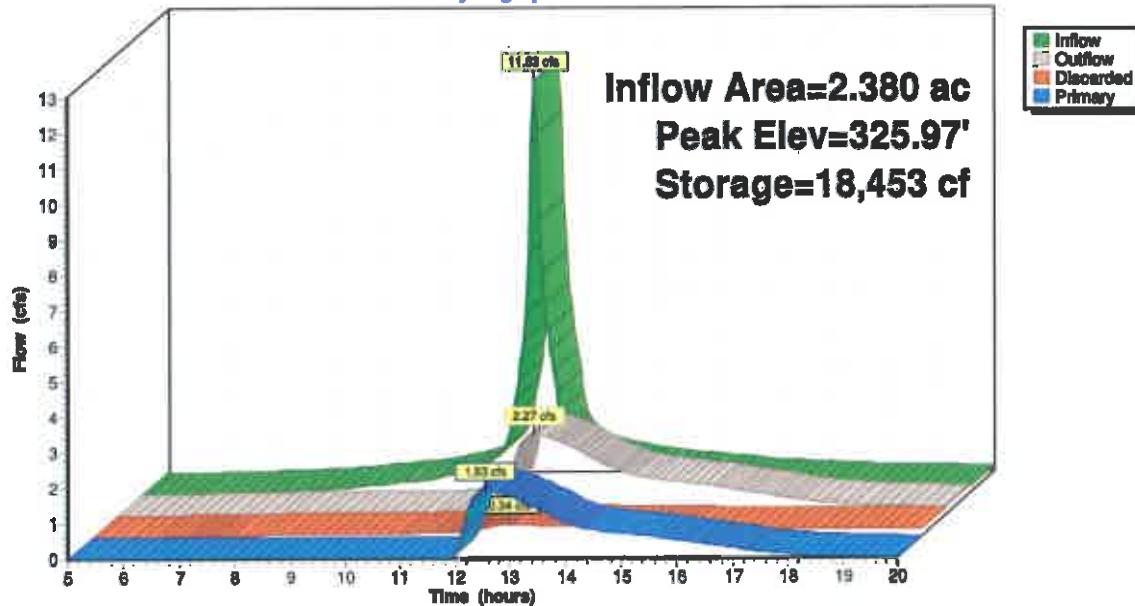
#1	Discarded	320.00'	2,400 in/hr Exfiltration over Surface area
#2	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	324.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	325.00'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**Discarded OutFlow** Max=0.34 cfs @ 12.56 hrs HW=325.97' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.34 cfs)

**Primary OutFlow** Max=1.93 cfs @ 12.56 hrs HW=325.97' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.56 cfs @ 6.46 fps)  
3=Orifice/Grate (Orifice Controls 0.56 cfs @ 6.46 fps)  
4=Orifice/Grate (Orifice Controls 0.80 cfs @ 4.08 fps)

### Pond PND1: PND 1

#### Hydrograph



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 121

**Summary for Pond PND2: BASIN#2**

Inflow Area = 1.891 ac, 33.69% Impervious, Inflow Depth > 5.28" for 100YR event  
 Inflow = 11.59 cfs @ 12.10 hrs, Volume= 0.832 af  
 Outflow = 7.58 cfs @ 12.22 hrs, Volume= 0.696 af, Atten= 35%, Lag= 7.1 min  
 Discarded = 0.21 cfs @ 12.22 hrs, Volume= 0.153 af  
 Primary = 7.36 cfs @ 12.22 hrs, Volume= 0.543 af  
 Routed to Reach IP-P2 : SCHOOL ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 326.79' @ 12.22 hrs Surf.Area= 3,822 sf Storage= 12,783 cf

Plug-Flow detention time= 89.5 min calculated for 0.693 af (83% of inflow)  
 Center-of-Mass det. time= 43.7 min ( 814.2 - 770.6 )

Volume	Invert	Avail.Storage	Storage Description
--------	--------	---------------	---------------------

#1	322.00'	13,609 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
----	---------	-----------	---

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
322.00	1,600	0	0
324.00	2,638	4,238	4,238
326.00	3,155	5,793	10,031
327.00	4,000	3,578	13,609

Device	Routing	Invert	Outlet Devices
--------	---------	--------	----------------

#1	Discarded	322.00'	2.400 in/hr Exfiltration over Surface area
#2	Primary	324.50'	8.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	325.70'	6.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Primary	326.50'	10.0" long x 1.0" breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

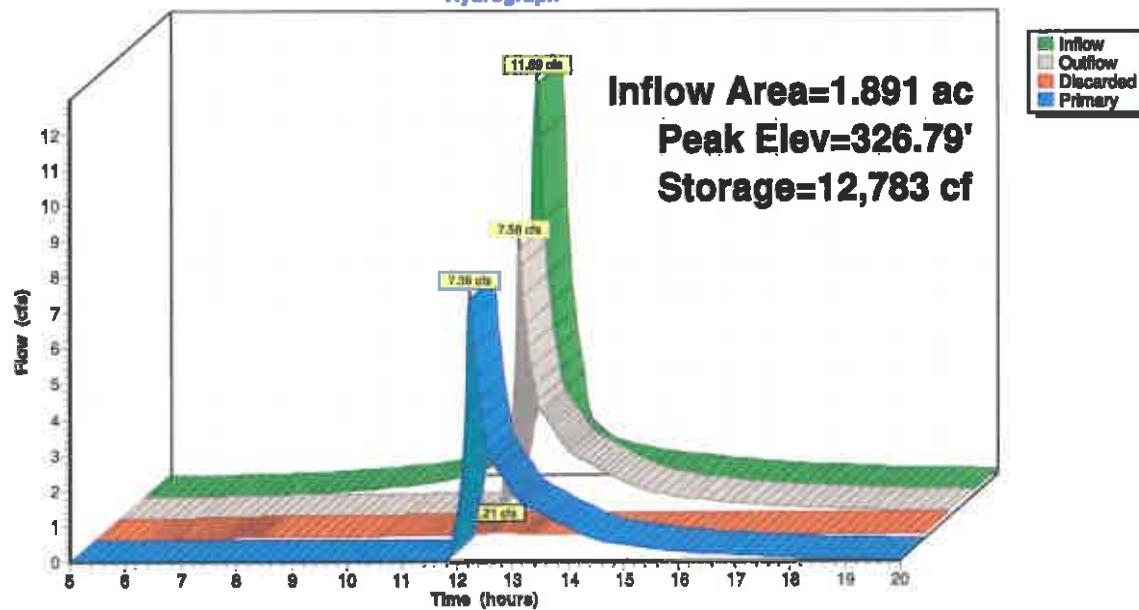
**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 122

**Discarded OutFlow** Max=0.21 cfs @ 12.22 hrs HW=326.77' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.21 cfs)

**Primary OutFlow** Max=6.98 cfs @ 12.22 hrs HW=326.77' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 2.34 cfs @ 6.70 fps)  
3=Orifice/Grate (Orifice Controls 0.86 cfs @ 4.36 fps)  
4=Broad-Created Rectangular Weir (Weir Controls 3.79 cfs @ 1.40 fps)

**Pond PND2: BASIN#2****Hydrograph**

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

*Type III 24-hr 100YR Rainfall=7.85"*

Printed 8/29/2023

Page 123

**Summary for Pond PND3: BASIN3**

Inflow Area = 1.306 ac, 7.39% Impervious, Inflow Depth > 4.49" for 100YR event  
 Inflow = 7.25 cfs @ 12.08 hrs, Volume= 0.488 af  
 Outflow = 7.24 cfs @ 12.10 hrs, Volume= 0.456 af, Atten= 0%, Lag= 0.6 min  
 Discarded = 0.09 cfs @ 12.10 hrs, Volume= 0.070 af  
 Primary = 7.16 cfs @ 12.10 hrs, Volume= 0.387 af  
 Routed to Reach IP-P1 : 45 MAIN ST

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 333.71' @ 12.10 hrs Surf.Area= 1,536 sf Storage= 3,267 cf

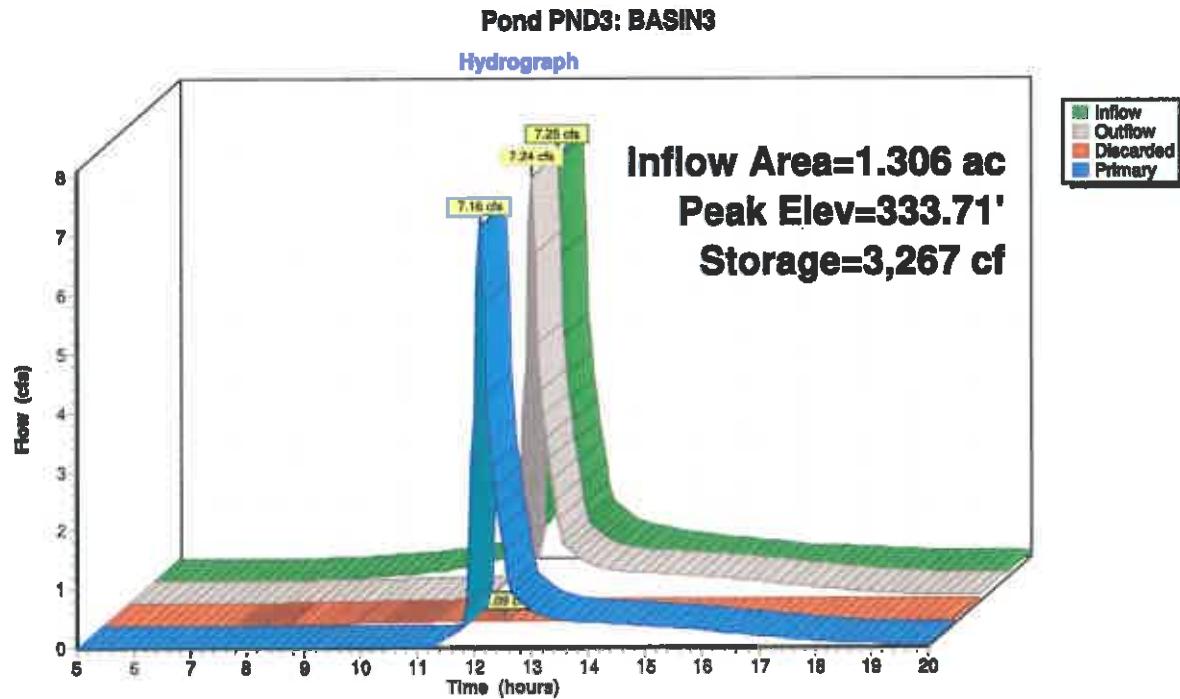
Plug-Flow detention time= 54.2 min calculated for 0.455 af (93% of inflow)  
 Center-of-Mass det. time= 31.2 min ( 813.9 - 782.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	331.00'	5,380 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
331.00	510	0	0
332.00	1,250	880	880
335.00	1,750	4,500	5,380

Device	Routing	Invert	Outlet Devices
#1	Discarded	331.00'	2.400 In/hr Exfiltration over Surface area
#2	Primary	332.25'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Primary	333.50'	25.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32

Discarded OutFlow Max=0.09 cfs @ 12.10 hrs HW=333.71' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=7.05 cfs @ 12.10 hrs HW=333.71' (Free Discharge)  
2=Orifice/Grate (Orifice Controls 0.48 cfs @ 5.48 fps)  
3=Broad-Created Rectangular Weir (Weir Controls 6.57 cfs @ 1.24 fps)



**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c s/n 13057 © 2023 HydroCAD Software Solutions LLC

**Type III 24-hr 100YR Rainfall=7.85"**

Printed 8/29/2023

Page 125

**Summary for Pond PND4: U/G BASIN**

Inflow Area = 0.514 ac, 100.00% Impervious, Inflow Depth > 7.01" for 100YR event  
 Inflow = 3.87 cfs @ 12.09 hrs, Volume= 0.300 af  
 Outflow = 0.20 cfs @ 10.35 hrs, Volume= 0.207 af, Atten= 95%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 10.35 hrs, Volume= 0.207 af  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af  
 Routed to Pond PND1 : PND 1

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 325.98' @ 14.07 hrs Surf.Area= 3,637 sf Storage= 6,278 cf

Plug-Flow detention time= 159.7 min calculated for 0.206 af (69% of inflow)  
 Center-of-Mass det. time= 89.2 min ( 822.4 - 733.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	324.00'	2,587 cf	Custom Stage Data (Prismatic) Listed below (Recalc) 12,739 cf Overall - 6,270 cf Embedded = 6,468 cf x 40.0% Voids
#2	324.00'	6,270 cf	Culitec R-330XLHD x 120 Inside #1 Effective Size= 47.8" W x 30.0" H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0" W x 30.5" H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 1 rows
8,857 cf			Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
324.00	3,637	0	0
324.50	3,637	1,828	1,828
327.00	3,637	9,093	10,920
327.50	3,637	1,819	12,739

Device	Routing	Invert	Outlet Devices
#1	Discarded	324.00'	2,400 in/hr Exfiltration over Surface area
#2	Primary	326.50'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

**PRE-POST DEVELOPMENT**

Prepared by D&amp;L Design Group Inc

HydroCAD® 10.20-3c a/n 13057 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100YR Rainfall=7.85"

Printed 8/29/2023

Page 126

Discarded OutFlow Max=0.20 cfs @ 10.35 hrs HW=324.04' (Free Discharge)  
1=Exfiltration (Exfiltration Controls 0.20 cfs)

Primary OutFlow Max=0.00 cfs @ 5.00 hrs HW=324.00' (Free Discharge)  
2=Orifice/Grate (Controls 0.00 cfs)

**Pond PND4: U/G BASIN****Hydrograph**